
Σ-Ⅱ Series SGM□H/SGDM

USER'S MANUAL
Design and Maintenance

SGMAH/SGMPH/SGMGH/SGMSH/SGMDH Servomotors
SGDM Servopack

efesotomasyon.com

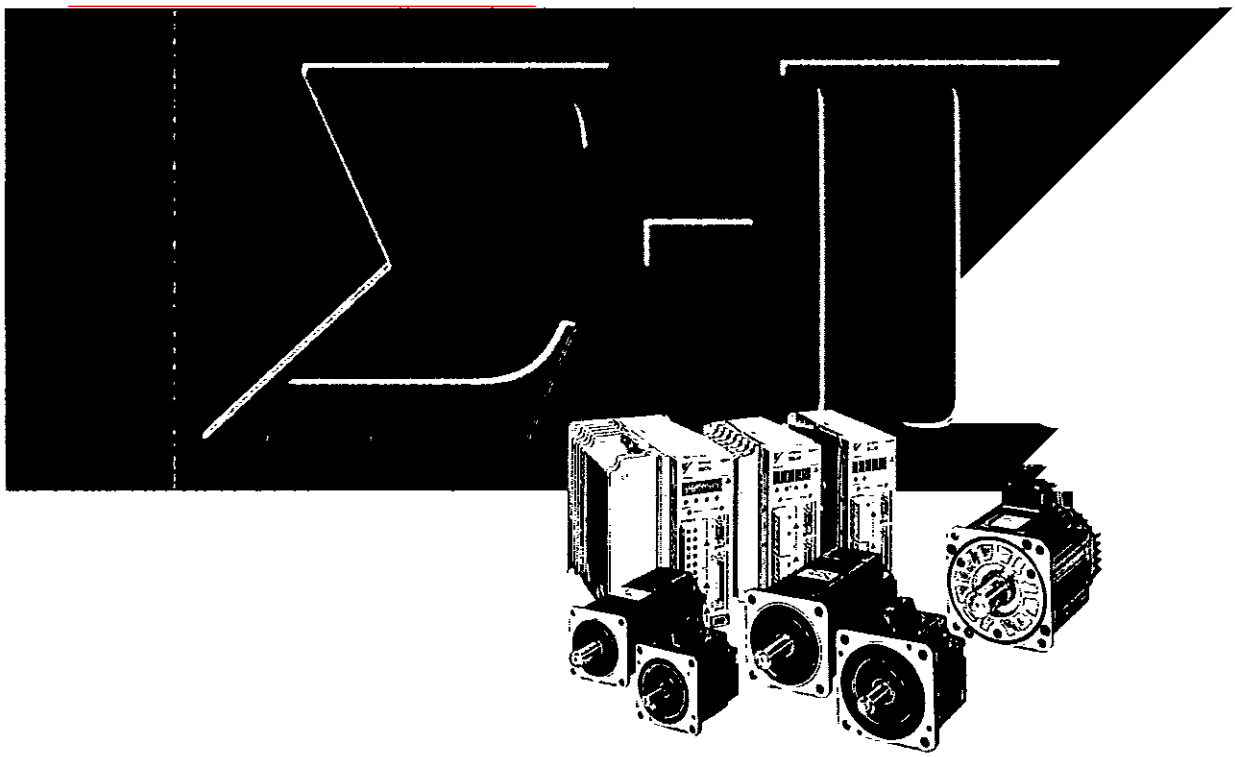

YASKAWA

MANUAL NO SIE-S800-31 2B

Safety Information

The following conventions are used to indicate precautions in this manual Failure to heed precautions provided in this manual can result in serious or possibly even fatal injury or damage to the products or to related equipment and systems

⚠ **WARNING** Indicates precautions that, if not heeded, could possibly result in loss of life or serious injury

⚠ **CAUTION** Indicates precautions that, if not heeded, could result in relatively serious or minor injury, damage to the product, or faulty operation

⃠ **PROHIBITED** Indicates actions that must never be taken

©Yaskawa, 1998

All rights reserved No part of this publication may be reproduced, stored in a retrieval system, or transmitted, in any form, or by any means, mechanical, electronic, photocopying, recording, or otherwise, without the prior written permission of Yaskawa No patent liability is assumed with respect to the use of the information contained herein Moreover, because Yaskawa is constantly striving to improve its high-quality products, the information contained in this manual is subject to change without notice Every precaution has been taken in the preparation of this manual Nevertheless, Yaskawa assumes no responsibility for errors or omissions Neither is any liability assumed for damages resulting from the use of the information contained in this publication

Visual Aids

The following aids are used to indicate certain types of information for easier reference

◀EXAMPLE▶ Indicates application examples



Indicates supplemental information

IMPORTANT Indicates important information that should be memorized, including precautions such as alarm displays to avoid damaging the devices



Indicates definitions of difficult terms or terms that have not been previously explained in this manual

CONTENTS

Safety Information III
Visual Aids IV
Overview XI
Using This Manual XII
Safety Precautions XIII

1 Checking Products and Part Names

1.1 Checking Σ-II Series Products on Delivery ..... 1 - 2

1 1 1 Servomotors 1 - 2
1 1 2 Servopacks 1 - 6

1.2 Product Part Names ..... 1 - 8

1 2 1 Servomotors 1 - 8
1 2 2 Servopacks 1 - 9

2 Installation

2.1 Servomotors ..... 2 - 2

2 1 1 Storage Temperature 2 - 2
2 1 2 Installation Site 2 - 3
2 1 3 Alignment 2 - 3
2 1 4 Orientation 2 - 3
2 1 5 Allowable Shaft Loads 2 - 4
2 1 6 Handling Oil and Water 2 - 6
2 1 7 Cable Stress 2 - 6

2.2 Servopacks ..... 2 - 7

2 2 1 Storage Conditions 2 - 7
2 2 2 Installation Site 2 - 7
2 2 3 Orientation 2 - 8
2 2 4 Installation 2 - 8

3 Wiring

3.1 Connecting to Peripheral Devices ..... 3 -2

3 1 1 Single-phase (100 V or 200 V) Main Circuit Specifications 3 -3
3 1 2 Three-phase (200 V) Main Circuit Specifications 3 -4

3.2 Servopack Internal Block Diagrams ..... 3 -5

3 2 1 30 to 400 W 200-V and 30 to 200 W 100-V Models 3 -5
3 2 2 0 5 kW to 1 5 kW 200-V Models 3 -6
3 2 3 2 0 kW to 5 0 kW 200-V Models 3 -6
3 2 4 6 0 kW and 7 5 kW 200-V Models 3 -7

3 3 Main Circuit Wiring .... 3 -8

3 3 1 Names and Descriptions of Main Circuit Terminals 3 -9
3 3 2 Typical Main Circuit Wiring Example 3 -10
3 3 3 Cable Specifications and Peripheral Devices 3 -10
3 3 4 Servopack Power Losses 3 -11
3 3 5 Wiring Main Circuit Terminal Blocks 3 -12

3.4 I/O Signals .... 3 -13

3 4 1 Examples of I/O Signal Connections 3 -14
3 4 2 List of CN1 Terminals 3 -15
3 4 3 I/O Signal Names and Functions 3 -16
3 4 4 Interface Circuits 3 -19

3.5 Wiring Encoders .... 3 -22

3 5 1 Connecting an Encoder (CN2) and Output Signals from the Servopack (CN1) 3 -22
3 5 2 CN2 Encoder Connector Terminal Layout and Types 3 -23

3.6 Examples of Standard Connections ..... 3 -24

3 6 1 Single-phase Power Supply Specifications 3 -24
3 6 2 Three-phase Power Supply Specifications 3 -25
3 6 3 Position Control Mode 3 -26
3 6 4 Speed Control Mode 3 -27
3 6 5 Torque Control Mode 3 -28

4 Trial Operation

4.1 Two-step Trial Operation .... 4 - 2

4 1 1 Step 1 Trial Operation for Servomotor without Load 4 - 3
4 1 2 Step 2 Trial Operation with the Servomotor Connected to the Machine 4 - 9

4.2 Supplementary Information on Trial Operation ..... 4 - 10

4 2 1 Servomotors with Brakes 4 - 10
4 2 2 Position Control by Host Controller 4 - 11

4.3 Minimum User Constants and Input Signals ..... 4 - 12

4 3 1 User Constants 4 - 12
4 3 2 Input Signals 4 - 13

5 User Constant Settings and Functions

5.1 Settings According to Device Characteristics ..... 5 -4

5 1 1 Switching Servomotor Rotation Direction 5 -4
5 1 2 Setting the Overtravel Limit Function 5 -5
5 1 3 Limiting Torques 5 -9
5 1 4 Limiting Speed 5 -13

5.2 Settings According to Host Controller ..... 5 -15

5 2 1 Speed Reference 5 -15
5 2 2 Position Reference 5 -17
5 2 3 Using the Encoder Signal Output 5 -23
5 2 4 Sequence I/O Signals 5 -26
5 2 5 Using the Electronic Gear Function 5 -28
5 2 6 Contact Input Speed Control 5 -32
5 2 7 Using Torque Control 5 -38
5 2 8 Torque Feed-forward Function 5 -44
5 2 9 Speed Feed-forward Function 5 -45
5 2 10 Torque Limiting by Analog Voltage Reference, Function 1 5 -46
5 2 11 Torque Limiting by Analog Voltage Reference, Function 2 5 -47
5 2 12 Reference Pulse Inhibit Function (INHIBIT) 5 -49

5.3 Setting Up the Servopack ..... 5 -50

5 3 1 User Constants 5 -50
5 3 2 JOG Speed 5 -51
5 3 3 Input Circuit Signal Allocation 5 -51
5 3 4 Output Circuit Signal Allocation 5 -57
5 3 5 Control Mode Selection 5 -60
5 3 6 DC Power Input 5 -62

5.4 Setting Stop Functions ..... 5 -63

5 4 1 Adjusting Offset 63
5 4 2 Using the Dynamic Brake 64
5 4 3 Using the Zero Clamp Function 65
5 4 4 Using the Holding Brake 67

5.5 Forming a Protective Sequence ..... 5 -71

5 5 1 Using Servo Alarm and Alarm Code Outputs 5 -71
5 5 2 Using the Servo ON Input Signal 5 -73
5 5 3 Using the Positioning Completed Output Signal 5 -74
5 5 4 Speed Coincidence Output 5 -75
5 5 5 Using the Running Output Signal 5 -77
5 5 6 Using the Servo Ready Output Signal 5 -78
5 5 7 Using the Warning Output Signal 5 -79
5 5 8 Using the Near Output Signal 5 -80
5 5 9 Handling Power Loss 5 -82

5.6 Selecting a Regenerative Resistor ..... 5 -83

5 6 1 External Regenerative Resistors 5 -84
5 6 2 Calculating the Required Capacity of Regenerative Resistors 5 -86

5.7 Absolute Encoders ..... 5 -92

5 7 1 Interface Circuit 5 -93
5 7 2 Selecting an Absolute Encoder 5 -94
5 7 3 Handling Batteries 5 -94
5 7 4 Absolute Encoder Setup 5 -95
5 7 5 Absolute Encoder Reception Sequence 5 -97
5 7 6 Multiturn Limit Setting 5 -101

5.8 Special Wiring 5-105

5 8 1 Wiring Precautions 5-105
5 8 2 Wiring for Noise Control 5-109
5 8 3 Using More Than One Servodrive 5-113
5 8 4 Extending Encoder Cables 5-114
5 8 5 400-V Power Supply Voltage 5-116
5 8 6 DC Reactor for Harmonic Suppression 5-117

6 Servo Adjustment

6.1 Smooth Operation 6-2

6 1 1 Using the Soft Start Function 6-2
6 1 2 Smoothing 6-3
6 1 3 Adjusting Gain 6-4
6 1 4 Adjusting Offset 6-5
6 1 5 Setting the Torque Reference Filter Time Constant 6-5
6 1 6 Notch Filter 6-6

6.2 High-speed Positioning 6-7

6 2 1 Setting Servo Gain 6-7
6 2 2 Using Feed-forward Control 6-9
6 2 3 Using Proportional Control 6-9
6 2 4 Setting Speed Bias 6-10
6 2 5 Using Mode Switch 6-11
6 2 6 Speed Feedback Compensation 6-14
6 2 7 Gain Changing Function 6-16

6.3 Autotuning 6-17

6 3 1 Online Autotuning 6-17
6 3 2 Machine Rigidity Settings for Online Autotuning 6-20
6 3 3 Saving Results of Online Autotuning 6-22
6 3 4 User Constants Related to Online Autotuning 6-24

6 4 Servo Gain Adjustments 6-27

6 4 1 Servo Gain User Constants 6-27
6 4 2 Basic Rules of Gain Adjustment 6-27
6 4 3 Making Manual Adjustments 6-29
6 4 4 Gain Setting Reference Values 6-33

6 5 Analog Monitor 6-35

7 Using the Digital Operator

7.1 Basic Operation 7-2

7 1 1 Connecting the Digital Operator 7-2
7 1 2 Functions 7-3
7 1 3 Resetting Servo Alarms 7-4
7 1 4 Basic Mode Selection 7-5
7 1 5 Status Display Mode 7-5
7 1 6 Operation in User Constant Setting Mode 7-8
7 1 7 Operation in Monitor Mode 7-14

7 2 Applied Operation ..... 7 -19
7 2 1 Operation in Alarm Traceback Mode 7 -20
7 2 2 Controlling Operation Through the Digital Operator 7 -21
7 2 3 Automatic Adjustment of the Speed and Torque Reference Offset 7 -23
7 2 4 Manual Adjustment of the Speed and Torque Reference Offset 7 -26
7 2 5 Clearing Alarm Traceback Data 7 -30
7 2 6 Checking the Motor Model 7 -32
7 2 7 Checking the Software Version 7 -35
7 2 8 Origin Search Mode 7 -36
7 2 9 Initializing User Constant Settings 7 -38
7 2 10 Manual Zero Adjustment and Gain Adjustment of Analog Monitor Output 7 -40
7 2 11 Adjusting the Motor Current Detection Offset 7 -45
7 2 12 Password Setting (Write Prohibited Setting) 7 -49

8 Ratings and Characteristics

8.1 Servomotors ..... 8 -2
8 1 1 Ratings, Specifications, and Dimensional Drawings 8 -2

8 2 Servopacks ..... 8 -24
8 2 1 Combined Specifications 8 -24
8 2 2 Ratings and Specifications 8 -29
8 2 3 Dimensional Drawings 8 -36

9 Inspection, Maintenance, and Troubleshooting

9.1 Servodrive Inspection and Maintenance ..... 9 -2
9 1 1 Servomotor Inspection 9 -2
9 1 2 Servopack Inspection 9 -3
9 1 3 Replacing Battery for Absolute Encoder 9 -4

9.2 Troubleshooting ..... 9 -5
9 2 1 Troubleshooting Problems with Alarm Displays 9 -5
9 2 2 Troubleshooting Problems with No Alarm Display 9 -31
9 2 3 Alarm Display Table 9 -33
9 2 4 Warning Displays 9 -35

A Host Controller Connection Examples

A.1 Connecting the GL-series MC20 Motion Module ..... A -2

A.2 Connecting the CP-9200SH Servo Controller Module (SVA) .. A -3

A.3 Connecting the GL-series B2813 Positioning Module . ..... A -4

A.4 Connecting OMRON's C500-NC222 Position Control Unit ..... A -5

A 5 Connecting OMRON's C500-NC112 Position Control Unit ..... A -6

A.6 Connecting MITSUBISHI's AD72 Positioning Unit ..... A -7

A.7 Connecting MITSUBISHI's AD75 Positioning Unit . ..... A -8

B List of User Constants

B.1 User Constants . ..... B -2

B.2 Switches .... B -6

B.3 Input Signal Selections ... . B -11

B.4 Output Signal Selections .... B -13

B.5 Auxiliary Functions . ... B -15

B.6 Monitor Modes . ... B -16

C Additional Functions for SGDM-□DA (New Version)

C.1 Additional Functions for SGDM-□DA (New Version) ..... C - 2

INDEX Index-1

Overview

■ About this Manual

This manual provides the following information for the Σ-II Series SGM□H/SGDM Servodrives

- Procedures for installing and wiring the Servomotor and Servopack
- Procedures for trial operation of the Servodrive
- Procedures for using functions and adjusting the Servodrives
- Procedures for using the built-in Panel Operator and the Hand-held Digital Operator
- Ratings and specifications for standard models
- Procedures for maintenance and inspection

■ Related Manuals

Refer to the following manuals as required

Read this manual carefully to ensure the proper use of Σ-II Series Servodrives Also, keep this manual in a safe place so that it can be referred to whenever necessary

Manual Name	Manual Number	Contents
Σ-II Series SGM□H/SGDM User's Manual Servo Selection and Data Sheets	SI-S800-31 1	Describes the procedure used to select Σ-II Series Servodrives and capacities
Σ-II Series Servopack Personal Computer Monitoring Software Operation Manual	SIE-S800-35	Describes the applications and operation of software for the Σ-II Series Servodrive monitoring devices for use on personal computers
Σ-II Series SGM□H/SGDM Digital Operator Operation Manual	TO-S800-34	Provides detailed information on the operation of the JUSP-OP02A-2 Digital Operator, which is an optional product

Using This Manual

■ Intended Audience

This manual is intended for the following users

- Those designing Σ-II Series Servodrive systems
- Those installing or wiring Σ-II Series Servodrives
- Those performing trial operation or adjustments of Σ-II Series Servodrives
- Those maintaining or inspecting Σ-II Series Servodrives

■ Description of Technical Terms

In this manual, the following terms are defined as follows

- **Servomotor** = Σ-II Series SGMAH SGMPH, SGMGH, SGMSH, or SGMDH Servomotor
- **Servopack** = Σ-II Series SGDM Servopack
- **Servodrive** = A set including a Servomotor and Servo Amplifier
- **Servo System** = A servo control system that includes the combination of a Servodrive with a host computer and peripheral devices

■ Indication of Reverse Signals

In this manual, the names of reverse signals (ones that are valid when low) are written with a forward slash (/) before the signal name, as shown in the following examples

- /S-ON
- /P-CON

Safety Precautions

The following precautions are for checking products upon delivery, installation, wiring, operation, maintenance and inspections

■ Checking Products upon Delivery

⚠ CAUTION

- Always use the Servomotor and Servopack in one of the specified combinations

  Not doing so may cause fire or malfunction

■ Installation

⚠ CAUTION

- Never use the products in an environment subject to water, corrosive gases, inflammable gases, or combustibles

  Doing so may result in electric shock or fire

■ Wiring

⚠ WARNING

- Connect the ground terminal to a class-3 ground (100 Ω or less)

  Improper grounding may result in electric shock or fire

⚠ CAUTION

- Do not connect a three-phase power supply to the U, V, or W output terminals

  Doing so may result in injury or fire

- Securely fasten the power supply terminal screws and motor output terminal screws

  Not doing so may result in fire

■ Operation

⚠ WARNING

- Never touch any rotating motor parts while the motor is running

  Doing so may result in injury

⚠ CAUTION

- Conduct trial operation on the Servomotor alone with the motor shaft disconnected from machine to avoid any unexpected accidents

  Not doing so may result in injury

- Before starting operation with a machine connected, change the settings to match the user's constants of the machine

  Starting operation without matching the proper settings may cause the machine to run out of control or malfunction

- Before starting operation with a machine connected, make sure that an emergency stop can be applied at any time

  Not doing so may result in injury

- Do not touch the heat sinks during operation

  Doing so may result in burns due to high temperatures

■ Maintenance and Inspection

⚠ WARNING

- Never touch the inside of the Servopacks

  Doing so may result in electric shock

- Do not remove the panel cover while the power is ON

  Doing so may result in electric shock

- Do not touch terminals for five minutes after the power is turned OFF

  Residual voltage may cause electric shock

⚠ CAUTION

- Do not disassemble the Servomotor

  Doing so may result in electric shock or injury

- Do not attempt to change wiring while the power is ON

  Doing so may result in electric shock or injury

■ General Precautions

Note the following to ensure safe application

- The drawings presented in this manual are sometimes shown without covers or protective guards. Always replace the cover or protective guard as specified first, and then operate the products in accordance with the manual.
- The drawings presented in this manual are typical examples and may not match the product you received.
- This manual is subject to change due to product improvement, specification modification, and manual improvement. When this manual is revised, the manual code is updated and the new manual is published as a next edition. The edition number appears on the front and back covers.
- If the manual must be ordered due to loss or damage, inform your nearest Yaskawa representative or one of the offices listed on the back of this manual.
- Yaskawa will not take responsibility for the results of unauthorized modifications of this product. Yaskawa shall not be liable for any damages or troubles resulting from unauthorized modification.

1

Checking Products and Part Names

This chapter describes the procedure for checking products upon delivery as well as names for product parts

1 1 Checking Σ-II Series Products on Delivery 1 - 2

1 1 1 Servomotors 1 - 2

1 1 2 Servopacks 1 - 6

1 2 Product Part Names .... 1 - 8

1 2 1 Servomotors 1 - 8

1 2 2 Servopacks 1 - 9

1.1 Checking Σ-II Series Products on Delivery


The following procedure is used to check Σ-II Series products upon delivery Check the following items when Σ-II Series products are delivered

Check Items	Comments
Are the delivered products the ones that were ordered?	Check the model numbers marked on the nameplates of the Servomotor and Servopack (Refer to the descriptions of model numbers on following pages)
Does the Servomotor shaft rotate smoothly?	The Servomotor shaft is normal if it can be turned smoothly by hand Servomotors with brakes, however, cannot be turned manually
Is there any damage?	Check the overall appearance, and check for damage or scratches that may have occurred during shipping
Are there any loose screws?	Check screws for looseness using a screwdriver


If any of the above items are faulty or incorrect, contact your Yaskawa sales representative or the dealer from whom you purchased the products

1.1.1 Servomotors

■ External Appearance and Nameplate Examples



Σ-II Series Servomotor

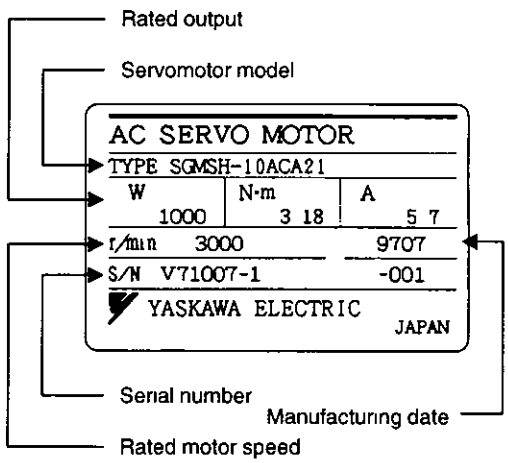

■ Model Numbers

Standard Servomotors

SGMPH – 01 A A A 2 S

Σ-II Series Servomotor Name
- SGMAH
- SGMPH
- SGMGH
- SGMSH
- SGMDH

1) Servomotor Capacity (See *Table 1 1*)

2) Supply Voltage
- A 200 V
- B 100 V *

* The only 100-V Servomotors are the 0 2 kW or less SGMAH and SGMPH Servomotors

3) Serial Encoder Specifications (See *Table 1 2*)

4) Design Revision Order
- A SGMAH, SGMPH, SGMGH (1500 r/min), SGMSH, SGMDH
- B SGMGH (1000 r/min)
- C SGMGH (1500 r/min) high-precision machinery
- D SGMGH (1000 r/min) high-precision machinery
- E SGMPH (IP67 waterproof specification)

7) Shaft End Specification (See *Table 1 3*)

8) Brake and Oil Seal Specifications
- 1 With brake no oil seal
- S With oil seal
- B With 90 VDC brake
- C With 24 VDC brake
- D S + B
- E S + C

Table 1 1 Servomotor Capacity (kW)

Symbol	SGMAH	SGMPH	SGMGH		SGMSH	SGMDH	Symbol	SGMAH	SGMPH	SGMGH		SGMSH	SGMDH
	3000 r/min	3000 r/min	1500 r/min	1000 r/min	3000 r/min	2000 r/min		3000 r/min	3000 r/min	1500 r/min	1000 r/min	3000 r/min	2000 r/min
A3	0 03	–	–	–	–	–	15	–	1 5	–	–	1 5	–
A5	0 05	–	–	–	–	–	20	–	–	1 8	2 0	2 0	–
01	0 1	0 1	–	–	–	–	22	–	–	–	–		2 2
02	0 2	0 2	–	–	–	–	30	–	–	2 9	3 0	3 0	–
03	–	–	–	0 3	–	–	32	–	–	–	–	–	3 2
04	0 4	0 4	–	–	–	–	40	–		–	–	4 0	4 0
05	–	–	0 45	–	–	–	44	–	–	4 4	4 4	–	–
06	–	–	–	0 6	–	–	50	–	–	–	–	5 0	–
08	0 75	0 75	–	–	–	–	55	–	–	5 5	–	–	–
09	–	–	0 85	0 9	–	–	60	–	–	–	6 0	–	–
10	–	–	–	–	1 0	–	75	–	–	7 5	–	–	–
12	–	–	–	1 2	–	–							
13	–	–	1 3	–	–	–							

Table 1 2 Serial Encoders

Code	Specification	SGMAH	SGMPH	SGMGH	SGMSH	SGMDH
1	16-bit absolute encoder	Standard	Standard	–	–	–
2	17-bit absolute encoder	–	–	Standard	Standard	Standard
A	13-bit incremental encoder	Standard	Standard	–	–	–
B	16-bit incremental encoder	Optional	Optional	–	–	–
C	17-bit incremental encoder	–	–	Standard	Standard	Standard

Table 1 3 Axis End Specifications (Straight)

Code	Specification	SGMAH	SGMPH	SGMGH	SGMSH	SGMDH
2	Straight without key	Standard	Standard	Standard	Standard	Standard
3	Taper 1/10, with parallel key			Optional	Optional	Optional
4	Straight with key	Optional	Optional			
5	Taper 1/10, with woodruff key			Optional	Optional	
6	Straight with key and tap	Optional	Optional	Optional	Optional	Optional
8	Straight with tap	Optional	Optional			

efesotomasyon.com

Servomotors with Gears

SGMPH – 01 A A A G 1 2 B

Σ-II Series Servomotor Name
- SGMAH
- SGMPH
- SGMGH
- SGMSH

1) Servomotor Capacity (See *Table 1 4*)

2) Supply Voltage
- A 200 V
- B 100 V *

* The only 100-V Servomotors are the 0 2 kW or less SGMAH and SGMPH Servomotors

3) Serial Encoder Specifications (See *Table 1 5*)

4) Design Revision Order
- A SGMAH, SGMPH, SGMGH (1500 r/min), SGMSH
- B SGMGH (1000 r/min)
- E SGMPH (IP67 waterproof specification)

5) Gear Type (See *Table 1 6*)

6) Gear Ratio (See *Table 1 7*)
(Varies with gear type)

7) Shaft End Specifications
(See Table *1 8*)

8) Brake Specifications
- 1 Without brake
- B With 90 VDC brake
- C With 24 VDC brake

Table 1.4 Servomotor Capacity (kW)

Symbol	SGMAH	SGMPH	SGMGH		SGMSH	Symbol	SGMAH	SGMPH	SGMGH		SGMSH
	3000 r/min	3000 r/min	1500 r/min	1000 r/min	3000 r/min		3000 r/min	3000 r/min	1500 r/min	1000 r/min	3000 r/min
A3	0 03	–	–	–	–	15	–	1 5	–	–	1 5
A5	0 05	–	–	–	–	20	–	–	1 8	2 0	2 0
01	0 1	0 1	–	–	–	22	–	–	–	–	–
02	0 2	0 2	–	–	–	30	–	–	2 9	3 0	3 0
03	–	–	–	0 3	–	32	–	–	–	–	–
04	0 4	0 4	–	–	–	40	–	–	–	–	4 0
05	–	–	0 45	–	–	44	–	–	4 4	4 4	–
06	–	–	–	0 6	–	50	–	–	–	–	5 0
08	0 75	0 75	–	–	–	55	–	–	5 5	–	–
09	–	–	0 85	0 9	–	60	–	–	–	6 0	–
10	–	–	–	–	1 0	75	–	–	7 5	–	–
12	–	–	–	1 2	–						
13	–	–	1 3	–	–						

Table 1 5 Serial Encoders

Code	Specification	SGMAH	SGMPH	SGMGH	SGMSH
1	16-bit absolute encoder	Standard	Standard	–	–
2	17-bit absolute encoder	–	–	Standard	Standard
A	13-bit incremental encoder	Standard	Standard	–	–
B	16-bit incremental encoder	Optional	Optional	–	–
C	17-bit incremental encoder	–	–	Standard	Standard

Table 1 6 Gear Type

Code	Specification	SGMAH	SGMPH	SGMGH	SGMSH
G	HDS planetary low-backlash gear	Standard	Standard		
J	Standard backlash gear	Standard	Standard		
S	With foot			Standard	
T	Flange			Standard	
L	IMT planetary low-backlash gear			Standard	Standard

Table 1 7 Gear Ratio (Varies with Gear Type)

Code	Specification	SGMAH	SGMPH	SGMGH	SGMSH
A	1/6			S T*	
B	1/11 or 1/11 13	G	G	S T	
C	1/21	G, J	G J	S, T	
1	1/5	G, J	G, J	L	L
2	1/9	G		L	L
3	1/10 or 1/10 3	J	J		
5	1/20			L*	L
7	1/29 or 1/33	G J	G, J	L S, T*	L*
8	1/45			L*	L*


* Not all applicable models available

Table 1.8 Shaft End Specification (Varies with Gear Type)


Code	Specification	SGMAH	SGMPH	SGMGH	SGMSH
0	No shaft	G, J	G, J		
2	Straight without key	G, J	G J		
4	Straight with key	G J	G, J	L	L
6	Straight with key and tap	G, J	G J	S, T	
8	Straight with tap	G J	G J		

1.1.2 Servopacks

■ External Appearance and Nameplate Examples

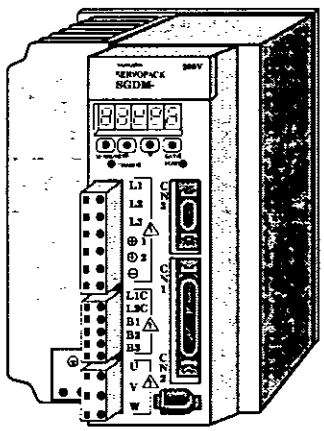

Σ-II Series SGDM
Servopack

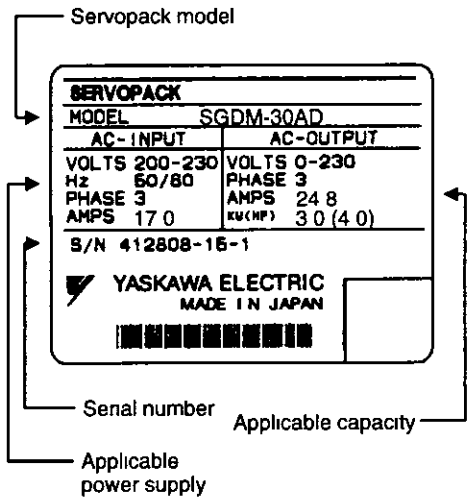

■ Model Numbers

SGDM – 10 A D □ –□

Σ-II Series
SGDM Servopack

Maximum Applicable Servomotor Capacity
(See *Table 1 9*)

Supply Voltage

A 200 V

B 100 V*

* The only 100-V Servomotors are the 0 2 kW or less SGMAH and SGMPH Servomotors

Type

D For torque, speed, and position control

Design Revision Order
Blank, A, B. etc

Options

R Rack mounted (5 kW or less)

P Duct ventilated (6 kW or 7 5 kW only)

. **Table 1 9**


Maximum Applicable Servomotor Capacity Symbol	Capacity (kW)	Maximum Applicable Servomotor Capacity Symbol	Capacity (kW)
A3	0 03	**15**	1 5
A5	0 05	**20**	2 0
01	0 10	**30**	3 0
02	0 20	**50**	5 0
04	0 40	**60**	6 0
05	0 50	**75**	7 5
08	0 75	–	–
10	1 0	–	–

1.2 Product Part Names

This section describes product part names

1.2.1 Servomotors


The figure below shows part names for Servomotors with or without brakes

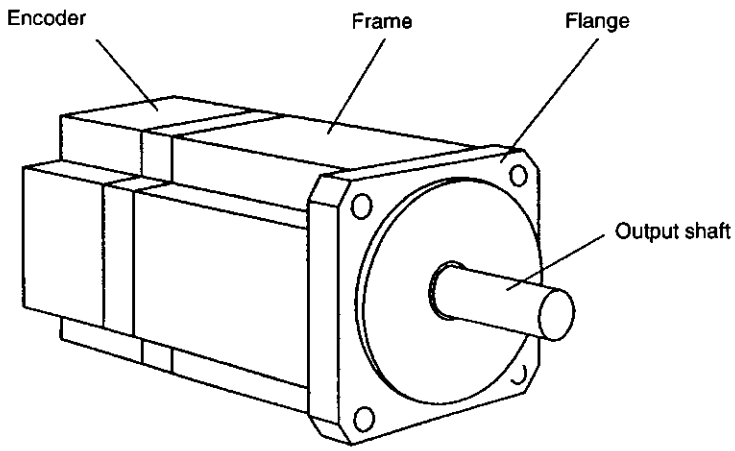

efesotomasyon.com

1.2.2 Servopacks

The figure below shows the part names for Servopacks

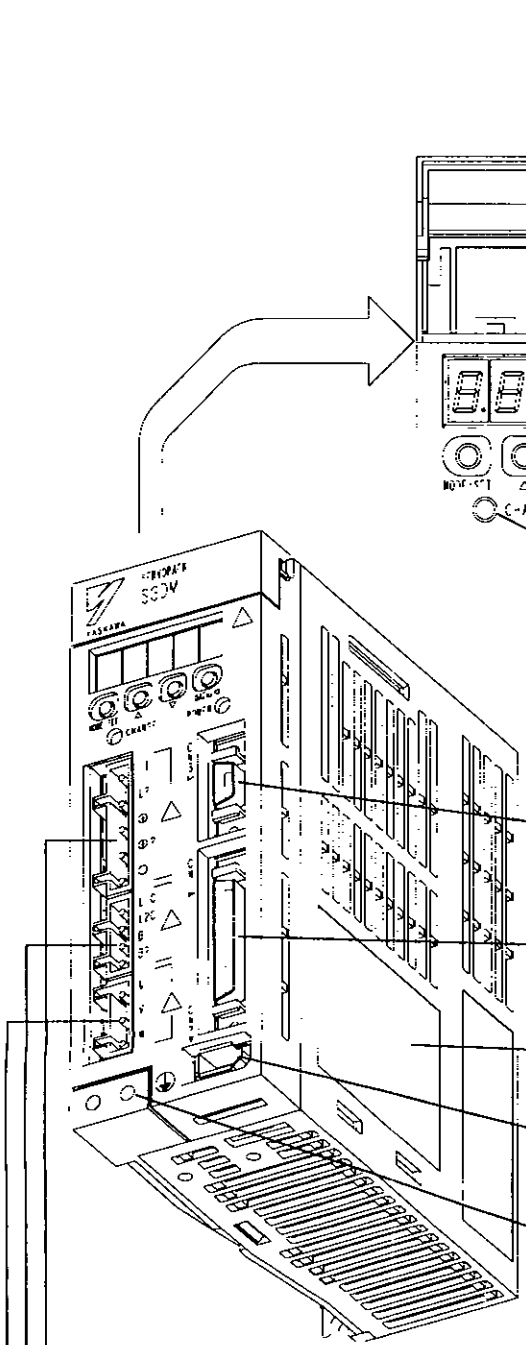

Battery Holder
Used to house the backup battery for an absolute encoder

CN5 Analog Monitor Connector
Used to monitor motor speed, torque reference, and other values through a special cable

CN8 Battery Connector
Used to connect to the backup battery for an absolute encoder

Panel Display
5-digit, 7-segment LED used to display servo status, alarm status, and other values when user constants are input

Panel Keys
Used to set user constants

Power ON Indicator
Lights when the control power supply is ON

Charge Indicator
Lights when the main circuit power supply is ON and stays lit as long as the main circuit power supply capacitor remains charged Therefore, do not touch the Servopack even after the power supply is turned OFF if the indicator is lit

CN3 Connector for Personal Computer Monitoring
Used to communicate with a personal computer or to connect to a Digital Operator

CN1 I/O Signal Connector
Used for reference input signals and sequence I/O signals

Nameplate
Indicates the Servopack model and ratings

CN2 Encoder Connector
Connects to the encoder in the Servomotor

Ground Terminal
Must be connected to protect against electrical shock

Main Circuit Power Supply Terminal
Used for main circuit power supply input

Control Power Supply Terminal
Connects to the control power supply and externally mounted regenerative resistor

Servomotor Terminal
Connects to the Servomotor power line

2

Installation

This chapter describes precautions for Σ-II Series Servomotor and Servopack installation

2 1 Servomotors .... 2 - 2

2 1 1 Storage Temperature 2 - 2

2 1 2 Installation Site 2 - 3

2 1 3 Alignment 2 - 3

2 1 4 Orientation 2 - 3

2 1 5 Allowable Shaft Loads 2 - 4

2 1 6 Handling Oil and Water 2 - 6

2 1 7 Cable Stress 2 - 6

2 2 Servopacks . 2 - 7

2 2 1 Storage Conditions 2 - 7

2 2 2 Installation Site 2 - 7

2 2 3 Orientation 2 - 8

2 2 4 Installation 2 - 8

2.1 Servomotors


SGM□H Servomotors can be installed either horizontally or vertically

The service life of the Servomotor will be shortened or unexpected problems will occur if the Servomotor is installed incorrectly or in an inappropriate location Always observe the following installation instructions

⚠ CAUTION

- Do not connect the Servomotor directly to a commercial power line This will damage the Servomotor

  The Servomotor cannot operate without the proper Servopack

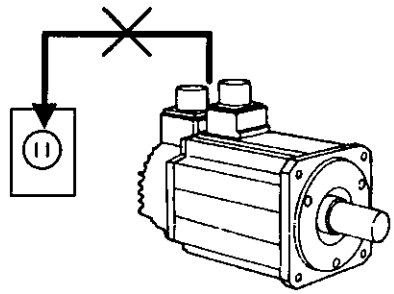


IMPORTANT

Prior to Installation

The end of the motor shaft is coated with anticorrosive paint Thoroughly remove the paint using a cloth moistened with thinner prior to installation

Avoid getting thinner on other parts of the Servomotor when cleaning the shaft

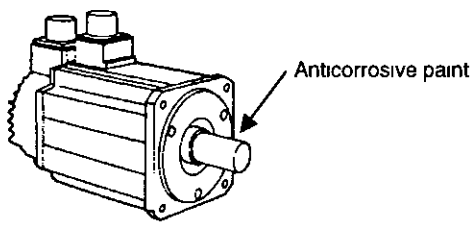

2.1.1 Storage Temperature

Store the Servomotor within the following temperature range if it is stored with the power cable disconnected

–20 to 60°C

2.1.2 Installation Site


SGM□H Servomotors are designed for indoor use Install the Servomotor in environments that satisfy the following conditions

- Free of corrosive or explosive gases
- Well-ventilated and free of dust and moisture
- Ambient temperature of 0 to 40°C
- Relative humidity of 20 to 80% with no condensation
- Facilitates inspection and cleaning

2.1.3 Alignment

Align the shaft of the Servomotor with the shaft of the equipment, and then couple the shafts Install the Servomotor so that alignment accuracy falls within the following range

Measure this distance at four different positions on the circumference The difference between the maximum and minimum measurements must be 0 03 mm (0 0012 in) or less (Turn together with coupling)

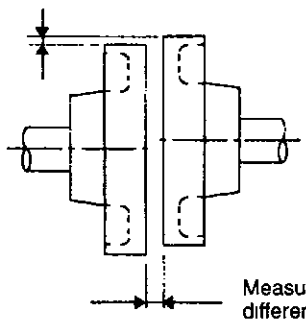

Measure this distance at four different positions on the circumference The difference between the maximum and minimum measurements must be 0 03 mm (0 0012 in) or less (Turn together with coupling)

IMPORTANT

- Vibration that will damage the bearings will occur if the shafts are not properly aligned
- Do not allow direct impact to be applied to the shafts when installing the coupling Otherwise the encoder mounted on the opposite end of the shaft may be damaged

2.1.4 Orientation


SGM□H Servomotors can be installed either horizontally or vertically

2.1.5 Allowable Shaft Loads

Design the mechanical system so thrust and radial loads applied to the Servomotor shaft end during operation falls within the ranges shown in the *Table 2 1*

The allowable radial load in the table is the maximum load allowed on the end of the output shaft

Table 2 1 Allowable Radial and Thrust Loads for the Servomotor


Servomotor Model		Allowable Radial Load * Fr [N (lbf)]	Allowable Thrust Load Fs [N (lbf)]	LR mm (inch)	Reference Diagram
SGMAH-	A3	68 (15 29)	54 (12 14)	20 (0 79)	
	A5	68 (15 29)	54 (12 14)		
	01	78 (17 54)	54 (12 14)		
	02	245 (55 1)	74 (16 63)	25 (0 98)	
	04	245 (55 1)	74 (16 63)		
	08	392 (88 1)	147 (33 0)	35 (1 38)	
SGMPH-	01	78 (17 54)	49 (11 02)	20 (0 79)	
	02	245 (55 1)	68 (15 29)	25 (0 98)	
	04	245 (55 1)	68 (15 29)		
	08	392 (88 1)	147 (33 0)	35 (1 38)	
	15	490 (110)	147 (33 0)		
SGMGH-	05A□A	490 (110)	98 (22 0)	58 (2 28)	
	09A□A	490 (110)	98 (22 0)		
	13A□A	686 (154)	343 (77 1)		
	20A□A	1176 (264 3)	490 (110)	79 (3 11)	
	30A□A	1470 (330 4)	490 (110)		
	44A□A	1470 (330 4)	490 (110)		
	55A□A	1764 (396 5)	588 (132)	113 (4 45)	
	75A□A	1764 (396 5)	588 (132)		


TERMS

◆ Thrust and radial loads

Thrust load (Fs) Shaft-end load applied parallel to the centerline of the shaft

Radial load (Fr) Shaft-end load applied perpendicular to the centerline of the shaft

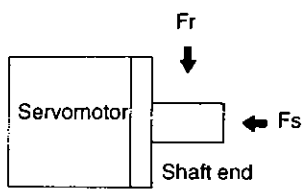


Servomotor Model		Allowable Radial Load * Fr [N (lbf)]	Allowable Thrust Load Fs [N (lbf)]	LR mm (inch)	Reference Diagram
SGMGH-	03A□B	490 (110)	98 (22 0)	58 (2 28)	
	06A□B	490 (110)	98 (22 0)		
	09A□B	686 (154)	343 (77 1)		
	12A□B	1176 (264 3)	490 (110)	79 (3 11)	
	20A□B	1470 (330 4)	490 (110)		
	30A□B	1470 (330 4)	490 (110)		
	44A□B	1764 (396 5)	588 (132)	113 (4 45)	
	60A□B	1764 (396 5)	588 (132)		
SGMSH-	10A	686 (154)	196 (44 1)	45 (1 77)	
	15A	686 (154)	196 (44 1)		
	20A	686 (154)	196 (44 1)		
	30A	980 (220)	392 (88 1)	63 (2 48)	
	40A	1176 (264 3)	392 (88 1)		
	50A	1176 (264 3)	392 (88 1)		
SGMDH-	22A	1176 (264 3)	490 (110)	55 (2 17)	
	32A	1176 (264 3)	490 (110)		
	40A	1176 (264 3)	490 (110)	65 (2 56)	

2.1.6 Handling Oil and Water

Install a protective cover over the Servomotor if it is used in a location that is subject to water or oil mist Also use a Servomotor with an oil seal to seal the through shaft section

Install the Servomotor with the connector facing down

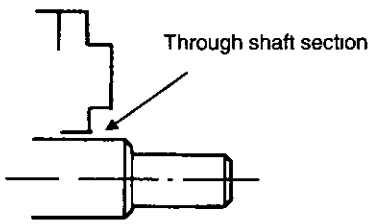

2.1.7 Cable Stress

Make sure there are no bends or tension on the power lines

Be especially careful to wire signal line cables so that they are not subject to stress because the core wires are very thin at only 0 2 to 0 3 mm (0 0079 to 0 012 in)

TERMS

◆ Through sections of the shaft

This refers to the gap where the shaft protrudes from the end of the motor


2.2 Servopacks

The SGDM Servopacks are base-mounted servoamps Incorrect installation will cause problems Always observe the installation instructions below

2.2.1 Storage Conditions

Store the Servopack within the following temperature range if it is stored with the power cable disconnected

–20 to 85°C

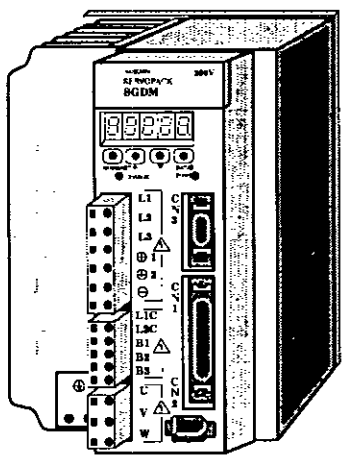

Σ-II Series SGDM Servopack

efesotomasyon.com

2.2.2 Installation Site


Take the following precautions at the installation site

Situation	Installation Precaution
Installation in a Control Panel	Design the control panel size, unit layout, and cooling method so the temperature around the Servopack does not exceed 55°C
Installation Near a Heating Unit	Minimize heat radiated from the heating unit as well as any temperature rise caused by natural convection so the temperature around the Servopack does not exceed 55°C
Installation Near a Source of Vibration	Install a vibration isolator beneath the Servopack to avoid subjecting it to vibration
Installation at a Site Exposed to Corrosive Gas	Corrosive gas does not have an immediate effect on the Servopack, but will eventually cause electronic components and contactor-related devices to malfunction Take appropriate action to avoid corrosive gas
Other Situations	Do not install the Servopack in hot and humid locations or locations subject to excessive dust or iron powder in the air

2.2.3 Orientation


Install the Servopack perpendicular to the wall as shown in the figure The Servopack must be oriented this way because it is designed to be cooled by natural convection or cooling fan

Secure the Servopack using 2 to 4 mounting holes The number of holes depends on the capacity

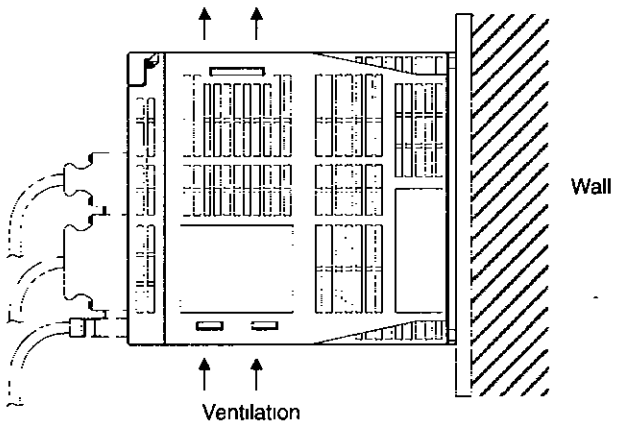

2.2.4 Installation

Follow the procedure below to install multiple Servopacks side by side in a control panel

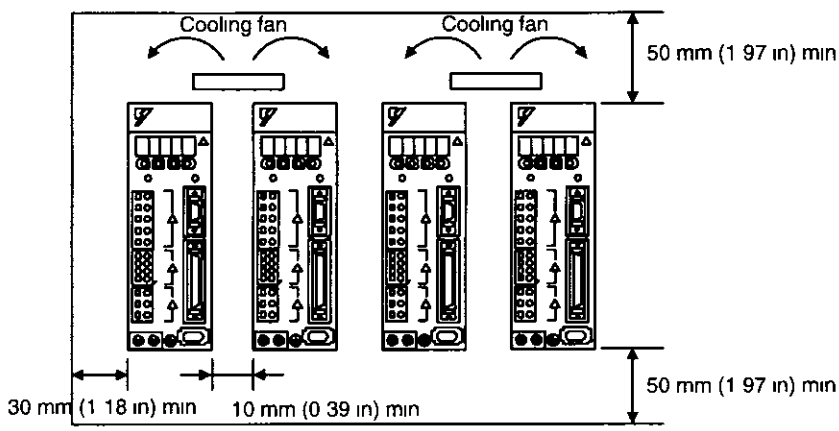

■ Servopack Orientation

Install the Servopack perpendicular to the wall so the front panel containing connectors faces outward

■ Cooling

As shown in the figure above, allow sufficient space around each Servopack for cooling by cooling fans or natural convection

■ Side-by-side Installation

When installing Servopacks side by side as shown in the figure above, allow at least 10 mm (0 39 in) between and at least 50 mm (1 97 in) above and below each Servopack Install cooling fans above the Servopacks to avoid excessive temperature rise and to maintain even temperature inside the control panel

■ Environmental Conditions in the Control Panel

- Ambient Temperature 0 to 55°C
- Humidity 90% RH or less
- Vibration 0 5 G (4 9 m/s^2)
- Condensation and Freezing None
- Ambient Temperature for Long-term Reliability 45°C max

3

Wiring

This chapter describes the procedure used to connect Σ-II Series products to peripheral devices and gives typical examples of main circuit wiring as well as I/O signal connections

3 1 Connecting to Peripheral Devices . 3 - 2

3 1 1 Single-phase (100 V or 200 V) Main Circuit Specifications 3 - 3
3 1 2 Three-phase (200 V) Main Circuit Specifications 3 - 4

3 2 Servopack Internal Block Diagrams 3 - 5

3 2 1 30 to 400 W 200-V and 30 to 200 W 100-V Models 3 - 5
3 2 2 0 5 kW to 1 5 kW 200-V Models 3 - 6
3 2 3 2 0 kW to 5 0 kW 200-V Models 3 - 6
3 2 4 6 0 kW and 7 5 kW 200-V Models 3 - 7

3 3 Main Circuit Wiring . . . . . 3 - 8

3 3 1 Names and Descriptions of Main Circuit Terminals 3 - 9
3 3 2 Typical Main Circuit Wiring Example 3 - 10
3 3 3 Cable Specifications and Peripheral Devices 3 - 10
3 3 4 Servopack Power Losses 3 - 11
3 3 5 Wiring Main Circuit Terminal Blocks 3 - 12

3.4 I/O Signals . . . . . 3 - 13

3 4 1 Examples of I/O Signal Connections 3 - 14
3 4 2 List of CN1 Terminals 3 - 15
3 4 3 I/O Signal Names and Functions 3 - 16
3 4 4 Interface Circuits 3 - 19

3 5 Wiring Encoders . . . . . 3 - 22

3 5 1 Connecting an Encoder (CN2) and Output Signals from the Servopack (CN1) 3 - 22
3 5 2 CN2 Encoder Connector Terminal Layout and Types 3 - 23

3.6 Examples of Standard Connections 3 - 24


3 6 1 Single-phase Power Supply Specifications 3 - 24
3 6 2 Three-phase Power Supply Specifications 3 - 25
3 6 3 Position Control Mode 3 - 26
3 6 4 Speed Control Mode 3 - 27
3 6 5 Torque Control Mode 3 - 28

3.1 Connecting to Peripheral Devices


This section provides examples of standard Σ-II Series product connections to peripheral devices

It also briefly explains how to connect each peripheral device

3.1.1 Single-phase (100 V or 200 V) Main Circuit Specifications

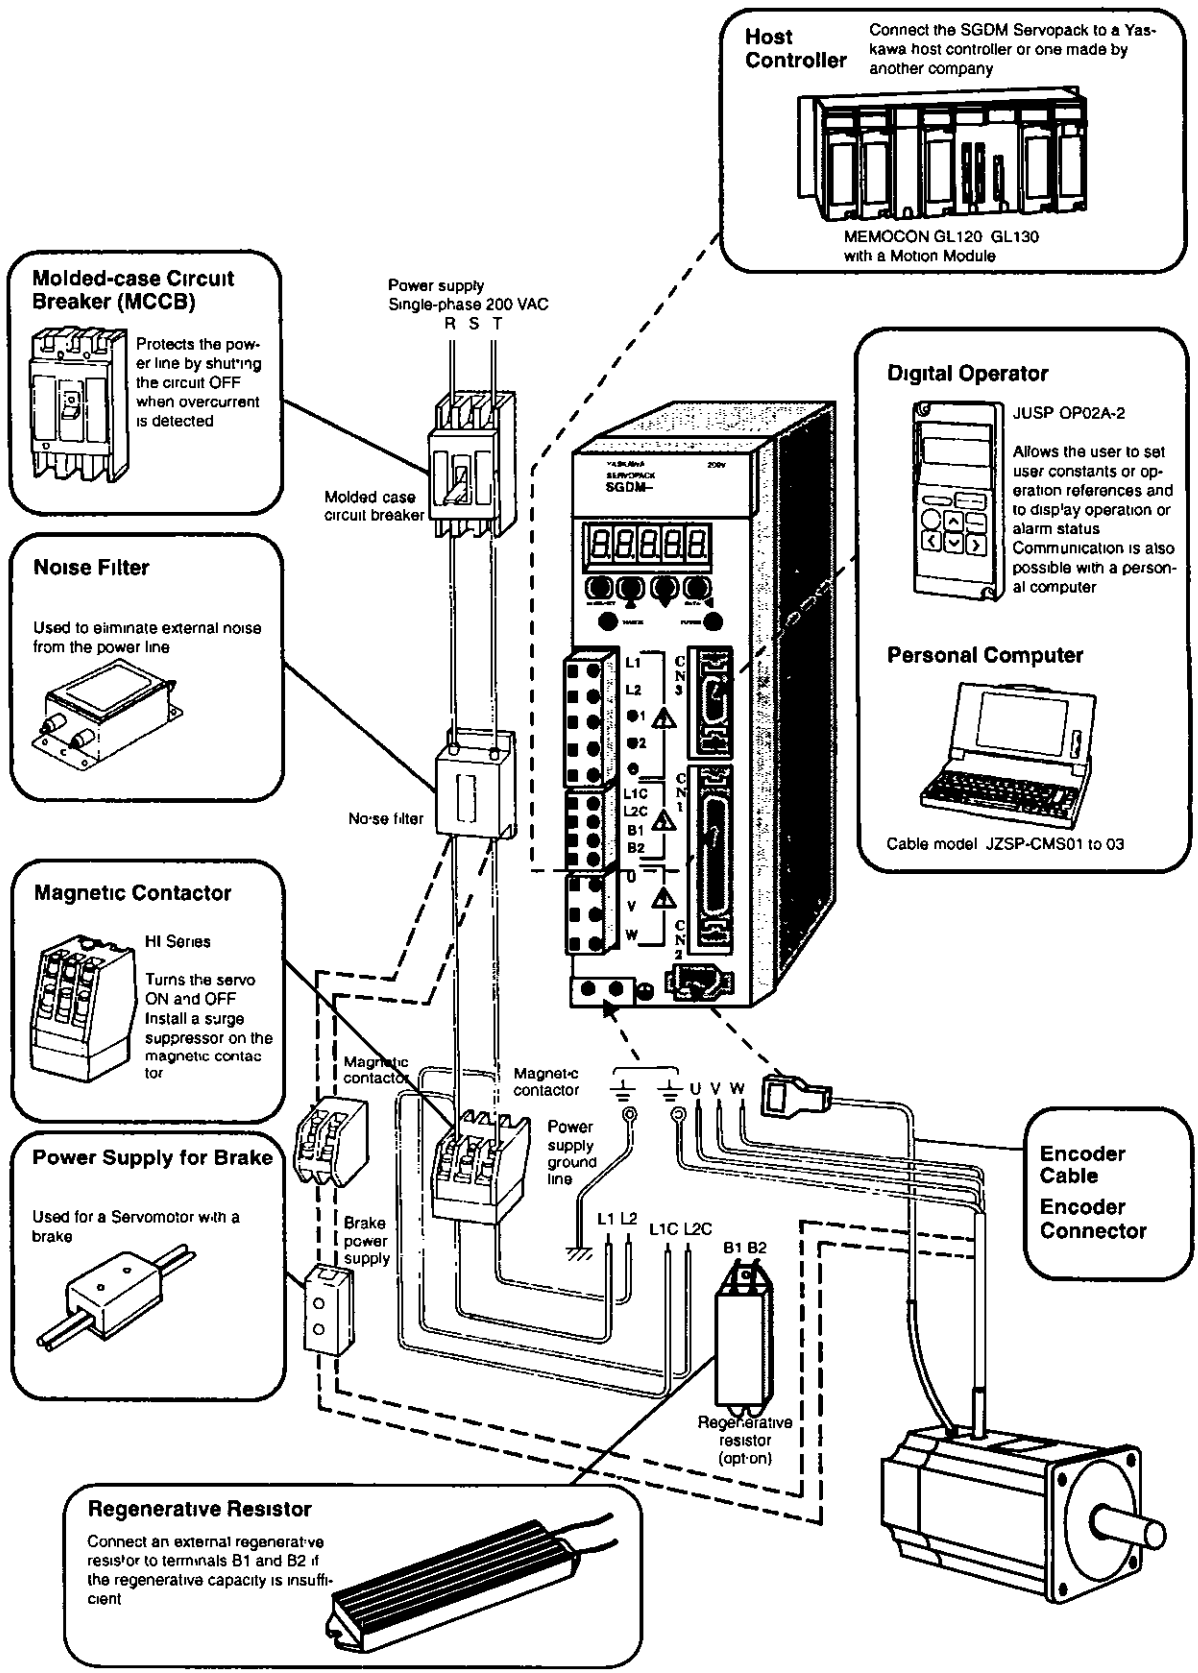


3.1.2 Three-phase (200 V) Main Circuit Specifications

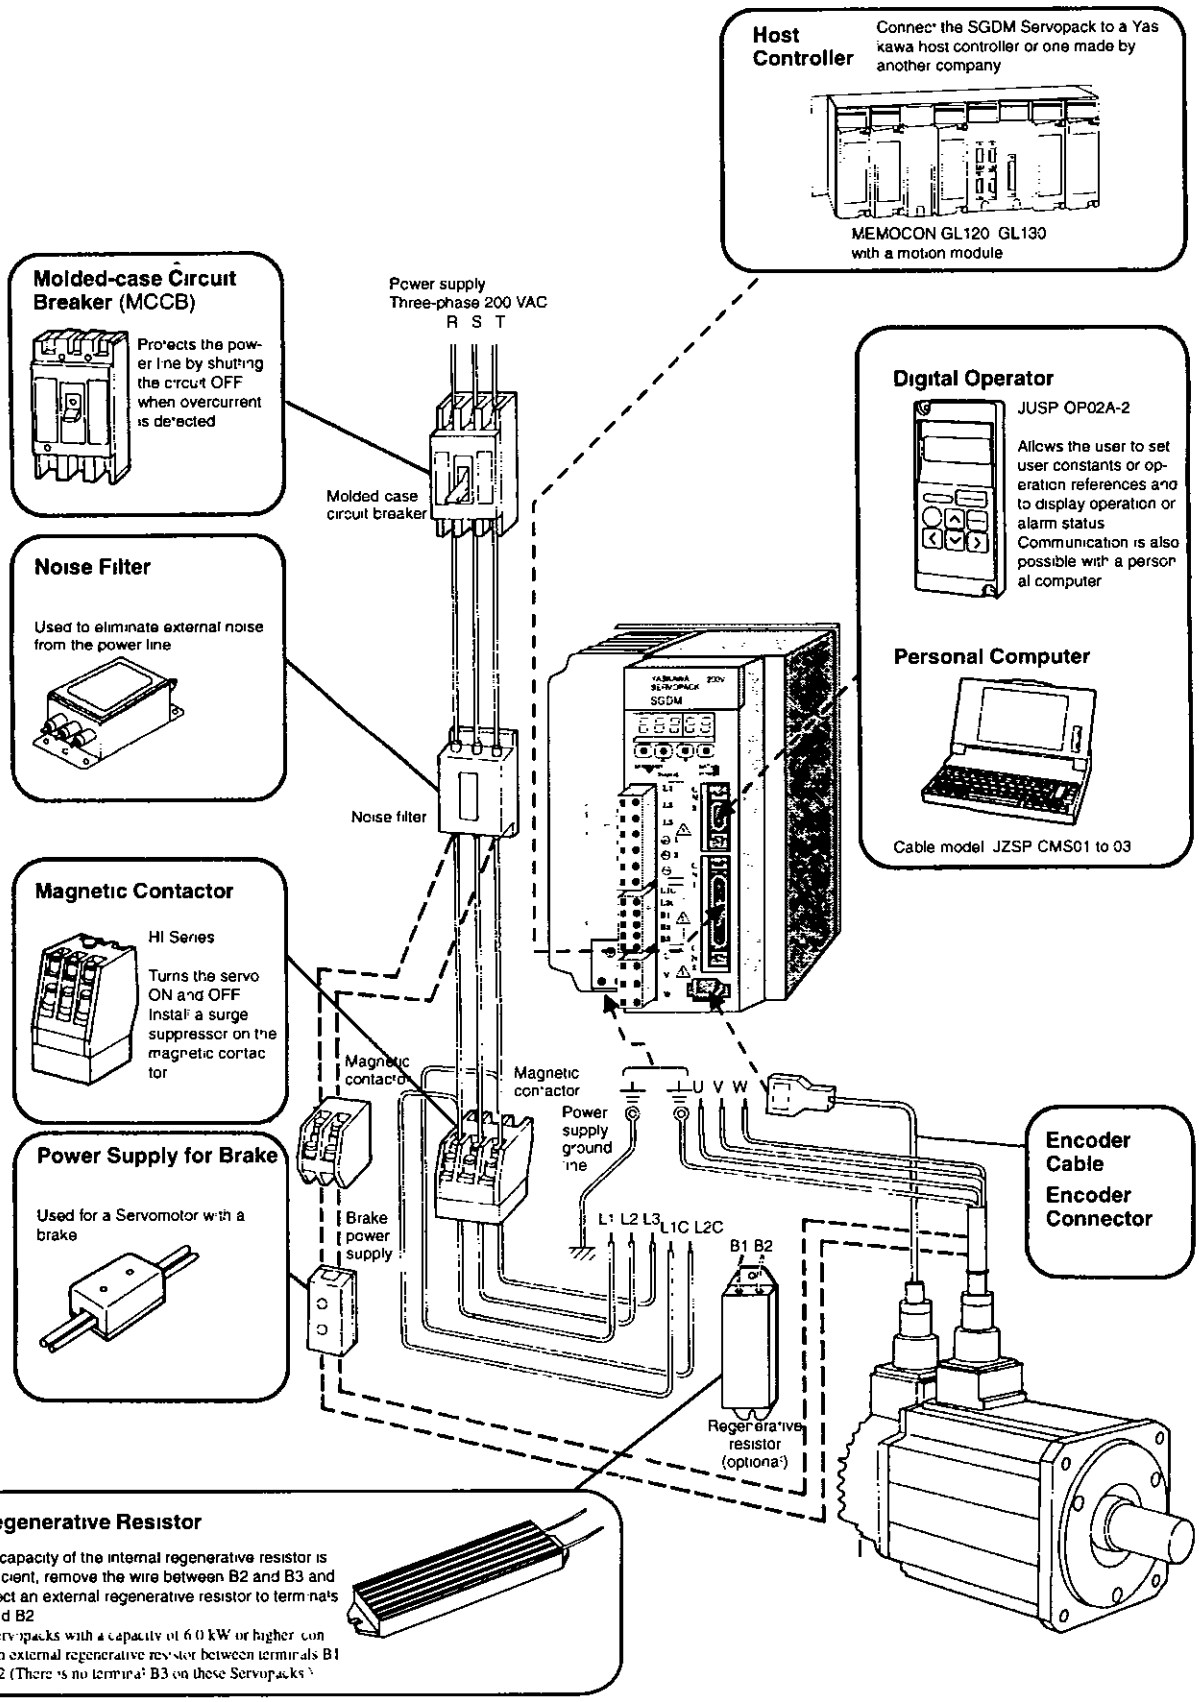

3.2 Servopack Internal Block Diagrams


The following sections show internal block diagrams of the Servopacks

3.2.1 30 to 400 W 200-V and 30 to 200 W 100-V Models

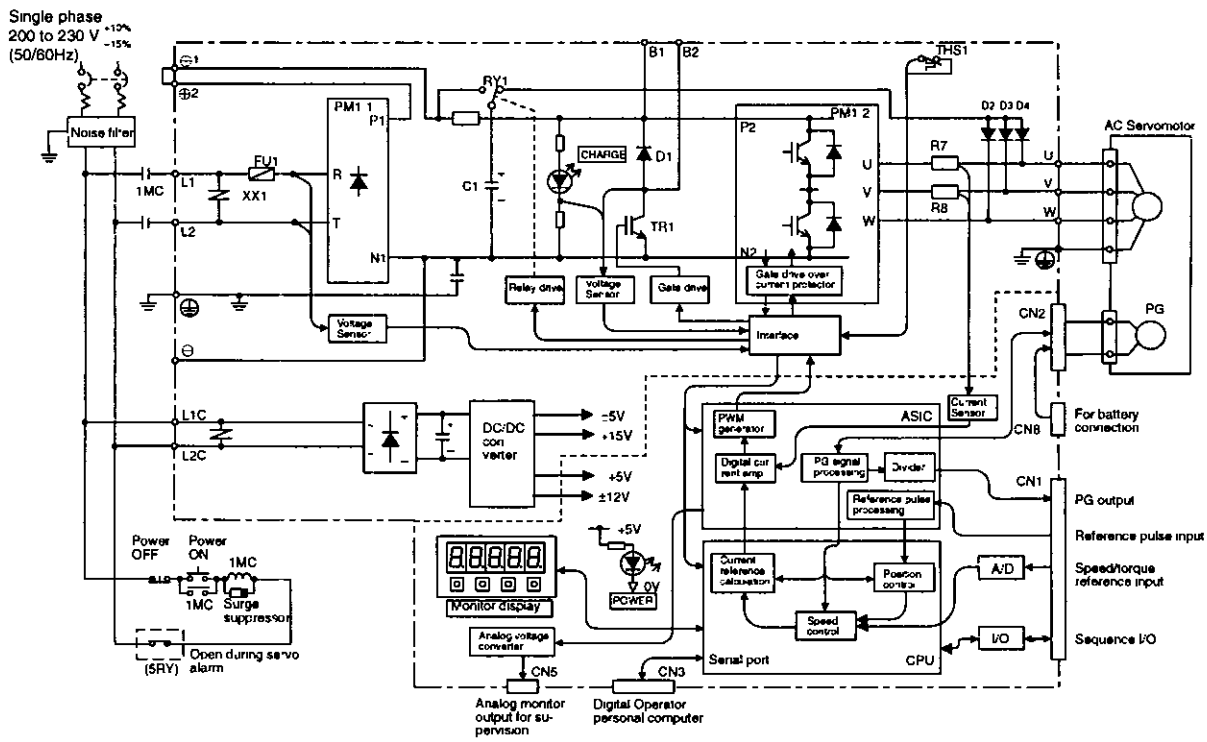


* The power supply voltage is 100 to 115 V $^{+10\%}_{-15\%}$ (50/60 Hz) for the 30 to 200 W 100-V models


3.2.2 0.5 kW to 1.5 kW 200-V Models

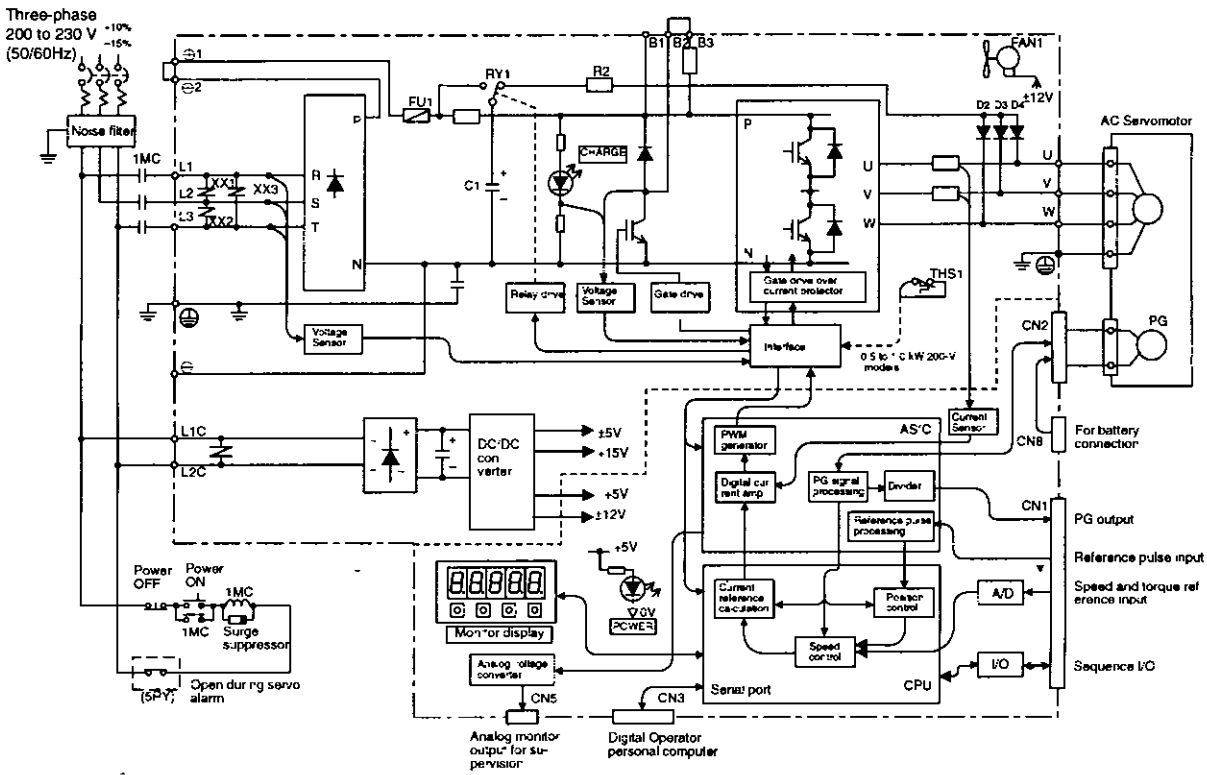

3.2.3 2.0 kW to 5.0 kW 200-V Models

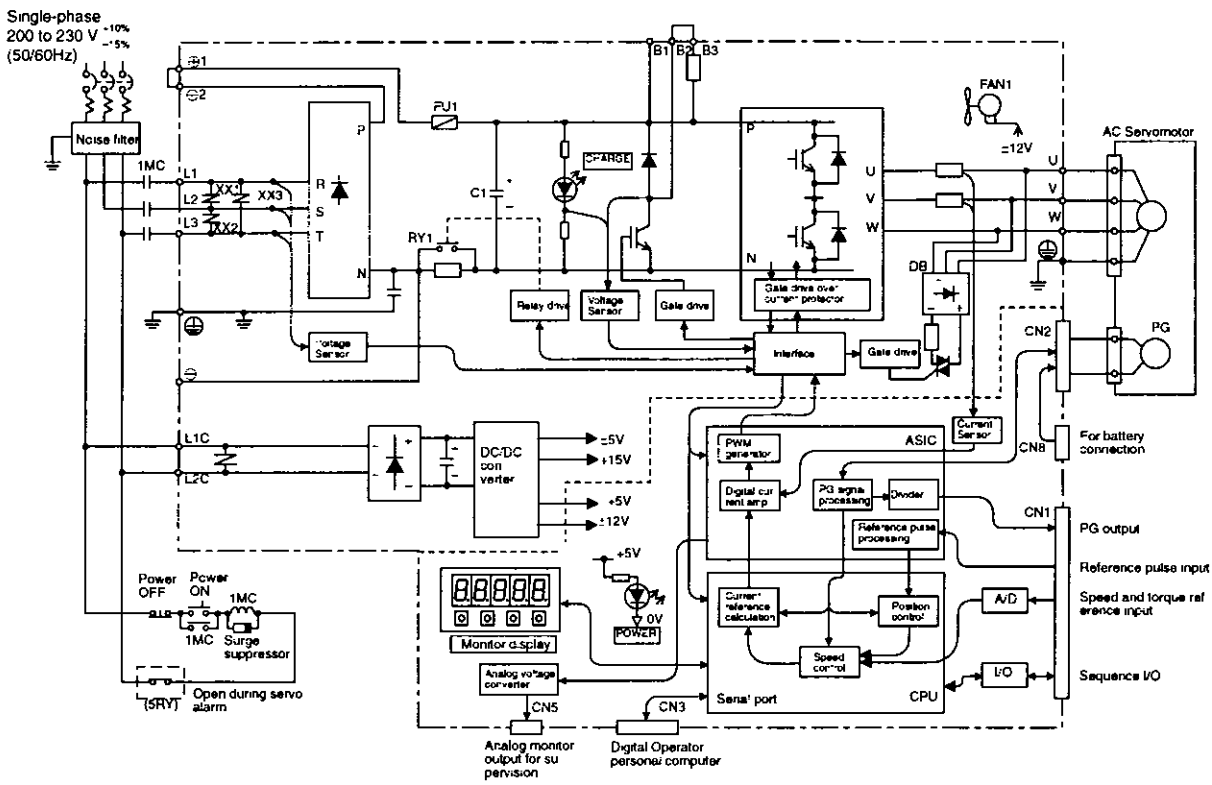

3.2.4 6.0 kW and 7.5 kW 200-V Models

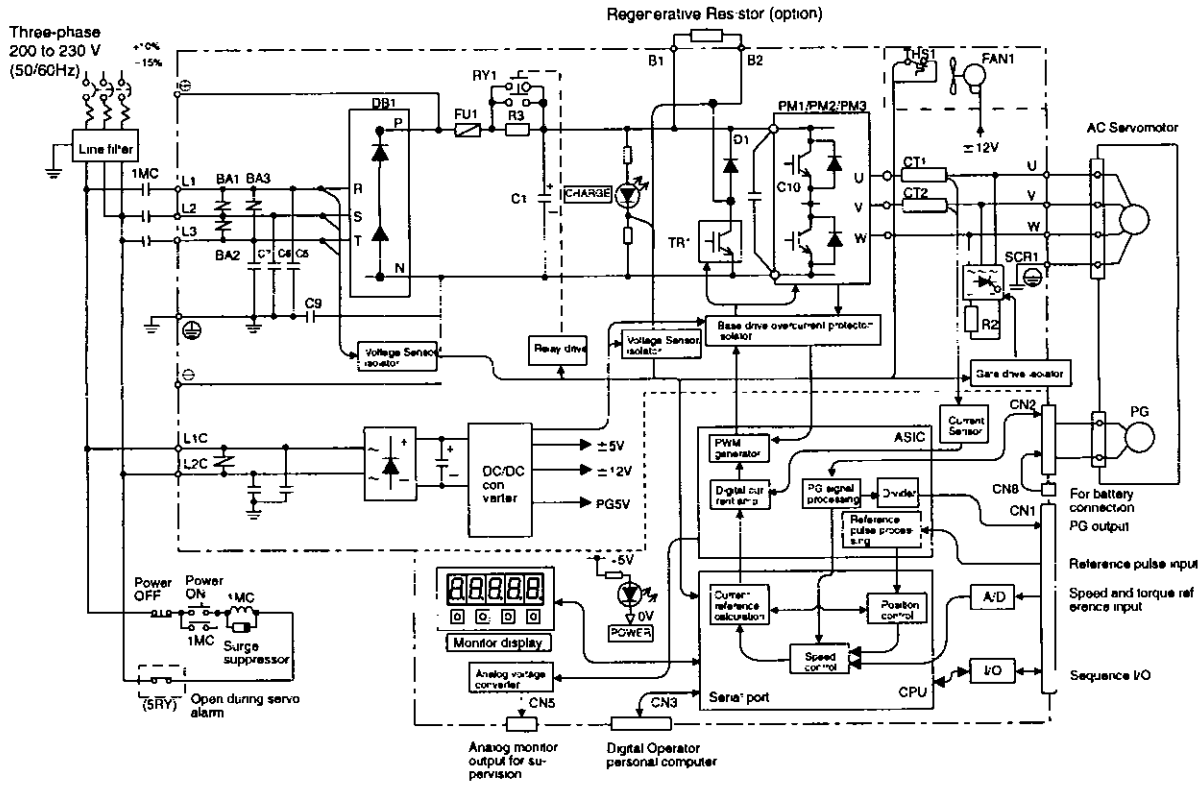

3.3 Main Circuit Wiring

This section shows typical examples of main circuit wiring for Σ-II Series servo products, functions of main circuit terminals, and the power ON sequence

Observe the following precautions when wiring

⚠ CAUTION

- Do not bundle or run power and signal lines together in the same duct Keep power and signal lines separated by at least 30 cm (11 81 in)
- Use twisted-pair wires or multi-core shielded-pair wires for signal and encoder (PG) feedback lines

  The maximum length is 3 m (118 11 in) for reference input lines and is 20 m (787 40 in) for PG feedback lines
- Do not touch the power terminals for 5 minutes after turning power OFF because high voltage may still remain in the Servopack

  Make sure the charge indicator is out first before starting an inspection
- Avoid frequently turning power ON and OFF Do not turn power ON or OFF more than once per minute

  Since the Servopack has a capacitor in the power supply, a high charging current flows for 0 2 seconds when power is turned ON Frequently turning power ON and OFF causes main power devices like capacitors and fuses to deteriorate, resulting in unexpected problems

3.3.1 Names and Descriptions of Main Circuit Terminals


Table 3 1 gives the names and a description of main circuit terminals

Table 3.1 Main Circuit Names and Description

Terminal Symbol	Name	Description	
L1, L2 or L1, L2, L3	Main circuit AC input terminal	30 W to 200 W	Single-phase 100 to 115 V $^{+10\%}_{-15\%}$ (50/60 Hz)
		30 W to 400 W	Single-phase 200 to 230 V $^{+10\%}_{-15\%}$ (50/60 Hz)
		0 5 kW to 7 5 kW	Three-phase 200 to 230 V $^{+10\%}_{-15\%}$ (50/60 Hz)
U, V, W	Servomotor connection terminal	Connects to the Servomotor	
L1C, L2C	Control power input terminal	30 W to 200 W	Single-phase 100 to 115 V $^{+10\%}_{-15\%}$ (50/60 Hz)
		30 W to 7 5 kW	Single-phase 200 to 230 V $^{+10\%}_{-15\%}$ (50/60 Hz)
⏚ **(2 places)**	Ground terminal	Connects to the power supply ground terminals and motor ground terminal	
B1, B2 or B1, B2, B3	External regenerative resistor terminal	30 W to 400 W	Normally not connected Connect an external regenerative resistor (provided by customer) between B1 and B2 if the regenerative capacity is insufficient Note No B3 terminal
		0 5 kW to 5 0 kW	Normally short B2 and B3 (for an internal regenerative resistor) Remove the wire between B2 and B3 and connect an external regenerative resistor (provided by customer) between B1 and B2 if the capacity of the internal regenerative resistor is insufficient
B1, B2 or B1, B2, B3	External regenerative resistor terminal	6 0 kW, 7 5 kW	Connect an external regenerative resistor (provided by customer) between terminals B1 and B2 Refer to *5 6 Selecting a Regenerative Resistor* for details Note No B3 terminal
⊕1, ⊕2	DC reactor terminal connection for power supply harmonic wave countermeasure	Normally short ⊕1 and ⊕2 If a countermeasure against power supply harmonic waves is needed, connect a DC reactor between ⊕1 and ⊕2 Note These terminals do not exist on Servopacks with a capacity of 6 kW or higher	
⊕	Main circuit plus terminal	Normally not connected Note This terminal is on Servopacks with a capacity of 6 kW or higher only	
⊖	Main circuit minus terminal	Normally not connected	

3.3.2 Typical Main Circuit Wiring Example

The following figure shows a typical example of main circuit wiring

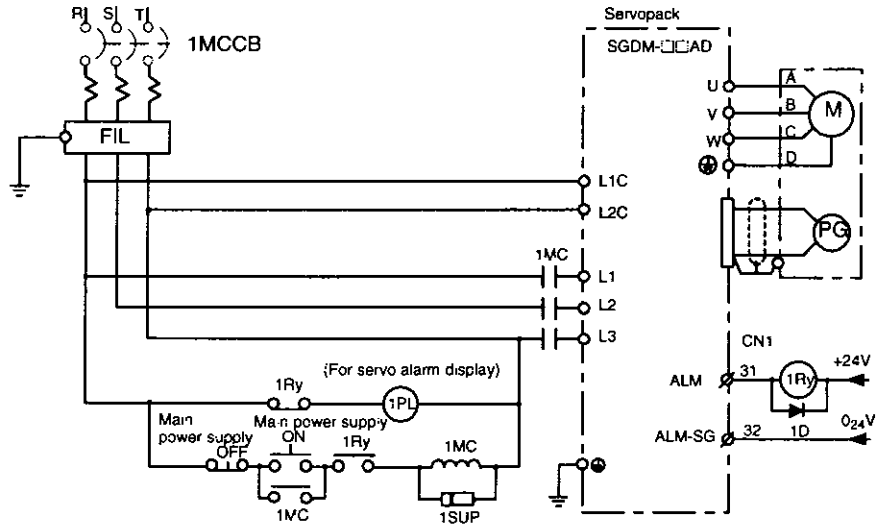

1MCCB: Molded-case circuit breaker (for the inverter)

FIL. Noise filter

1MC Magnetic Contactor

1Ry Relay

1PL: Indicator lamp


1SUP Surge suppressor

1D: Flywheel diode

■ Designing a Power ON Sequence

Note the following points when designing the power ON sequence

- Design the power ON sequence so that power is turned OFF when a servo alarm signal is output (See the circuit figure above)
- Hold the power ON button for at least two seconds The Servopack will output a servo alarm signal for two seconds or less when power is turned ON This is required in order to initialize the Servopack

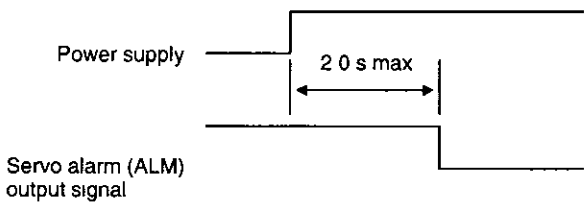

3.3.3 Cable Specifications and Peripheral Devices

Refer to the *SGM□H/SGDM User's Manual Servo Selection and Data Sheets* (Manual No SIE-S800-31 1)

3.3.4 Servopack Power Losses

Table 3 2 shows Servopack power losses at the rated output

Table 3.2 Servopack Power Losses at Rated Output

Main Circuit Power Supply	Maximum Applicable Servomotor Capacity [kW]	Servopack Model	Output Current (Effective Value) [A]	Main Circuit Power Loss [W]	Regenerative Resistor Power Loss [W]	Control Circuit Power Loss [W]	Total Power Loss [W]
Single-phase 200V	0 03	SGDM-A3AD, -A3ADA	0 44	3 1	–*1	13	16 1
	0 05	SGDM-A5AD, -A5ADA	0 64	4 6			17 6
	0 10	SGDM-01AD. -01ADA	0 91	6 7			19 7
	0 20	SGDM-02AD, -02ADA	2 1	13 3			26 3
	0 40	SGDM-04AD, -04ADA	2 8	20			33
Three-phase 200V	0 50	SGDM-05AD. -05ADA	3 8	27	12*2	15	54
	0 75	SGDM-08AD. -08ADA	5 7	41			68
	1 0	SGDM-10AD. -10ADA	7 6	55			82
	1 5	SGDM-15AD. -15ADA	11 6	123	14*2		152
	2 0	SGDM-20AD, -20ADA	18 5	120	28*2		163
	3 0	SGDM-30AD. -30ADA	24 8	155			198
	5 0	SGDM-50ADA	32 9	240	56*2		311
	6 0	SGDM-60ADA	46 9	290	–*3	27	317
	7 5	SGDM-75ADA	54 7	330			357
Single-phase 100V	0 03	SGDM-A3BD, -A3BDA	0 66	3 5	–*1	13	16 5
	0 05	SGDM-A5BD, -A5BDA	0 95	5 2			18 2
	0 10	SGDM-01BD, -01BDA	2 4	12			25
	0 20	SGDM-02BD, -02BDA	3 0	16 4			29 4

*** 1.** Servopacks with a capacity of 30 to 400 W do not have built-in regenerative resistors If the regenerative energy exceeds the specified value, connect an external regenerative resistor Refer to *5 6 2 Calculating the Required Capacity of Regenerative Resistors*

*** 2.** Regenerative resistor power losses are allowable losses Take the following action if this value is exceeded
Remove the lead from the internal regenerative resistor in the Servopack
Install an external regenerative resistor

*** 3.** An external regenerative resistor must be connected to Servopacks with a capacity of 6 0 kW or higher The following Regenerative Resistor Units are provided for this purpose
For the SGDM-60ADA JUSP-RA04 (allowable loss 180 W)
For the SGDM-75ADA JUSP-RA05 (allowable loss 350W)

Note External Regenerative Resistor Units are optional Refer to *5 6 Selecting a Regenerative Resistor* for details

3.3.5 Wiring Main Circuit Terminal Blocks

Observe the following precautions when wiring main circuit terminal blocks


⚠ CAUTION

- Remove the terminal block from the Servopack prior to wiring
- Insert only one wire per terminal on the terminal block
- Make sure that the core wire is not electrically shorted to adjacent core wires
- Reconnect any wires that were accidentally pulled out

Servopacks with a capacity below 1 5 kW will have connector-type terminal blocks for main circuit terminals Follow the procedure below when connecting to the terminal block

■ Connection Procedure

1. Strip the end of the wire



8 to 9 mm (0 31 to 0 35 in)

2. Open the wire terminal on the terminal block housing (plug) with the tool using the procedure shown in Fig A or B
   - Insert the hook end of the provided tool into the slot as shown in Fig A Press on the lever end to open the wire terminal
   - Use a standard flat-blade screwdriver (blade width of 3 0 to 3 5 mm (0 12 to 0 14 in)) Put the blade into the slot. as shown in Fig B. and press down firmly to open the wire terminal

   Either the procedure shown in Fig A or B can be used to open the wire insert opening

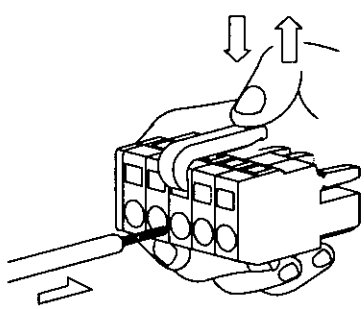


Fig A

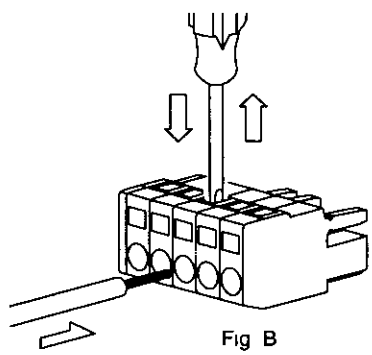


Fig B

3. Insert the wire core into the opening and then close the opening by releasing the lever or removing the screwdriver

■ Preparing the End of the Wire

Wire can be used simply by stripping back the outer coating The following are applicable wire sizes


- Single wire Ø0 5 to Ø1 6 mm
- Braided wire AWG28 to AWG12

3.4 I/O Signals

This section describes I/O signals for the SGDM Servopack

3.4.1 Examples of I/O Signal Connections

The following diagram shows a typical example of I/O signal connections

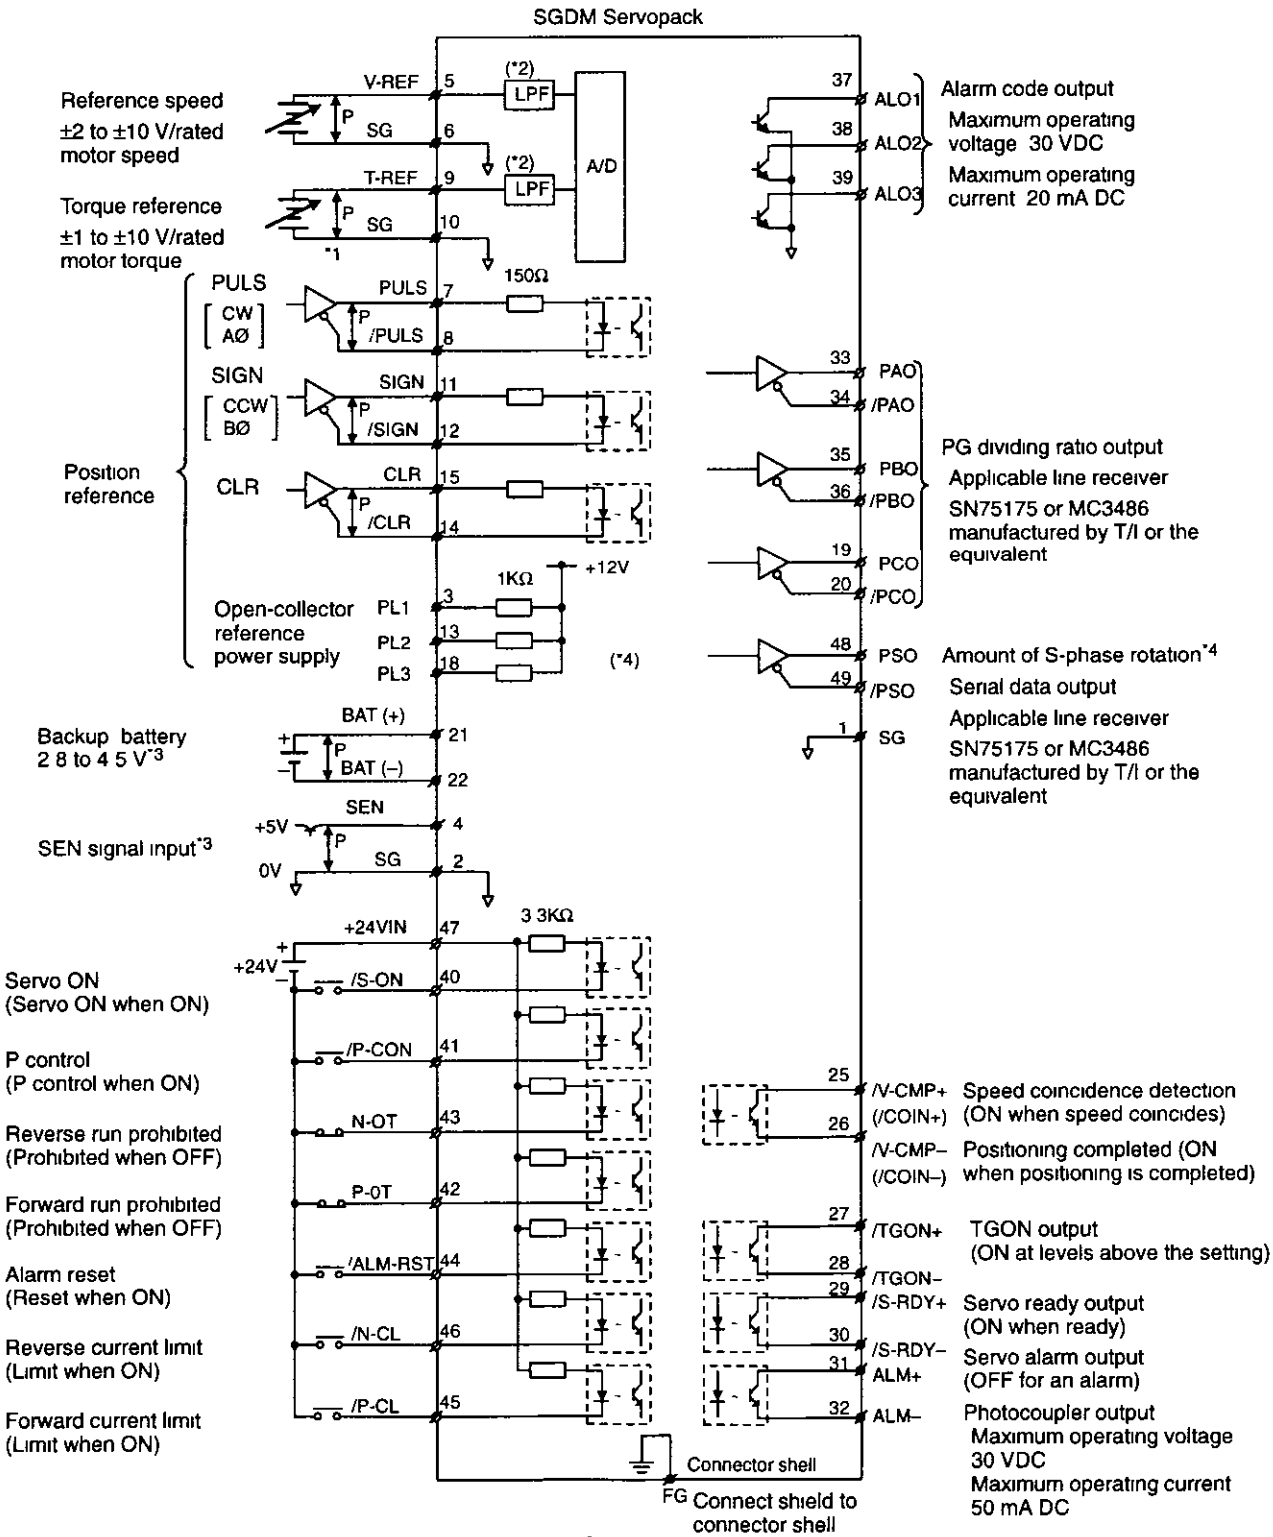

* 1. ‡P represents twisted-pair wires
* 2. The time constant for the primary filter is 47 μs
* 3. Connect when using an absolute encoder
* 4. Used only with an absolute encoder

3.4.2 List of CN1 Terminals

The following diagram shows the layout and specifications of CN1 terminals

■ CN1 Terminal Layout

			1	SG	GND				26	/V-CMP- (/COIN-)	Speed coinci-dence detec-tion output
2	SG	GND				27	/TGON+	TGON signal output			
			3	PL1	Open-collec-tor reference power supply				28	/TGON	TGON signal output
4	SEN	SEN signal input				29	/S-RDY+	Servo ready output			
			5	V-REF	Reference speed input				30	/S-RDY	Servo ready output
6	SG	GND				31	ALM+	Servo alarm output			
			7	PULS	Reference pulse input				32	ALM	Servo alarm output
8	/PULS	Reference pulse input				33	PAO	PG divided output A-phase			
			9	T-REF	Torque refer-ence input				34	/PAO	PG divided output A-phase
10	SG	GND				35	PBO	PG divided output B-phase			
			11	SIGN	Reference sign input				36	/PBO	PG divided output B-phase
12	/SIGN	Reference symbol input				37	AL01	Alarm code output			
			13	PL2	Open-collec-tor reference power supply				38	AL02	Alarm code output
14	/CLR	Clear input				39	AL03	(open-collec-tor output)			
			15	CLR	Clear input				40	/S-ON	Servo ON in-put
16	–	–				41	P-CON	P operation input			
			17	–	–				42	P-OT	Forward over-travel input
18	PL3	Open-collec-tor reference power supply				43	N-OT	Reverse over-travel input			
			19	PCO	PG divided output C-phase				44	/ALM-RST	Alarm reset input
20	/PCO	PG divided output C-phase				45	/P-CL	Forward cur-rent limit ON input			
			21	BAT (+)	Battery (+)				46	/N-CL	Reverse cur-rent limit ON input
22	BAT (–)	Battery (–)				47	+24V –IN	External input power supply			
			23	–	–				48	PSO	S-phase signal output
24	–	–				49	/PSO	S-phase signal output			
			25	/V-CMP+ (/COIN+)	Speed coinci-dence detec-tion output				50	–	–

Note 1. Do not use unused terminals for relays

2. Connect the shield of the I/O signal cable to the connector shell
Connect to the FG (frame ground) at the Servopack-end connector

■ CN1 Specifications

Specifications for Servopack Connectors	Applicable Receptacles		
	Solder Type	Case	Manufacturer
10250-52A2JL or Equivalent 50-p Right Angle Plug	10150-3000VE	10350-52A0-008	Manufactured by Sumitomo 3M Co

3.4.3 I/O Signal Names and Functions

The following section describes Servopack I/O signal names and functions

■ Input Signals

Signal Name		Pin No	Function		Reference
Common	/S-ON	40	Servo ON Turns ON the servomotor when the gate block in the inverter is released		5 5 2
	/P-CON	41	Function selected via user constant		5 2 1, 5 2 7
			Proportional operation reference	Switches the speed control loop from PI (proportional/integral) to P (proportional) control when ON	5 2 1
			Direction reference	With internal reference speed selected Switches the direction of rotation	5 2 6
			Control mode switching	Position ↔ speed Control ↔ torque Torque ↔ speed } Enables control mode switching	5 2 7
			Zero-clamp reference	Speed control with zero-clamp function Reference speed is zero when ON	5 4 3
			Reference pulse block	Position control with reference pulse stop Stops reference pulse input when ON	5 2 12
	P-OT N-OT	42 43	Forward Run prohibited Reverse Run prohibited	Overtravel prohibited Stops Servomotor when movable part travels beyond the allowable range of motion	5 1 2
	/P-CL /N-CL	45 46	* Function selected via user constant		---
			Forward current limit ON Reverse current limit ON	Current limit function used when ON	5 1 3
			Internal speed switching	With internal reference speed selected Switches the internal speed settings	5 2 6
	/ALM -RST	44	Alarm reset Releases the servo alarm state		5 5 1
	+24VIN	47	Control power supply input for sequence signals Users must provide the +24-V power supply Allowable voltage fluctuation range 11 to 25 V		5 2 4
	SEN	4 (2)	Initial data request signal when using an absolute encoder		5 2 3
	BAT (+) BAT (–)	21 22	Connecting pin for the absolute encoder backup battery		5 2 3
Speed	V-REF	5 (6)	Speed reference speed input ±2 to ±10 V/rated motor speed (Input gain can be modified using a user constant)		5 2 1

Signal Name		Pin No	Function		Reference
Torque	T-REF	9 (10)	Torque reference input ±1 to ±10 V/rated motor torque (Input gain can be modified using a parameter)		5.2.7
Position Reference	PULS /PULS SIGN /SIGN	7 8 11 12	Corresponds to reference pulse input Line-driver Open-collector	Input mode • Code + pulse string • CCW/CW pulse • Two-phase pulse (90° phase differential)	5.2.2
	CLR /CLR	15 14	Error counter clear Clears the error counter during position control		5.2.2
	PL1 PL2 PL3	3 13 18	+12-V pull-up power supply when PULS, SIGN and CLR reference signals are open-collector outputs (+12-V power supply is built into the Servopack)		5.2.2

Note 1 The functions allocated to /S-ON, /P-CON P-OT, N-OT, /ALM-RST, /P-CL, and /N-CL input signals can be changed via user constants (See *5.3.3 Input Circuit Signal Allocation*)

2. Pin numbers in parenthesis () indicate signal grounds

3 The voltage input range for speed and torque references is a maximum of ±12 V

■ Output Signals

Signal Name		Pin No	Function		Reference
Common	ALM+ ALM–	31 32	Servo alarm Turns OFF when an error is detected		5.5.1
	/TGON+ /TGON–	27 28	Detection during Servomotor rotation Detects whether the Servomotor is rotating at a speed higher than the motor speed setting Motor speed detection can be set via user constant		5.5.5
	/S-RDY + /S-RDY –	29 30	Servo ready ON if there is no servo alarm when the control/main circuit power supply is turned ON		5.5.6
	PAO /PAO PBO /PBO PCO /PCO	33 (1) 34 35 36 19 20	A phase signal B phase signal C phase signal	Converted two-phase pulse (A and B phase) encoder output signal and origin pulse (C phase) signal RS-422 or the equivalent	5.2.3
	PSO /PSO	48 49	S phase signal	With an absolute encoder Outputs serial data corresponding to the number of revolutions (RS-422 or equivalent)	5.2.3
	ALO1 ALO2 ALO3	37 38 39 (1)	Alarm code output Outputs 3-bit alarm codes Open-collector 30 V and 20 mA rating maximum		5.5.1
	FG	Shell	Connected to frame ground if the shield wire of the I/O signal cable is connected to the connector shell		

Signal Name		Pin No.	Function	Reference
Speed	**/V-CMP +** **/V-CMP –**	25 26	Speed coincidence (output in Speed Control Mode) Detects whether the motor speed is within the setting range and if it matches the reference speed value	5 5 4
Position	**/COIN+** **/COIN–**	25 26	Positioning completed (output in Position Control Mode) Turns ON when the number of error pulses reaches the value set The setting is the number of error pulses set in reference units (input pulse units defined by the electronic gear)	5 5 3
Not used		16 17 23 24 50	These terminals are not used Do not connect relays to these terminals	---

Note 1. Pin numbers in parenthesis () indicate signal grounds

2. The functions allocated to /TGON, /S-RDY, and /V-CMP (/COIN) can be changed via user constants /CLT /VCT /BK, /WARN, and /NEAR signals can also be changed *(See 5 3 4 Output Circuit Signal Allocation)*

3.4.4 Interface Circuits

This section shows examples of Servopack I/O signal connection to the host controller


■ Interface for Reference Input Circuits

Analog Input Circuit

Analog signals are either speed or torque reference signals at the impedance below

- Reference speed input About 14 kΩ
- Reference torque input About 14 kΩ


The maximum allowable voltages for input signals is ±12 V

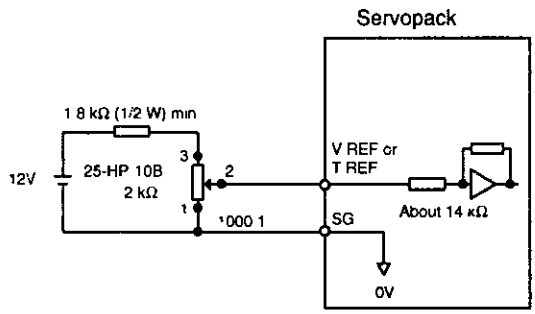


Reference Position Input Circuit

An output circuit for the reference pulse and error counter clear signal at the host controller can be either line-driver or open-collector outputs These are shown below by type

- Line-driver Output

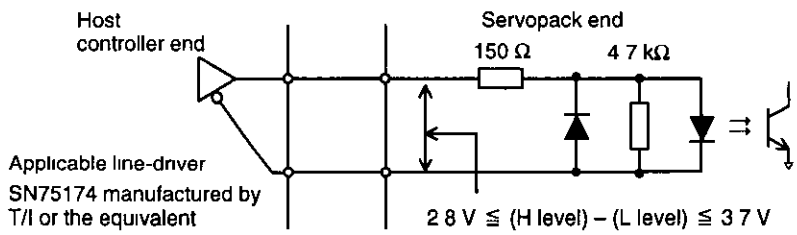

- Open-collector Output, Example 1 Power Supply Provided by User

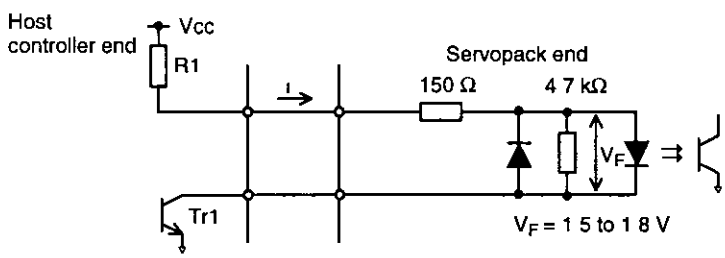


Use the examples below to set pull-up resistor R1 so the input current, I, falls between 7 and 15 mA

Application Examples		
R1 = 2 2 kΩ with a V_{CC} of 24 V ±5%	R1 = 1 kΩ with a V_{CC} of 12 V ±5%	R1 = 180 Ω with a V_{CC} of 5 V ±5%

- Open-collector Output, Example 2 Using 12-V Power Supply Built into Servopack


  This circuit uses the 12-V power supply built into the Servopack The input is not insulated in this case

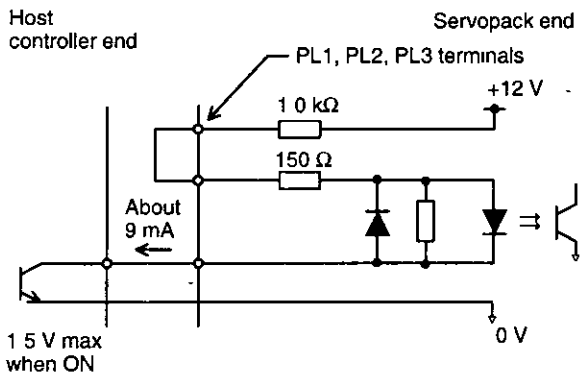

3

■ Sequence Input Circuit Interface

The sequence input circuit interface connects through a relay or open-collector transistor circuit Select a low-current relay otherwise a faulty contact will result

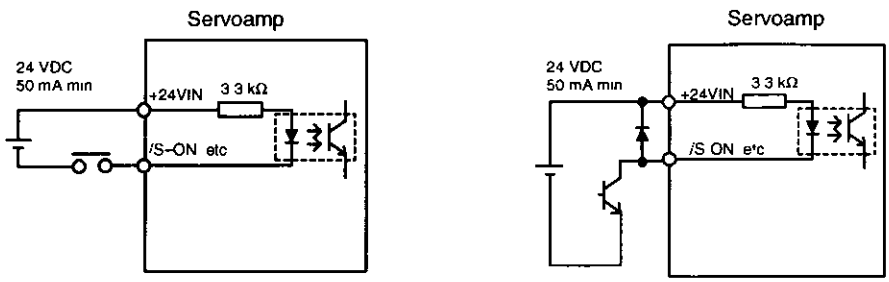

■ Output Circuit Interfaces

Any of the following three types of Servopack output circuits can be used Form an input circuit at the host controller that matches one of these types

- Connecting to a Line-driver Output Circuit

  Encoder serial data converted to two-phase (A and B phase) pulse output signals (PAO, /PAO, PBO, /PBO), origin pulse signals (PCO, /PCO) and S phase rotation signals (PCO, /PCO) are output via line-driver output circuits that normally comprise the position control system at the host controller Connect the line-driver output circuit through a line receiver circuit at the host controller


  See *3 5 Wiring to an Encoder* for connection circuit examples


efesotomasyon.com


- Connecting to an Open-collector Output Circuit

  Alarm code signals are output from open-collector transistor output circuits

  Connect an open-collector output circuit through a photocoupler, relay or line receiver circuit

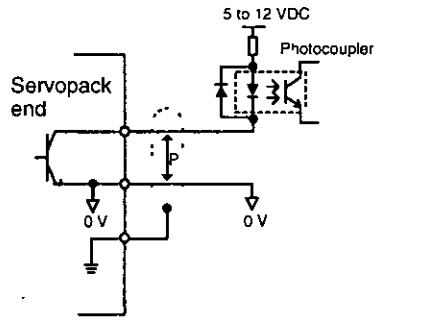

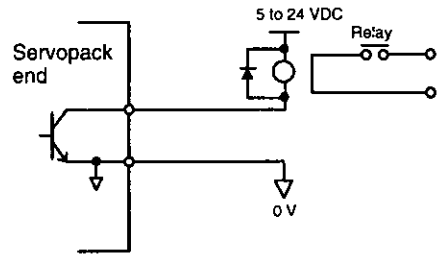

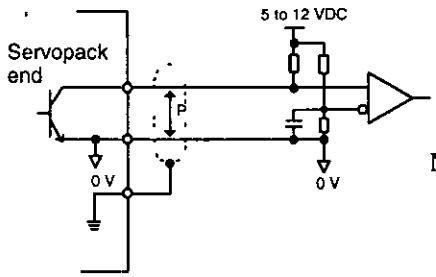



Note The maximum allowable voltage and current capacities for open-collector output circuits are as follows
Voltage 30 VDC max
Current 20 mA DC max

- Connecting to a Photocoupler Output Circuit

  Photocoupler output circuits are used for servo alarm, servo ready, and other sequence output signal circuits

  Connect a photocoupler output circuit through a relay or line receiver circuit

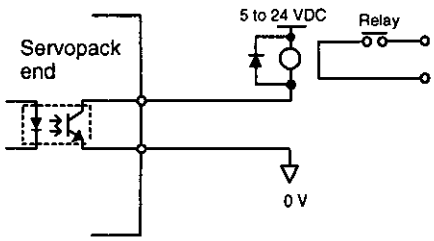

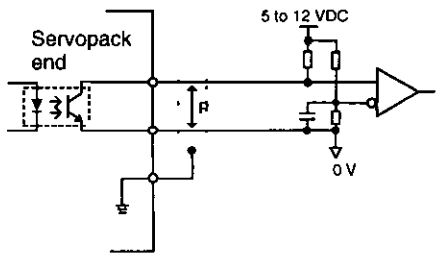

Note The maximum allowable voltage and current capacities for photocoupler output circuits are as follows
Voltage 30 VDC max
Current 50 mA DC max


3.5 Wiring Encoders

The following sections describe the procedure for wiring a Servopack to the encoder


3.5.1 Connecting an Encoder (CN2) and Output Signals from the Servopack (CN1)

The following diagrams show wiring for incremental and absolute encoders

■ Incremental Encoders

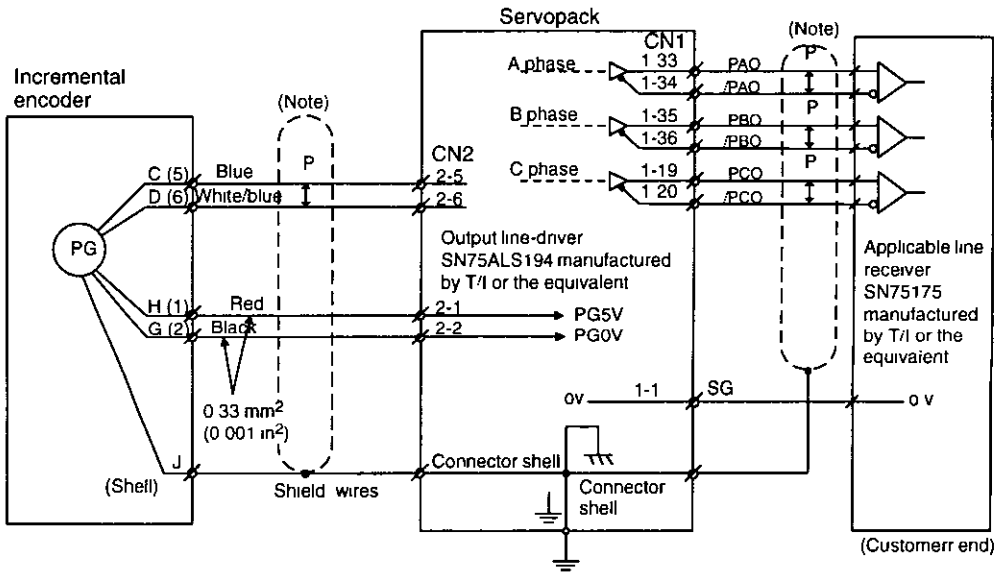

■ Absolute Encoders

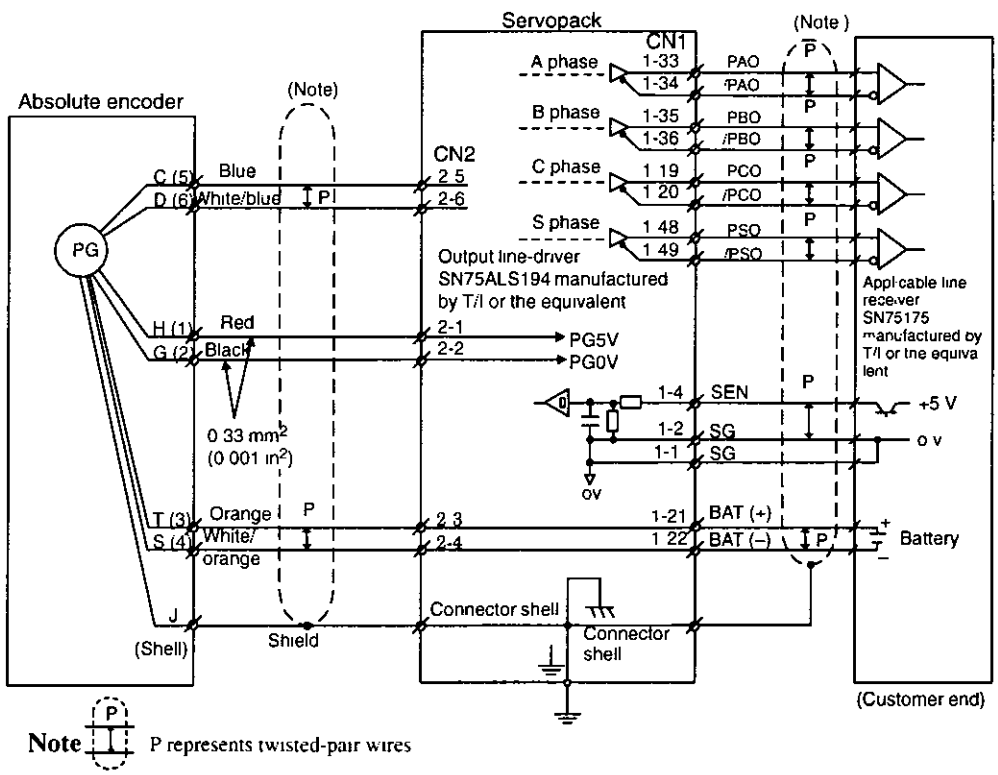

Note P represents twisted-pair wires

3.5.2 CN2 Encoder Connector Terminal Layout and Types

The following tables describe CN2 connector terminal layout and types

■ CN2 Connector Terminal Layout

1	PG5V	PG power supply +5 V	2	PG 0 V	PG power supply 0 V
3	BAT (+)	Battery (+) (For an absolute encoder)	4	BAT (–)	Battery (–) (For an absolute encoder)
5	PS	PG serial signal input	6	/PS	PG serial signal input

■ CN2 Connector Models

Servopack Connectors	Applicable Plug (or Socket)		
	Soldered Relay Plug (Servopack Connector)	Soldered Relay Plug (Servomotor Connector)	Manufacturer
53460-0611	55100-0600	54280-0600	Molex Japan Co , Ltd

Note 1. FA1394 is the product number for the Servopack-end plug and the Servomotor-end socket set from Molex Japan Co , Ltd

2. The Servomotor-end relay socket connects to the encoder connector for the SGMAH and SGMPH Servomotor

3 The following encoder connectors are for the SGMGH, SGMSH and SGMDH Servomotor
L-shaped plug MS3108B20-29S or
Straight MS3106B20-29S
Cable clamp MS3057-12A




Encoder cables are available from Yaskawa See the data sheets below for more details on the cables

- Refer to Σ-*II Series SGM□H/SGDM User's Manual Servo Selection and Data Sheets* (Manual No SIE-S800-31 1)

3.6 Examples of Standard Connections

The following diagrams show examples of standard Servopack connections by specifications and type of control

3.6.1 Single-phase Power Supply Specifications

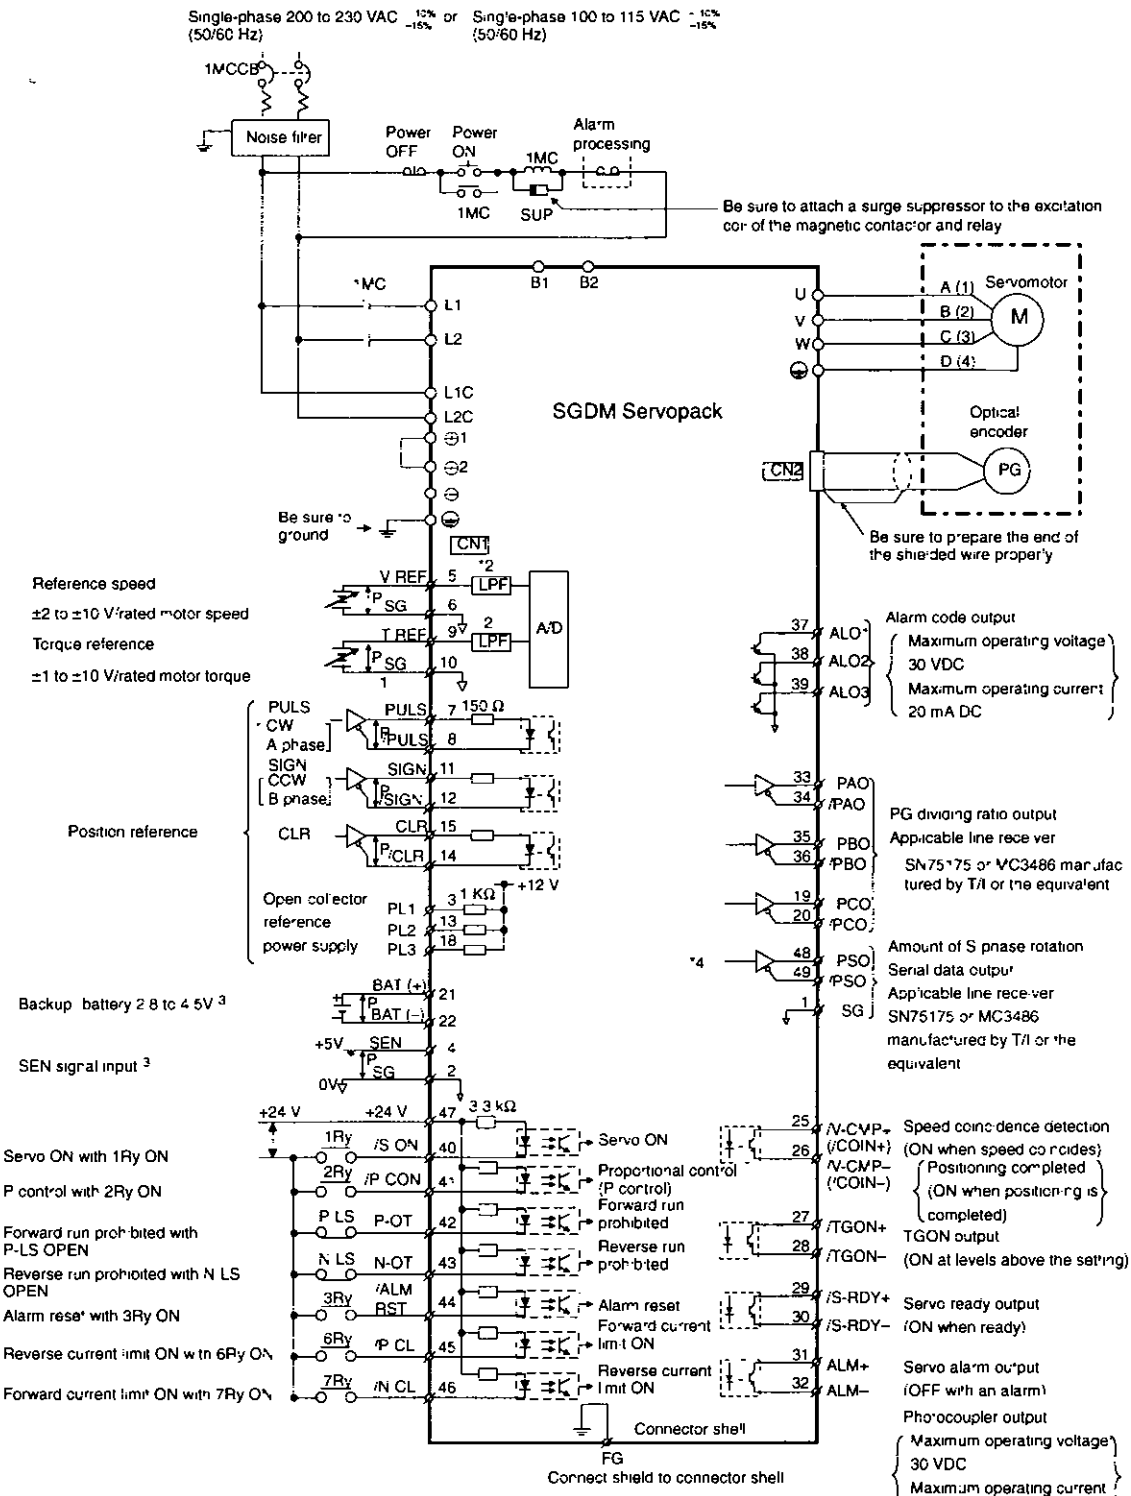


* 1. ‡P represents twisted-pair wires

* 2. The time constant for the primary filter is 47 µs

* 3. Connect when using an absolute encoder

* 4. Used only with an absolute encoder

3.6.2 Three-phase Power Supply Specifications

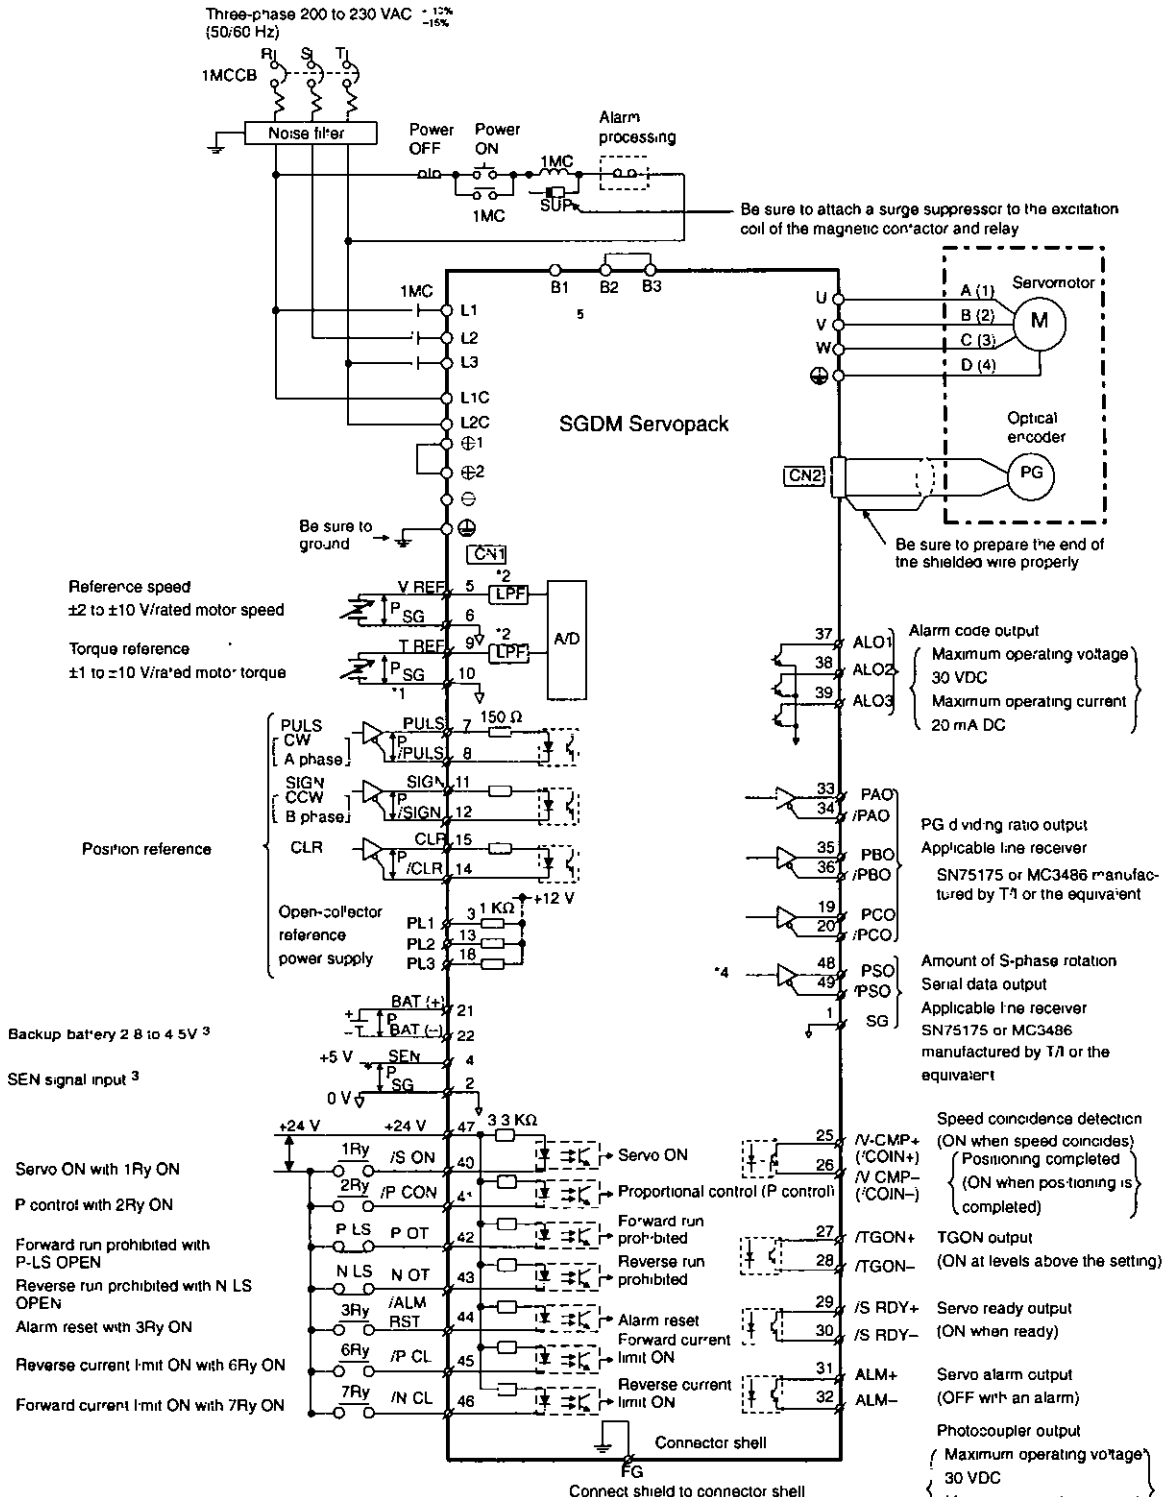

* 1. ↕P represents twisted-pair wires


* 2 The time constant for the primary filter is 47 μs

* 3 Connect when using an absolute encoder

* 4. Used only with an absolute encoder


* 5. Connect an external regenerative resistor between terminals B1 and B2 for Servopacks with a capacity of 6.0 kW or higher (There is no terminal B3 on these Servopacks.)

3.6.3 Position Control Mode

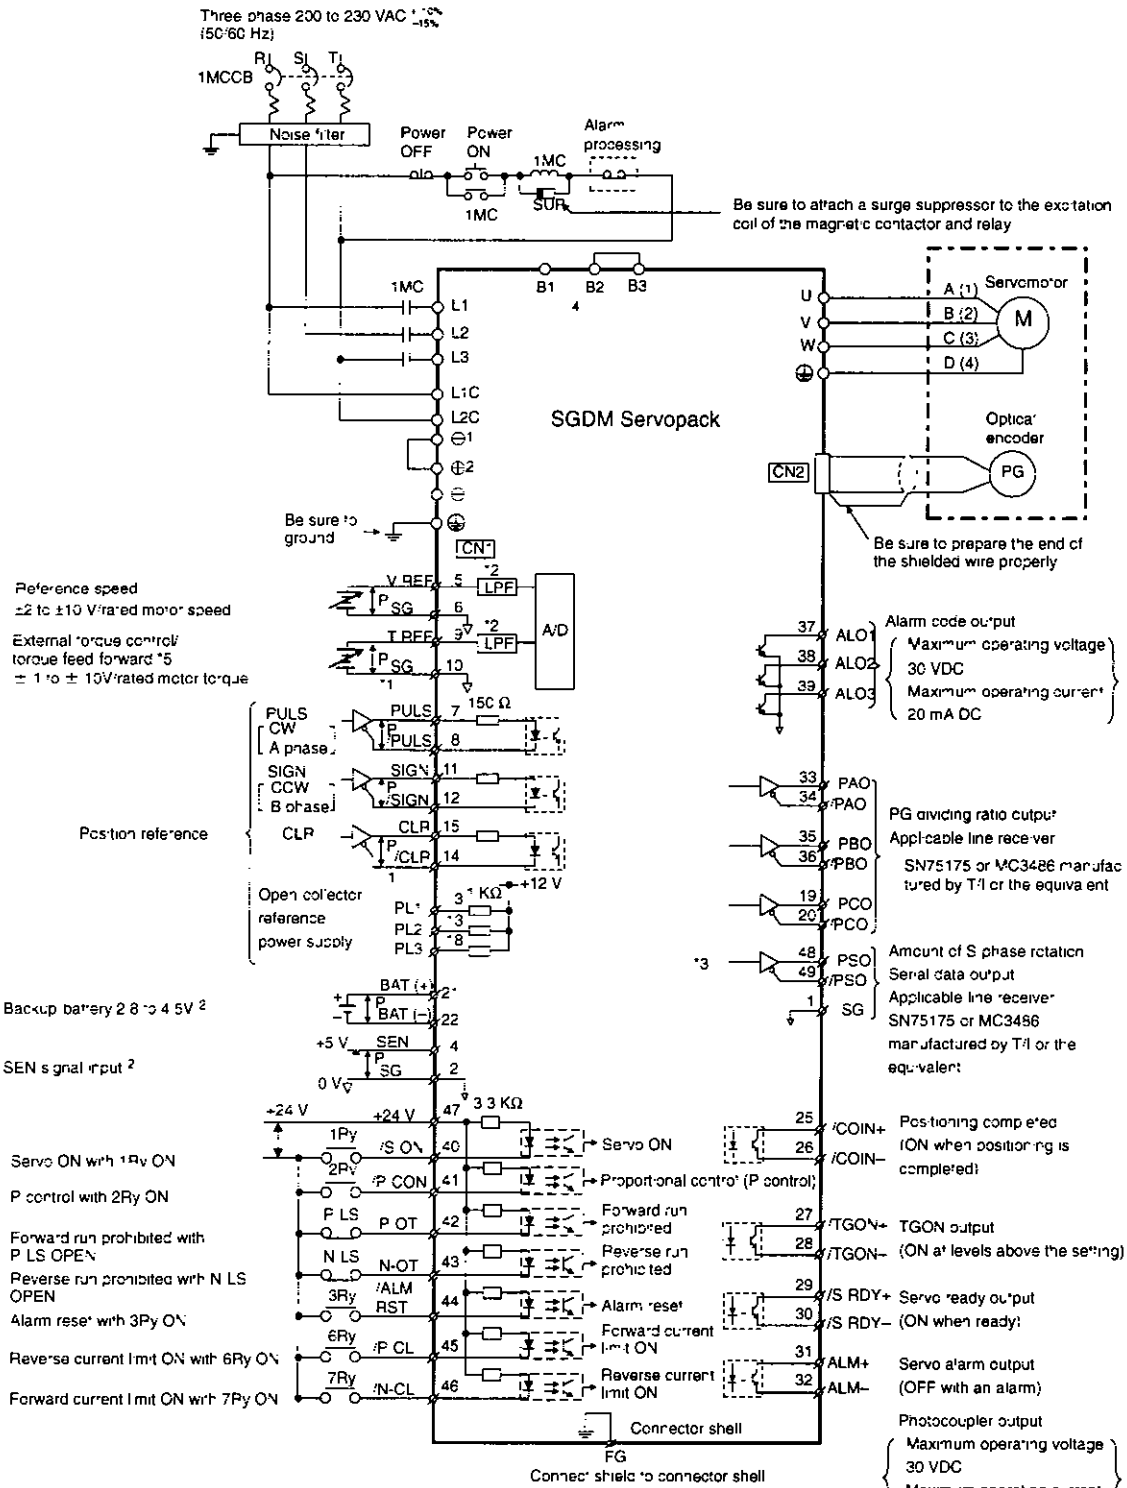


* 1. ↕P represents twisted-pair wires
* 2. Connect when using an absolute encoder
* 3. Used only with an absolute encoder
* 4. Connect an external regenerative resistor between terminals B1 and B2 for Servopacks with a capacity of 6 0 kW or higher (There is no terminal B3 on these Servopacks)
* 5. Set via user constant

3.6.4 Speed Control Mode

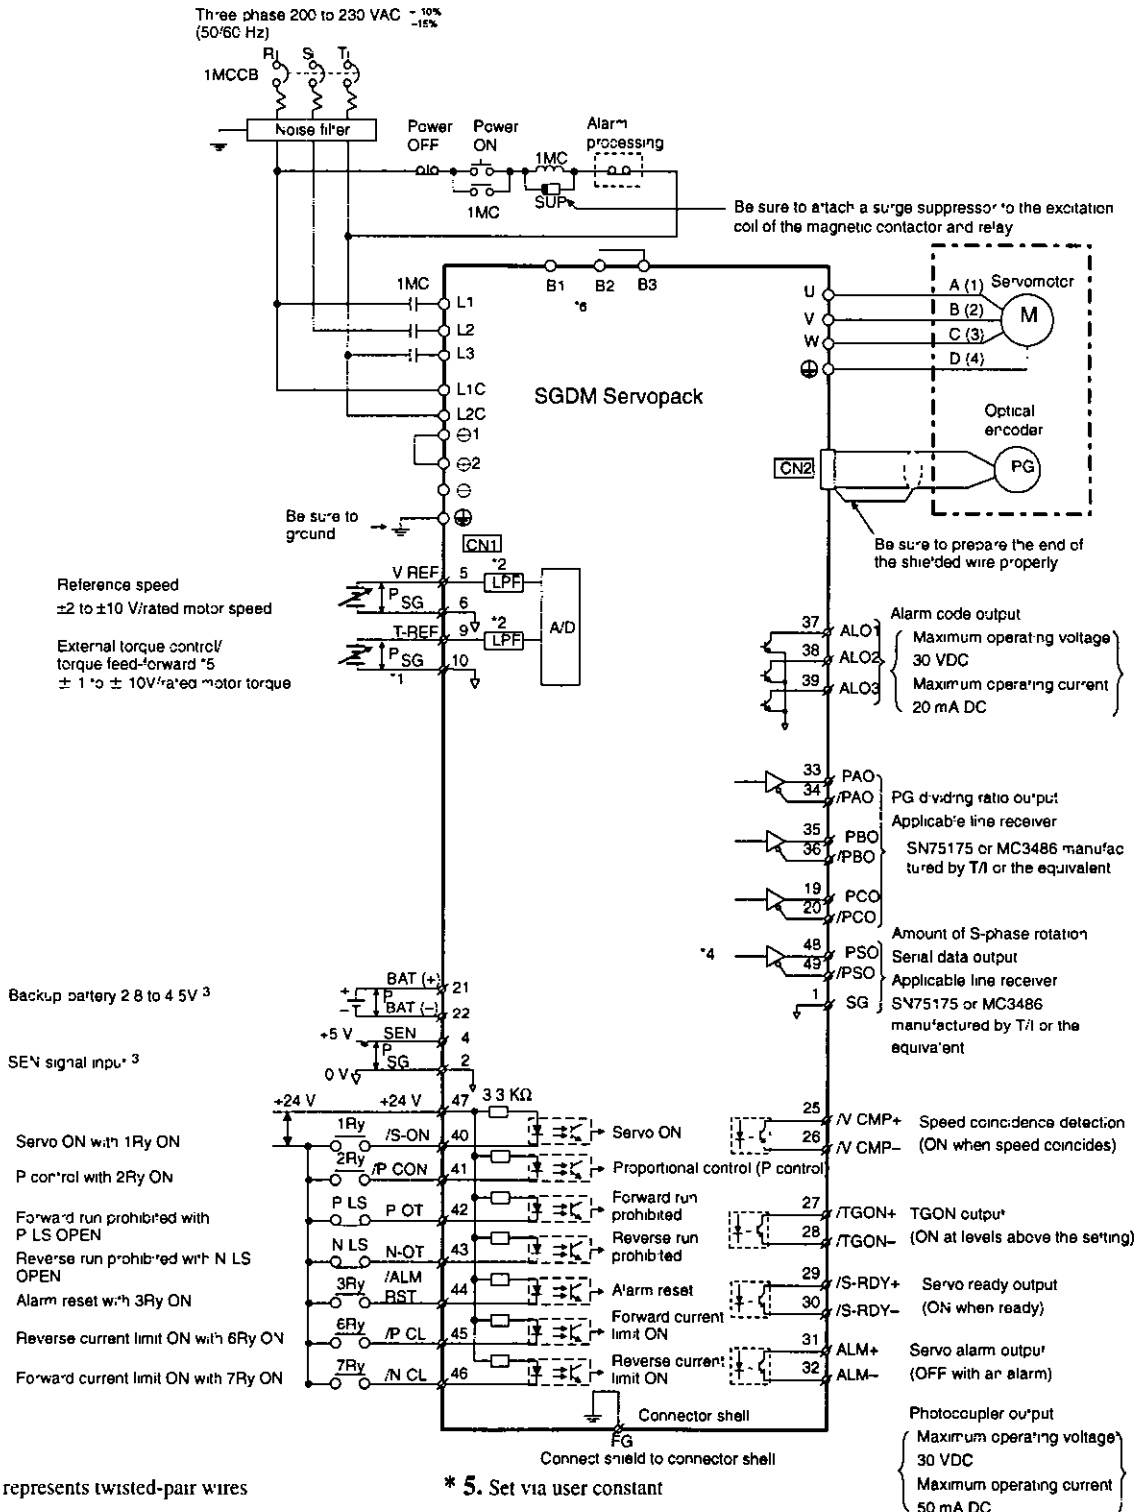

* **1.** ↕P represents twisted-pair wires
* **2.** The time constant for the primary filter is 47 μs
* **3.** Connect when using an absolute encoder
* **4.** Used only with an absolute encoder
* **5.** Set via user constant
* **6.** Connect an external regenerative resistor between terminals B1 and B2 for Servopacks with a capacity of 6.0 kW or higher (There is no terminal B3 on these Servopacks.)

3.6.5 Torque Control Mode

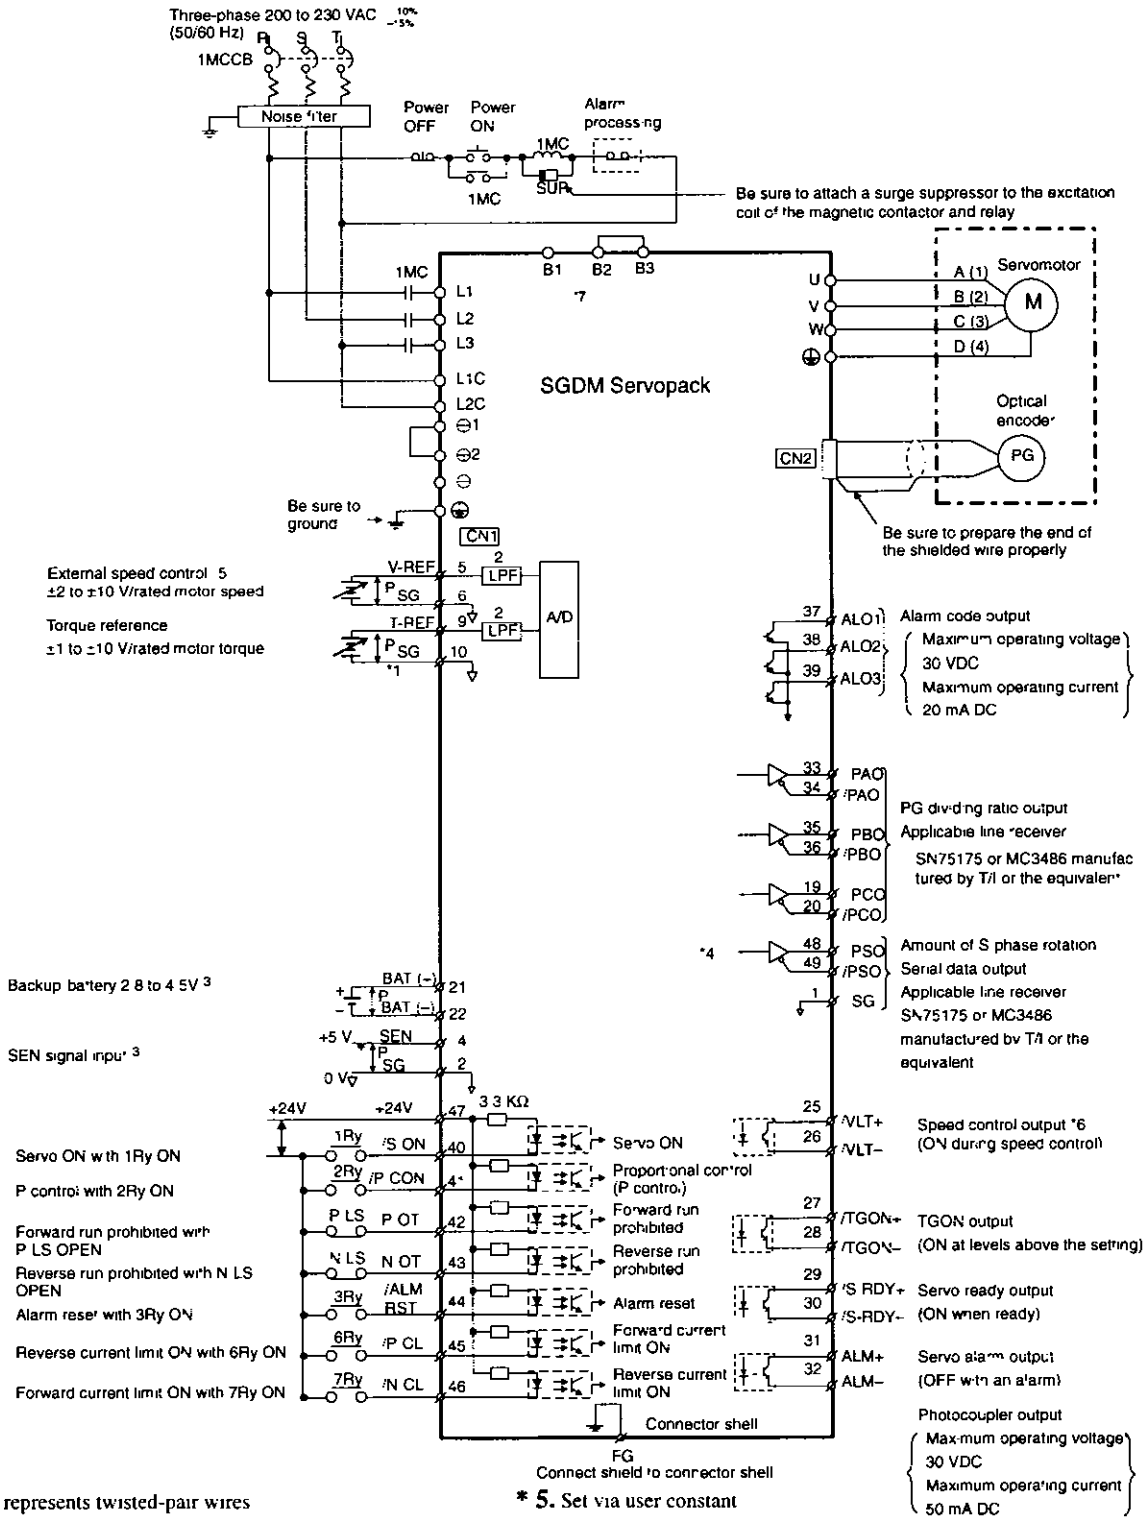

* **1.** ‡P represents twisted-pair wires
* **2.** The time constant for the primary filter is 47 μs
* **3.** Connect when using an absolute encoder
* **4.** Used only with an absolute encoder
* **5.** Set via user constant
* **6.** Set via user constant
* **7.** Connect an external regenerative resistor between terminals B1 and B2 for Servopacks with a capacity of 6.0 kW or higher (There is no terminal B3 on these Servopacks.)

4

Trial Operation

This chapter describes a two-step trial operation Be sure to complete step 1 before proceeding to step 2

4 1 Two-step Trial Operation . . . . . 4 - 2

4 1 1 Step 1 Trial Operation for Servomotor without Load 4 - 3

4 1 2 Step 2 Trial Operation with the Servomotor Connected to the Machine 4 - 9

4.2 Supplementary Information on Trial Operation . . . . . 4 - 10

4 2 1 Servomotors with Brakes 4 - 10

4 2 2 Position Control by Host Controller 4 - 11

4.3 Minimum User Constants and Input Signals 4 - 12

4 3 1 User Constants 4 - 12

4 3 2 Input Signals 4 - 13


4.1 Two-step Trial Operation

Make sure that all wiring is completed prior to starting trial operation

Perform the trial operation in the order given below (step 1 and 2) for your safety See *4 1 1* and *4 1 2* for more details on the trial operation


Step 1: Trial Operation for Servomotor without Load

Make sure the Servomotor is wired properly and then turn the shaft prior to connecting the Servomotor to the equipment

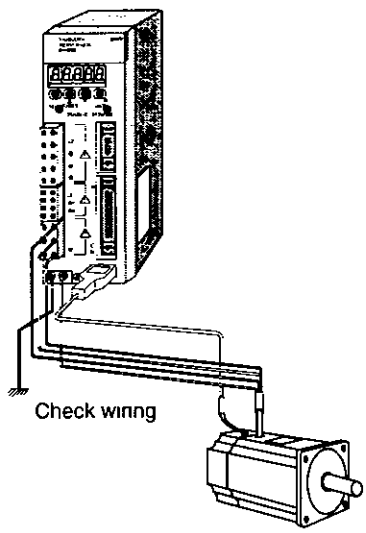

Step 2: Trial Operation with the Equipment and Servomotor Connected

Adjust the Servomotor according to equipment characteristics, connect the Servomotor to the equipment, and perform the trial operation

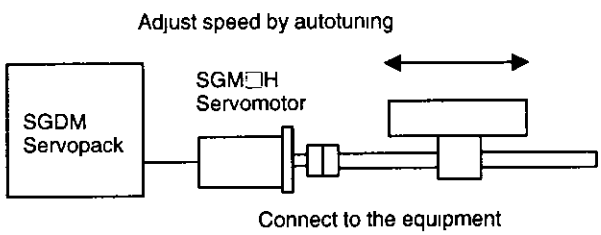

4.1.1 Step 1: Trial Operation for Servomotor without Load

⚠ CAUTION


- Do not operate the Servomotor while it is connected to the equipment

  To prevent accidents, initially perform step 1 where the trial operation is conducted under no-load conditions (with all couplings and belts disconnected)

In step 1, make sure that the Servomotor is wired properly as shown below Incorrect wiring is generally the reason why Servomotors fail to operate properly during trial operation

- Check main power supply circuit wiring
- Check Servomotor wiring
- Check CN1 I/O signal wiring

Make sure the host controller and other adjustments are completed as much as possible in step 1 (prior to connecting the Servomotor to equipment)

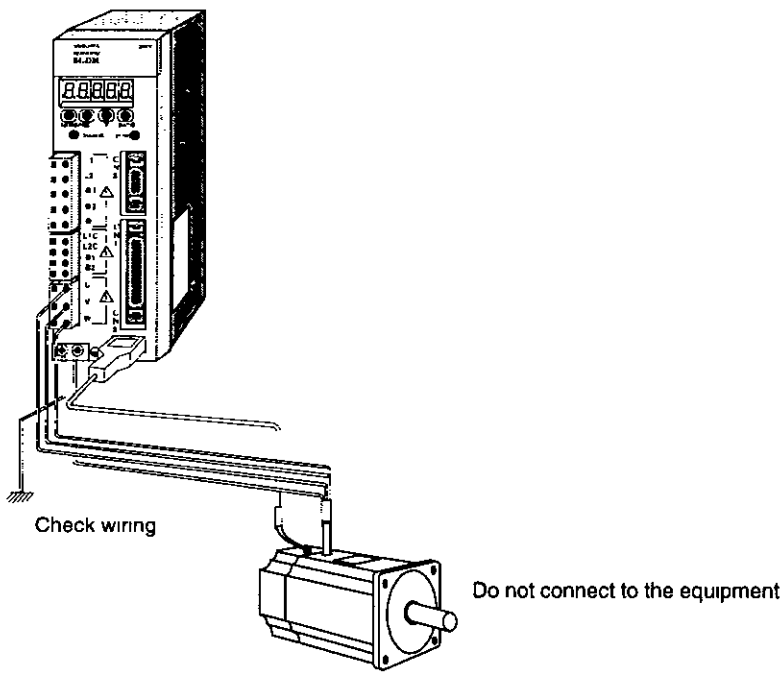


IMPORTANT

Check the items on the following pages in the order given during the Servomotor trial operation


See *4 2 1 Servomotors with Brakes* if you are using a Servomotor with brakes

1. Secure the Servomotor

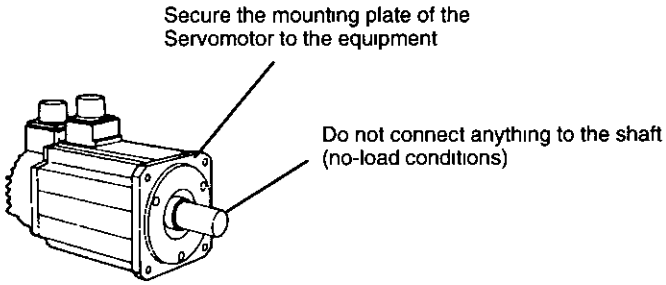

Secure the Servomotor mounting plate to the equipment in order to prevent the Servomotor from moving during operation


2. Check the wiring

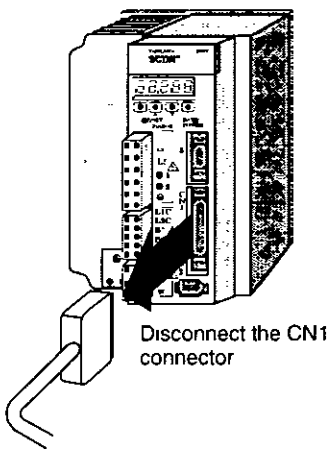

Disconnect the CN1 connector and check Servomotor wiring in the power supply circuit CN1 I/O signals are not used, so leave the connector disconnected

3. Turn ON power


Normal display





Alternate display

Example of Alarm Display




Turn ON Servopack power If the Servopack has turned ON normally, the LED display on the front panel of the Servopack will appear as shown above Power is not supplied to the Servomotor because the servo is OFF

If an alarm display appears on the LED indicator as shown above, the power supply circuit, Servomotor wiring, or encoder wiring is incorrect In this case, turn OFF power and take appropriate action See *9 2 Troubleshooting*

INFO If an absolute encoder is used, it must be set up Refer to *5 7 4 Absolute Encoder Setup*


4. Operate with Panel Operator

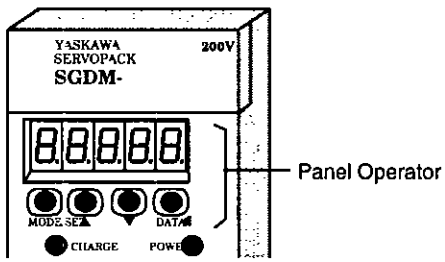

Operate the Servomotor using the Panel Operator Check to see if the Servomotor runs normally

See *7 2 2 Operation Using the Digital Operator* for more details on the procedure

5. Connect the signal lines

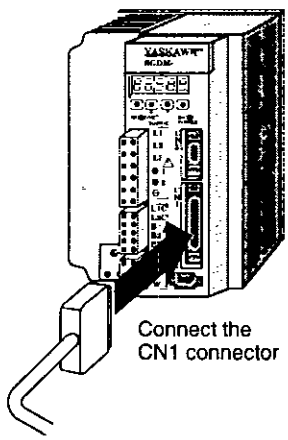

Use the following procedure to connect the CN1 connector

a) Turn OFF power

b) Connect the CN1 connector


c) Turn ON power again

6. Check the input signals

Check input signal wiring in Monitor Mode using the Panel Operator See *7 1 7 Operation in Monitor Mode* for more details on the procedure

Turn ON and OFF each signal line to see if the LED monitor bit display on the panel changes as shown below

Input signal LED display

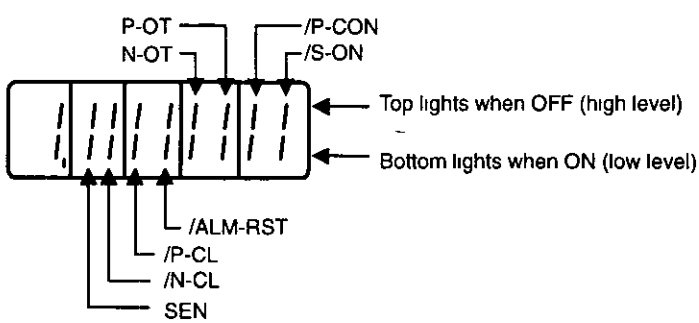

Input Signal Status	LED Display
OFF (high level)	Top LED indicators light
ON (low level)	Bottom LED indicators light

IMPORTANT


The Servomotor will not operate properly if the following signal lines are not wired correctly Short the signal lines if they will not be used The input signal selections (user constants Pn50A to Pn50D) can be used to eliminate the need for external short circuiting

Signal Symbol	Connector Pin No.	Description
P-OT	CN1-42	The Servomotor can rotate in the forward direction when this signal line is low (0 V)
N-OT	CN1-43	The Servomotor can rotate in the reverse direction when this signal line is low (0 V)
/S-ON	CN1-40	The Servomotor is turned ON when this signal line is low (0 V) Leave the Servomotor OFF
+24VIN	CN1-47	Control power supply terminal for sequence signals

INFO

IF an absolute encoder is being used. the servo will not turn ON when the servo ONsignal (/S-ON) is input unless the SEN signal is also ON
When the SEN signal is checked in monitor mode, the top of the LED will light because the SEN signal is high when ON


7. Turn ON the servo

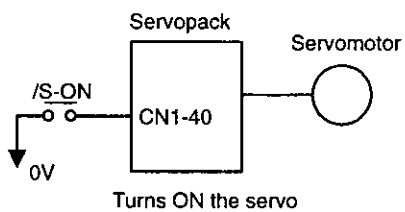

Turn ON the servo using the following procedure

1. Make sure there are no reference signals input
   - Set V-REF (CN1-5) and T-REF (CN1-9) to 0 V for speed and torque control
   - Set PULS (CN1-7) and SIGN (CN1-11) to low for position control
2. Turn ON the servo ON signal

Display with the servo ON



Set /S-ON (CN1-40) to 0 V If normal, the Servomotor will turn ON and the LED indicator on the front panel will display as shown above If an alarm display appears, take appropriate action as described in *9 2 Troubleshooting*


IMPORTANT If there is noise in the reference voltage for speed control, the "–" on the left of the 7-segment LED may flash

■ Operating Using Reference Input

The operating procedure here depends on the user constant settings (control mode selection at memory switch Pn000 1) Use the following procedure for operations with speed and position control

Operating Procedure in Speed Control Mode: Set Pn000.1 to 0

Standard speed control setting is described here

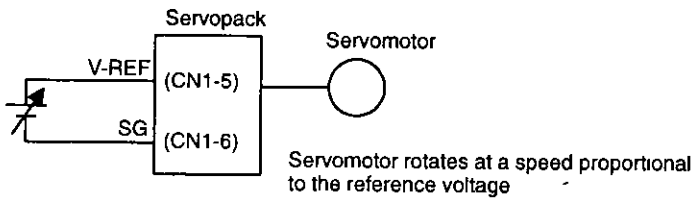

1. Gradually increase the reference speed input (V-REF, CN1-5) voltage The Servomotor will rotate
2. Check the following items in Monitor Mode See *7 1 7 Operation in Monitor Mode*

Un000	Actual motor speed
Un001	Reference speed

   - Has the reference speed been input?
   - Is the motor speed as designed?
   - Does the reference speed coincide the actual motor speed?
   - Does the Servomotor stop when the speed reference is 0?
3. If the Servomotor rotates at extremely slow speed with 0 V specified for the reference voltage, correct the reference offset value as described in *7 2 3 Automatic Adjustment of Speed and Torque Reference Offset* or *7 2 4 Manual Adjustment of Speed and Torque Reference Offset*
4. Reset the user constants shown below to change the motor speed or direction of rotation


Pn300	Sets the reference speed input gain See *5 2 1 Speed Reference*
Pn000 0	Selects the rotation direction See *5 1 1 Switching Servomotor Rotation Direction*

Operating Procedure in Position Control Mode: Set Pn000.1 to 1

1. Set the user constant Pn200 0 so the reference pulse form is the same as the host controller output form

   Selecting the reference pulse form See *5 2 2 Position Reference*

2. Input a slow speed pulse from the host controller and execute low-speed operation

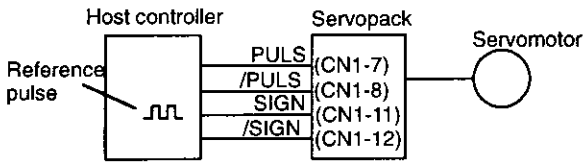

3. Check the following items in Monitor Mode See *7 1 7 Operation in Monitor Mode*

Un000	Actual motor speed
Un007	Reference pulse speed display
Un008	Position offset

- Has the reference pulse been input?
- Is the motor speed as designed?
- Does the reference speed coincide with the actual motor speed?
- Does the Servomotor stop when the speed reference is 0?

4. Reset the user constants shown below to change the motor speed or direction of rotation

Pn202, Pn203	Electronic gear ratio See *5 2 5 Using the Electronic Gear Function*
Pn000 0	Selects the direction of rotation See *5 1 1 Switching Servomotor Rotation Direction*

If an alarm occurs or the Servomotor fails to operate during the above operation, CN1 connector wiring is incorrect or user constant settings do not match the host controller specifications Check the wiring and review the user constant settings, then repeat step 1

INFO Reference

- List of Alarms See *9 2 3 Alarm Display Table*
- List of User Constants See *Appendix B List of User Constants*


4.1.2 Step 2: Trial Operation with the Servomotor Connected to the Machine

> **⚠ WARNING**
>
> - Follow the procedure below for step-2 operation precisely as given
>
> Malfunctions that occur after the Servomotor is connected to the equipment not only damage the equipment, but may also cause an accident resulting death or injury

Before proceeding to step 2, repeat step 1 (Servomotor trial operation without a load) until you are fully satisfied that all items including user constants and wiring have been tested completely

After step 1 has been completed, proceed to step 2 for trial operation with the Servomotor connected to the equipment The purpose of step 2 is to adjust the Servopack according to equipment characteristics

- Use autotuning to match the Servopack to equipment characteristics
- Match the direction of rotation and speed to equipment specifications
- Check the final control form

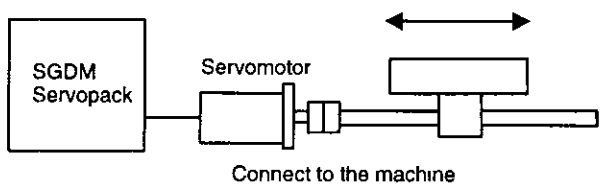

Follow the procedures below to perform the trial operation

1. Make sure power is OFF
2. Connect the Servomotor to the equipment

   See *2 1 Servomotors* for more details on connecting the Servomotor
3. Use autotuning to match the Servopack to equipment characteristics

   See *6 3 Autotuning*
4. Operate the Servomotor by reference input

   As in step 1 (Servomotor trial operation with no-load), execute operation by reference input as described in *4 1 1 Step 1 Servomotor Trial Operation* Tune to match the host controller at this time as well
5. Set and record user settings

   Set user constants as required and record all settings for use later in maintenance

INFO The Servomotor will not be broken in completely during the trial operation Therefore, let it the system run for a sufficient amount of additional time to ensure that it is properly broken in

4.2 Supplementary Information on Trial Operation


Always refer to this information before starting trial operation in the following instances

- 4 2 1 Servomotor with Brakes
- 4 2 2 Position Control by Host Controller

4.2.1 Servomotors with Brakes

Use Servomotors with brakes for vertical shaft applications or when external force is applied to the shaft to prevent the shaft from rotating due to gravity or external force when power is lost


The Servopack uses the brake interlock output (/BK) signal to control holding brake operation when using Servomotors with brakes

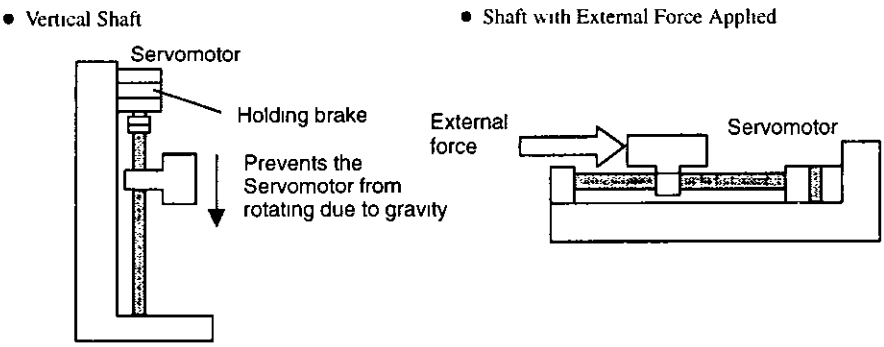

IMPORTANT


To prevent faulty operation due to gravity or external force, make sure that the Servomotor and holding brake operate normally with the Servomotor disconnected from the equipment When both of them operate normally, connect the servomotor to the equipment to start trial operation

The following figure shows wiring for a Servomotor with brakes See *5 4 4 Using the Holding Brake* for details on wiring

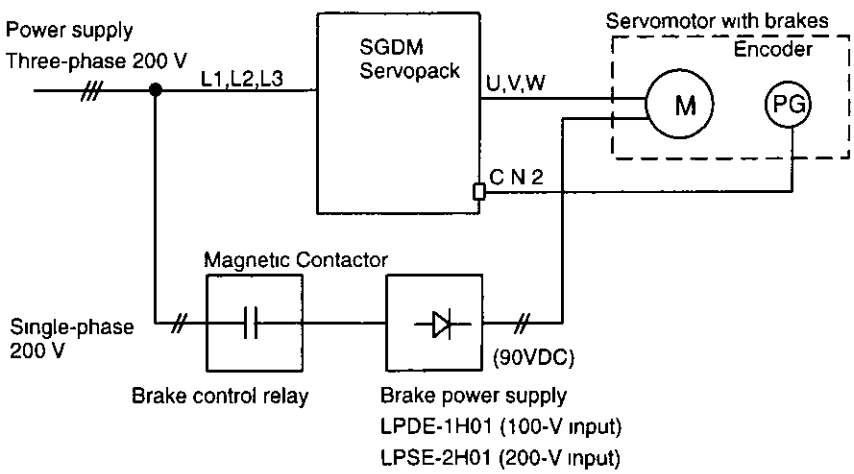

4.2.2 Position Control by Host Controller

If position control from the host controller has not been confirmed, disconnect the Servomotor from the equipment and perform a trial operation, otherwise the Servomotor may run out of control Check Servomotor operation as described in the following table

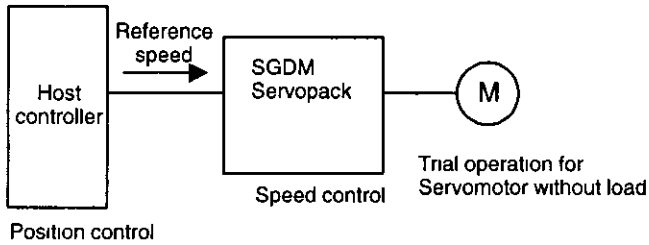

Reference from the Host Controller	Check Item	Check Method	Review Items
JOG Operation (Constant Reference Speed Input from Host Controller)	Motor speed	Check motor speed as follows • Use the speed monitor (Un000) on the Panel Operator • Run the Servomotor at low speed Input a reference speed of 60 r/min for example to check to see if the Servomotor makes one revolution per second	Check the user constant setting at Pn300 to see if reference speed gain is correct
Simple Positioning	No of motor rotations	Input a reference equivalent to one Servomotor rotation and visually check to see if the shaft makes one revolution	Check the user constant setting at Pn201 to see if the number of dividing pulses is correct
Overtravel (P-OT and N-OT Used)	Whether the Servomotor stops rotating when P-OT and N-OT signals are input	Check to see if the Servomotor stops when P-OT and N-OT signals are input during continuous Servomotor operation	Review P-OT and N-OT wiring if the Servomotor does not stop

4.3 Minimum User Constants and Input Signals

This section describes the minimum user constants and input signals required for trial operation

4.3.1 User Constants

See *7 1 6 Operation in User Constant Setting Mode* for more details on setting user constants

Turn OFF power once after changing any user constant except Pn300 The change will be valid when power is turned ON again

Basic Parameters

Pn000 1	Function Selection Basic Switches Control Method Selection	See *5 3 5*

Speed Control

Pn300	Speed Reference Input Gain	See *5 2 1*
Pn201	PG Divider	See *5 2 3*

Position Control

Pn200 0	Reference Pulse Form	See *5 2 2*
Pn202	Electronic Gear Ratio (Numerator)	See *5 2 5*
Pn203	Electronic Gear Ratio (Denominator)	See *5 2 5*

Changing Servomotor Rotation Direction

The wiring may be incorrect if the specified direction of rotation differs from the actual direction of rotation Recheck the wiring and correct if necessary Use the following user constant to reverse the direction of rotation

Pn000 0	Function Selection Basic Switches Direction Selection	See *5 1 1*

4.3.2 Input Signals

Refer to the relevant page for details on each input signal

Input signal selection settings through user constants can be used to eliminate the need for external short circuits

Signal Name		Pin Number	Description
/S-ON	Servo ON	CN1-40	See 5 5 2 for more details on turning ON and OFF the Servomotor
P-OT	Forward run prohibited	CN1-42	See 5 1 2 for more details on the overtravel limit switch
N-OT	Reverse run prohibited	CN1-43	

5

User Constant Settings and Functions

This chapter describes the procedure for setting and applying user constants

5 1 Settings According to Device Characteristics . . . 5 -4

5 1 1 Switching Servomotor Rotation Direction 5 -4

5 1 2 Setting the Overtravel Limit Function 5 -5

5 1 3 Limiting Torques 5 -9

5 1 4 Limiting Speed 5 -13

5 2 Settings According to Host Controller 5 -15

5 2 1 Speed Reference 5 -15

5 2 2 Position Reference 5 -17

5 2 3 Using the Encoder Signal Output 5 -23

5 2 4 Sequence I/O Signals 5 -26

5 2 5 Using the Electronic Gear Function 5 -28

5 2 6 Contact Input Speed Control 5 -32

5 2 7 Using Torque Control 5 -38

5 2 8 Torque Feed-forward Function 5 -44

5 2 9 Speed Feed-forward Function 5 -45

5 2 10 Torque Limiting by Analog Voltage Reference, Function 1 5 -46

5 2 11 Torque Limiting by Analog Voltage Reference, Function 2 5 -47

5 2 12 Reference Pulse Inhibit Function (INHIBIT) 5 -49

5 3 Setting Up the Servopack . 5 -50

5 3 1 User Constants 5 -50

5 3 2 JOG Speed 5 -51

5 3 3 Input Circuit Signal Allocation 5 -51

5 3 4 Output Circuit Signal Allocation 5 -57
5 3 5 Control Mode Selection 5 -60
5 3 6 DC Power Input 5 -62
5 4 Setting Stop Functions 5 -63
5 4 1 Adjusting Offset 63
5 4 2 Using the Dynamic Brake 64
5 4 3 Using the Zero Clamp Function 65
5 4 4 Using the Holding Brake 67
5 5 Forming a Protective Sequence . 5 -71
5 5 1 Using Servo Alarm and Alarm Code Outputs 5 -71
5 5 2 Using the Servo ON Input Signal 5 -73
5 5 3 Using the Positioning Completed Output Signal 5 -74
5 5 4 Speed Coincidence Output 5 -75
5 5 5 Using the Running Output Signal 5 -77
5 5 6 Using the Servo Ready Output Signal 5 -78
5 5 7 Using the Warning Output Signal 5 -79
5 5 8 Using the Near Output Signal 5 -80
5 5 9 Handling Power Loss 5 -82
5 6 Selecting a Regenerative Resistor 5 -83
5 6 1 External Regenerative Resistors 5 -84
5 6 2 Calculating the Required Capacity of Regenerative Resistors 5 -86
5 7 Absolute Encoders 5 -92
5 7 1 Interface Circuit 5 -93
5 7 2 Selecting an Absolute Encoder 5 -94
5 7 3 Handling Batteries 5 -94
5 7 4 Absolute Encoder Setup 5 -95
5 7 5 Absolute Encoder Reception Sequence 5 -97
5 7 6 Multiturn Limit Setting 5 -101
5 8 Special Wiring 5 -105
5 8 1 Wiring Precautions 5 -105
5 8 2 Wiring for Noise Control 5 -109
5 8 3 Using More Than One Servodrive 5 -113
5 8 4 Extending Encoder Cables 5 -114
5 8 5 400-V Power Supply Voltage 5 -116
5 8 6 DC Reactor for Harmonic Suppression 5 -117

■ Before Reading this Chapter

This chapter describes the use of each CN1 connector I/O signals in the SGDM Servopack as well as the procedure for setting the related user constants for the intended purposes

The following sections can be used as references for this chapter

- List of CN1 I/O signals See *3 4 3 I/O Signal Names and Functions*
- CN1 I/O signal terminal layout See *3 4 2 List of CN1 Terminals*
- List of user constants Appendix *Appendix B List of User Constants*
- User constant setting procedure *7 1 6 Operation in User Constant Setting Mode*

The CN1 connector is used to exchange signals with the host controller and external circuits

■ User Constant Configurations

User constants are comprised of the types shown in the following table See *Appendix B List of User Constants*

Type	User Constant No.	Description
Function Selection Constants	**Pn000 to Pn003**	Select basic and application functions such as the type of control or the stop mode used when an alarm occurs
Servo Gain and Other Constants	**Pn100 to Pn118**	Set numerical values such as speed and position loop gains
Position Control Constants	**Pn200 to Pn205**	Set position control parameters such as the reference pulse input form and gear ratio
Speed Control Constants	**Pn300 to Pn308**	Set speed control parameters such as speed reference input gain and soft start deceleration time
Torque Control Constants	**Pn400 to Pn407**	Set torque control parameters such as the torque reference input gain and forward/reverse torque limits
Sequence Constants	**Pn500 to Pn510**	Set output conditions for all sequence signals and changes I/O signal selections and allocations
Others	**Pn600 to Pn601**	Specify the capacity for an external regenerative resistor and reserved constants
Auxiliary Function Execution	**Fn000 to Fn012**	Execute auxiliary functions such as JOG Mode operation
Monitor Modes	**Un000 to Un00D**	Enable speed and torque reference monitoring, as well as monitoring to check whether I/O signals are ON or OFF





5.1 Settings According to Device Characteristics

This section describes the procedure for setting user constants according to the dimensions and performance of the equipment used

5.1.1 Switching Servomotor Rotation Direction

The Servopack has a Reverse Rotation Mode that reverses the direction of Servomotor rotation without rewiring Forward rotation in the standard setting is defined as counterclockwise as viewed from the load

With the Reverse Rotation Mode, the direction of Servomotor rotation can be reversed without changing other items The direction (+, –) of shaft motion is reversed

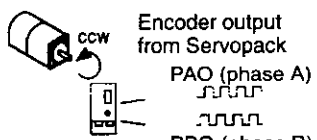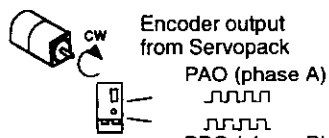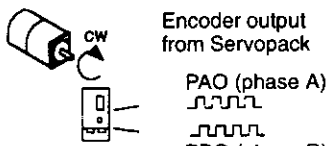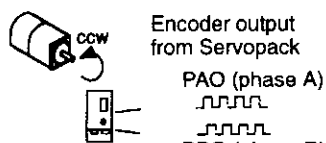	Standard Setting	Reverse Rotation Mode
Forward Reference		
Reverse Reference		


■ Setting Reverse Rotation Mode

Use user constant Pn000 0

Pn000.0	Direction Selection	Factory Setting: 0	Speed/Torque Control, Position Control

Use the following settings to select the direction of Servomotor rotation

Setting	Description	
0	Forward rotation is defined as counterclockwise (CCW) rotation as viewed from the load	(Standard setting)
1	Forward rotation is defined as clockwise (CW) rotation as viewed from the load	(Reverse Rotation Mode)



5.1.2 Setting the Overtravel Limit Function


The overtravel limit function forces movable equipment parts to stop if they exceed the allowable range of motion

■ Using the Overtravel Function

To use the overtravel function, connect the overtravel limit switch input signal terminals shown below to the correct pins of the Servopack CN1 connector

→ Input P-OT CN1-42	**Forward Run Prohibited (Forward Overtravel)**	**Speed/Torque Control, Position Control**
→ Input N-OT CN1-43	**Reverse Run Prohibited (Reverse Overtravel)**	**Speed/Torque Control, Position Control**

Connect limit switches as shown below to prevent damage to the devices during linear motion

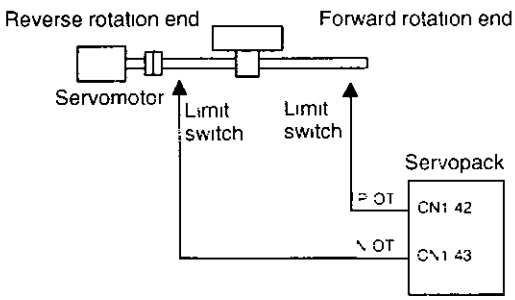

Drive status with an input signal ON or OFF is shown in the following table

P-OT	CN1-42 at low level when ON	Forward rotation allowed (Normal operation status)
	CN1-42 at high level when OFF	Forward run prohibited (reverse rotation allowed)
N-OT	CN1-43 at low level when ON	Reverse rotation allowed (Normal operation status)
	CN1-43 at high level when OFF	Reverse run prohibited (forward rotation allowed)


IMPORTANT

Lag pulses are maintained if the overtravel function stops the motor at position control. A clear signal is required to clear lag pulses.

■ Enabling/Disabling Input Signals

Set the following user constants to specify whether input signals are used for overtravel or not The factory setting is "used "

Pn50A 3	**P-OT Signal Mapping (Forward Run Prohibit Input Signal)**	**Factory Setting: 2**	**Speed/Torque Control, Position Control**
Pn50B 0	**N-OT Signal Mapping (Reverse Run Prohibit Input Signal)**	**Factory Setting 3**	**Speed/Torque Control, Position Control**



The short-circuit wiring shown in the figure can be omitted when P-OT and N-OT are not used

User Constant	Setting	Item
Pn50A 3	2 (Factory setting)	Uses the P-OT input signal for prohibiting forward rotation (Forward rotation is prohibited when CN1-42 is open and is allowed when CN1-42 is at 0 V)
	8	Does not use the P-OT input signal for prohibiting forward rotation (Forward rotation is always allowed and has the same effect as shorting CN1-42 to 0 V)
Pn50B 0	3 (Factory setting)	Uses the N-OT input signal for prohibiting reverse rotation (Reverse rotation is prohibited when CN1-43 is open and is allowed when CN1-43 is at 0 V)
	8	Does not use the N-OT input signal for prohibiting reverse rotation (Reverse rotation is always allowed and has the same effect as shorting CN1-43 to 0 V)


■ Servomotor Stop Mode for P-OT and N-OT Input Signals

Set the following user constants to specify the Servomotor Stop Mode when P-OT and N-OT input signals are used

Specify the Servomotor Stop Mode when either of the following signals is input during Servomotor operation

- Forward run prohibited input (P-OT,CN1-42)
- Reverse run prohibited input (N-OT,CN1-43)

Pn001 1	Overtravel Stop Mode	Factory Setting: 0	Speed/Torque Control, Position Control

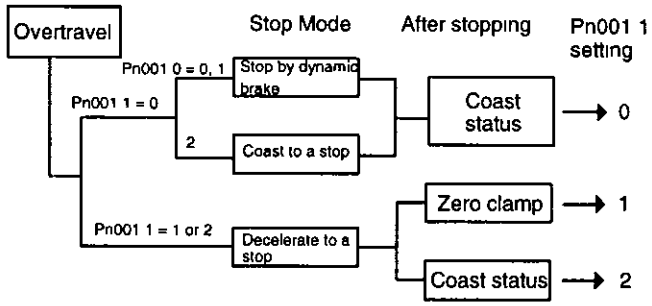


INFO For torque control, the servomotor will be placed in coast status after either decelerating or coasting to a stop (according to the stop mode set in Pn001 0), regardless of the setting of Pn001 1

User Constant	Setting	Item
Pn001.1	0	Stops the Servomotor the same way as turning the servo OFF (according to Pn001 0)
	1	Decelerates the Servomotor to a stop at the preset torque, and then locks the Servomotor in Zero Clamp Mode Torque setting Pn406 emergency stop torque
	2	Decelerates the Servomotor to a stop at the preset torque, and puts the Servomotor in coast status Torque setting Pn406 emergency stop torque

Pn406 specifies the stop torque applied for overtravel when the input signal for prohibiting forward or reverse rotation is used

The torque limit is specified as a percentage of rated torque

Pn406	Emergency Stop Torque	Unit: %	Setting Range 0 to Max. Torque	Factory Setting 800	Valid when Pn001.1 is 1 or 2

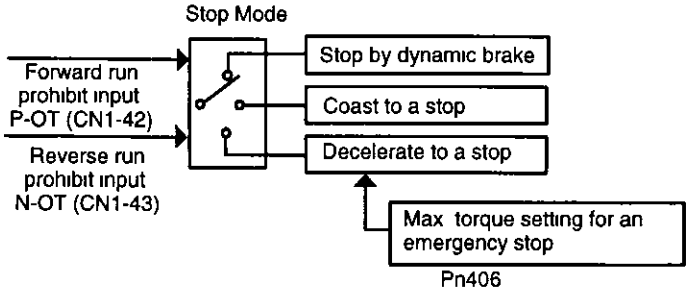


■ Servo OFF Stop Mode Selection

The SGDM Servopack turns OFF under the following conditions

- Servo ON input signal (/S-ON, CN1-40) is turned OFF
- Servo alarm occurs
- Power is turned OFF

Specify the Stop Mode if any of these occurs during operation

Pn001 0	Servo OFF or Alarm Stop Mode	Factory Setting: 0	–

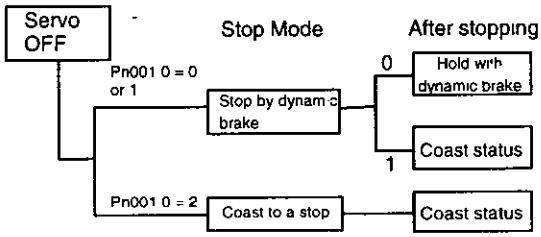

The dynamic brake electrically applies a brake by using a resistor to consume Servomotor rotation energy

See *5 4 2 Using the Dynamic Brake*

User Constant	Setting	Item
Pn001 0	0 (Factory setting)	Uses the dynamic brake to stop the Servomotor, and maintains dynamic brake status after stopping
	1	Uses the dynamic brake to stop the Servomotor, and cancels dynamic brake status after stopping to go into coast status
	2	Coasts the Servomotor to a stop The Servomotor is turned OFF and stops due to equipment friction

Note If the Servomotor is stopped or rotating at extremely low speed when the items above are set at 0 (dynamic brake status after stopping with the dynamic brake), then braking power is not generated and the Servomotor will stop the same as in coast status

5.1.3 Limiting Torques

The SGDM Servopack limits torques as follows

- Level 1 Limits maximum output torque to protect the equipment or workpiece
- Level 2 Limits torque after the Servomotor moves the equipment to a specified position (internal torque limit)
- Level 3 Always limits output torque rather than speed
- Level 4 Switches between speed and torque limit

Application of levels 1 and 2 in the torque limit function are described below

■ Setting Level 1: Internal Torque Limits

Maximum torque is limited to the values set in the following user constants

Pn402	**Forward Torque Limit**	**Unit:** **%**	**Setting Range:** **0 to 800**	**Factory Setting:** **800**	**Speed/Torque Control, Position Control**
Pn403	**Reverse Torque Limit**	**Unit** **%**	**Setting Range:** **0 to 800**	**Factory Setting:** **800**	**Speed/Torque Control, Position Control**

This user constant sets the maximum torque limits for forward and reverse rotation

Use this user constant when torque must be limited due to equipment conditions

The torque limit function always monitors torque and outputs the signals below when the limit is reached


The following signals are output by the torque limit function

• /CLT • Monitor Mode (Un006)
Condition that outputs a /CLT signal Pn50F 0 allocates an output terminal from SO1 to SO3

The torque limits are specified as a percentage of the rated torque

INFO If torque limit is set higher than the maximum torque of the Servomotor, the maximum torque of the Servomotor is the limit


Application Example Equipment Protection



Too small a torque limit will result in a insufficient torque during acceleration and deceleration

Using /CLT Signal

The following section describes the use of the contact output signal /CLT as a torque limit output signal

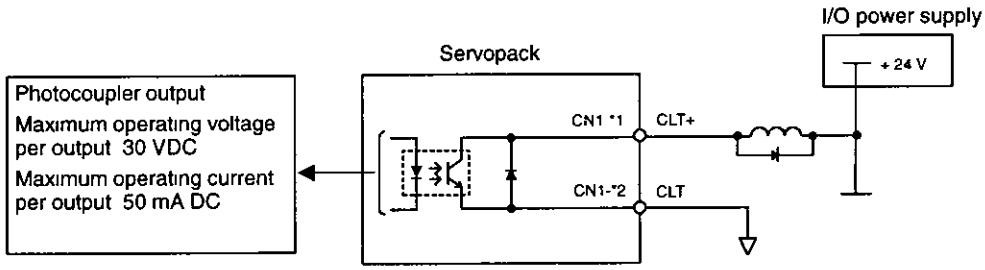

Output → /CLT CN1-*1	Torque Limit Output	Speed/Torque Control, Position Control

This signal indicates whether Servomotor output torque (current) is being limited

ON Status	The circuit between CN1-*1 and *2 is closed CN1-*1 is at low level	Servomotor output torque is being limited (Internal torque reference is greater than the limit setting)
OFF Status	The circuit between CN1-*1 and *2 is closed CN1-*1 is at low level	Servomotor output torque is not being limited (Internal torque reference is less than the limit setting)

Settings Pn402 (Forward Torque Limit)


Pn403 (Reverse Torque Limit)

Pn404 (Forward External Torque Limit) /P-CL input only

Pn405 (Reverse External Torque Limit) /N-CL input only

When the /CLT signal is used, the following user constant must be used to select the output signal

Pn50F	Output Signal Selections 2	Factory Setting 0000	Speed/Torque Control, Position Control

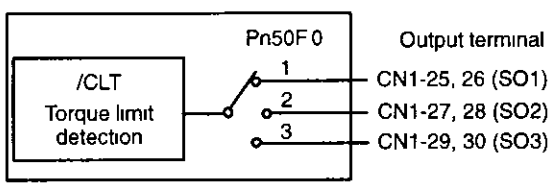


Use the following table to select which terminal will output the /CLT signal

User Constant	Setting	Output Terminal (CN1-)	
		*1	*2
Pn50F.0	0	–	–
	1	25	26
	2	27	28
	3	29	30

Note Multiple signals allocated to the same output circuit are output using OR logic Set other output signals to a value other than that allocated to the /CLT signal in order to use just the /CLT output signal See 5 3 4 *Output Circuit Signal Allocation*

■ Setting Level 2: External Torque Limit

A contact input signal is used to enable the torque (current) limits previously set in user constants Torque limits can be set separately for forward and reverse rotation

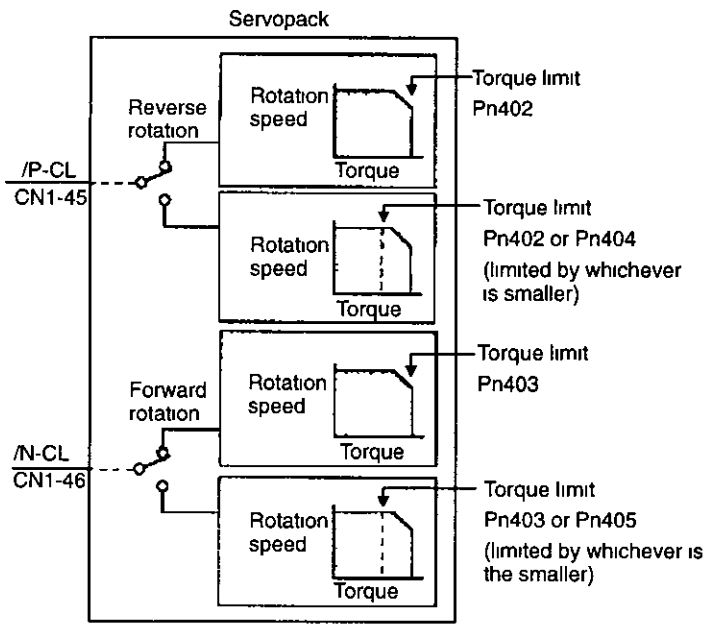

→ Input /P-CL CN1-45	**Forward External Torque Limit Input**	**Speed/Torque Control, Position Control**
→ Output /N-CL CN1-46	**Reverse External Torque Limit Input**	**Speed/Torque Control, Position Control**

This is the external torque (current) limit input for forward and reverse rotation

Check input signal allocation status when using this function (See *5 3 3 Input Circuit Signal Allocation*) Factory settings are given in the following table

/P-CL	CN1-45 at low level when ON	Use forward torque limit	Limit Pn404
	CN1-45 at high level when OFF	Do not use forward torque limit Normal operation	–
/N-CL	CN1-46 at low level when ON	Use reverse torque limit	Limit Pn405
	CN1-46 at high level when OFF	Do not use reverse torque limit Normal operation	–

efesotomasyon.com

The following output signals and monitor methods are used when torque is being limited

• /CLT • Monitor Mode • Un005 Nos 6 and 7 (With factory settings) (Refer to *7 1 7 Operation in Monitor Mode*) • Un006 Depending on output signal allocation conditions
Condition that outputs a /CLT signal Pn50F 0 is allocated to an output terminal from SO1 to SO3

Application Examples

- Forced stop
- Robot holding a workpiece

Pn404	**Forward External Torque Limit**	**Unit** %	**Setting Range:** 0 to 800	**Factory Setting:** 100	**Speed/Torque Control, Position Control**
Pn405	**Reverse External Torque Limit**	**Unit:** %	**Setting Range.** 0 to 800	**Factory Setting.** 100	**Speed/Torque Control, Position Control**


Set the torque limits when the torque is limited by an external contact input

/P-CL (CN1-45) Input	Pn404 torque limit applied
/N-CL (CN1-46) Input	Pn405 torque limit applied

See *5 2 10 Using Torque Limiting by Analog Voltage Reference*

Using /P-CL and /N-CL Signals

The procedure for using /P-CL and /N-CL as torque limit input signals is illustrated below

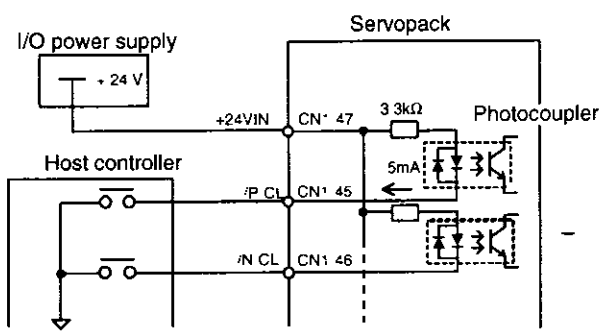


5.1.4 Limiting Speed

The SGDM Servopack limits speed when performing a torque control

Using /VLT Signal

The following section describes the use of the contact output signal /VLT as a speed limit output signal

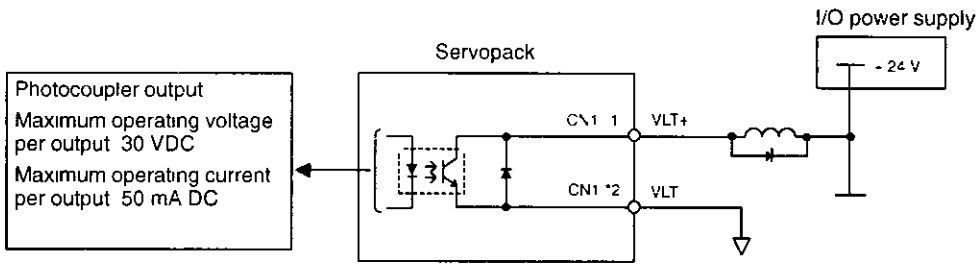

Output → /VLT CN1-*1	Speed Limit Output	Torque Control


This signal indicates whether Servomotor speed is being limited

ON Status	The circuit between CN1-*1 and *2 is closed CN1-*1 is at low level	Servomotor speed is being limited
OFF Status	The circuit between CN1-*1 and *2 is closed CN1-*1 is at low level	Servomotor speed is not being limited

Settings Pn407 (Speed Limit)

When the /VLT signal is used the following user constant must be used to select the output signal

Pn50F	Output Signal Selections 2	Factory Setting	Torque Control
		0000	

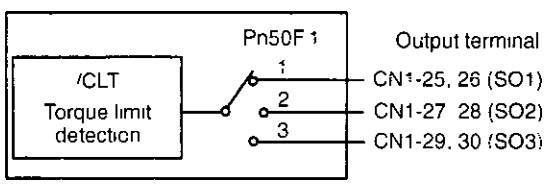

Use the following table to select which terminal will output the /VLT signal

User Constant	Setting	Output Terminal (CN1-)	
		*1	*2
Pn50F 1	0	–	–
	1	25	26
	2	27	28
	3	29	30


Note Multiple signals allocated to the same output circuit are output using OR logic. Set other output signals to a value other than that allocated to the /VLT signal in order to use just the /VLT output signal. See 5 3 4 *Output Circuit Signal Allocation*.

5.2 Settings According to Host Controller

This section describes the procedure for connecting a Σ-II Series Servo to a host controller, including the procedure for setting related user constants.

5.2.1 Speed Reference

Input the speed reference using the following input signal speed reference input. Since this signal has various uses, set the optimum reference input for the system created.

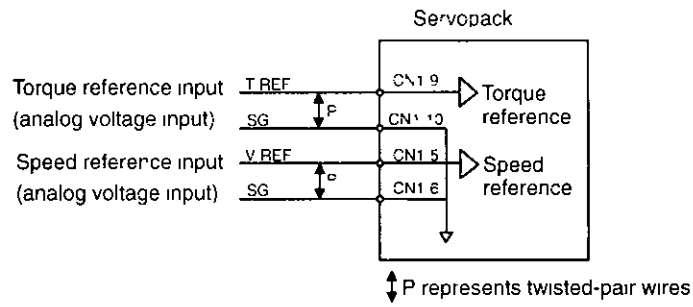


→Input V-REF CN1-5	Speed Reference Input	Speed Control
→Input SG CN1-6	Signal Ground	Speed Control

The above inputs are used for speed control (analog reference) (Pn000.1 = 0, 4, 7, 9, or A).

Always wire for normal speed control.

The motor speed is controlled in proportion to the input voltage between V-REF and SG.

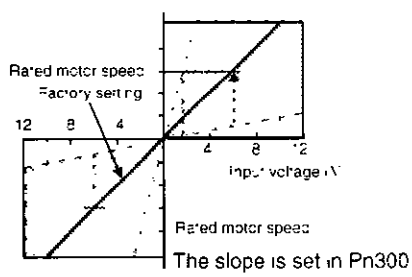

■ Setting Examples


Pn300 = 600. This setting means that 6 V is equivalent to the rated motor speed.

◀EXAMPLE▶

Speed Reference Input	Rotation Direction	Motor Speed	SGMAH Servomotor
+6 V	Forward rotation	Rated motor speed	3000 r/min
+1 V	Forward rotation	(1/6) rated motor speed	500 r/min
-3 V	Reverse rotation	(1/2) rated motor speed	1500 r/min

User constant Pn300 can be used to change the voltage input range.


■ Input Circuit Example

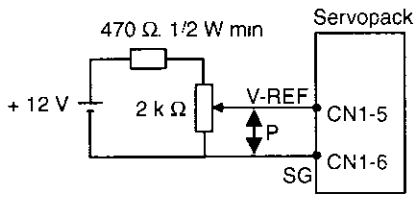

- Always use twisted-pair cable for noise control

  Recommended variable resistor Model 25HP-10B manufactured by Sakae Tsushin Kogyo Co . Ltd

Connect V-REF and SG to the speed reference output terminals on the host controller when using a host controller such as a programmable controller, for position control

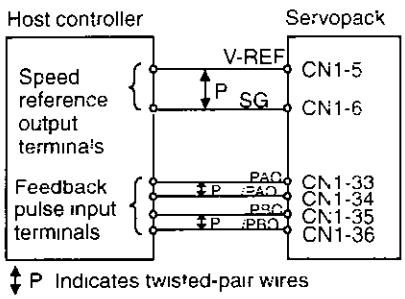


Adjust Pn300 according to output voltage specifications

Adjust the speed reference input gain at the following user constant

Pn300	Speed Reference Input Gain	Unit	Setting Range	Speed Control
		0 01V/rated motor speed	150 to 3000	

Set the voltage range for the speed reference input V-REF at CN1-5 according to host controller and external circuit output form

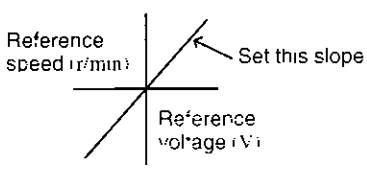

The factory setting is adjusted so that a 6-V input is equivalent to the rated motor speed of all applicable Servomotors

INFO The maximum allowable voltage to the speed reference input (between CN1-5 and 6) is ± 12 VDC

Using the /P-CON Signal

→ Input /P-CON CN1-41	Proportional Control Reference	Speed Control, Position Control


The /P-CON input signal switches the Speed Control Mode from PI (proportional-integral) to P (proportional) control in order to reduce Servomotor rotation and minute vibrations due to speed reference input drift The use of this signal will vary with applications because Servomotor rigidity (holding force) drops when the Servomotor is stopped

5.2.2 Position Reference

The reference pulse reference code, and clear inputs are used for the position reference Since this signal can be used in different ways, set the optimum reference input for the system created

■ Reference by Pulse Input

Positioning is controlled by inputting a move reference pulse

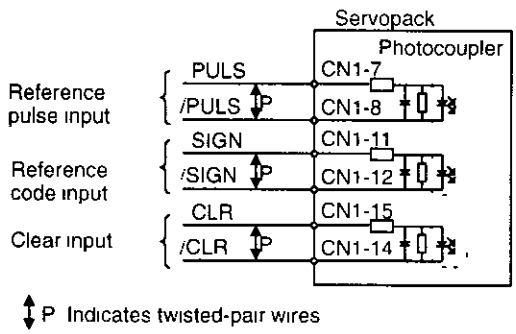


Any of the following forms can be used for the position reference

- Line-driver output
- +12-V open-collector output
- +5-V open-collector output


Connection Example 1: Line-driver Output

Applicable line driver SN75174 manufactured by Texas Instruments Inc , MC3487 or equivalent

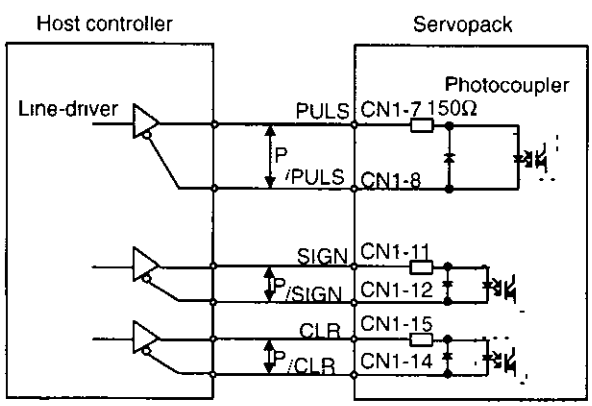

Connection Example 2: Open-collector Output

Set limiting resistor R1 so that input current, I, falls within the following range

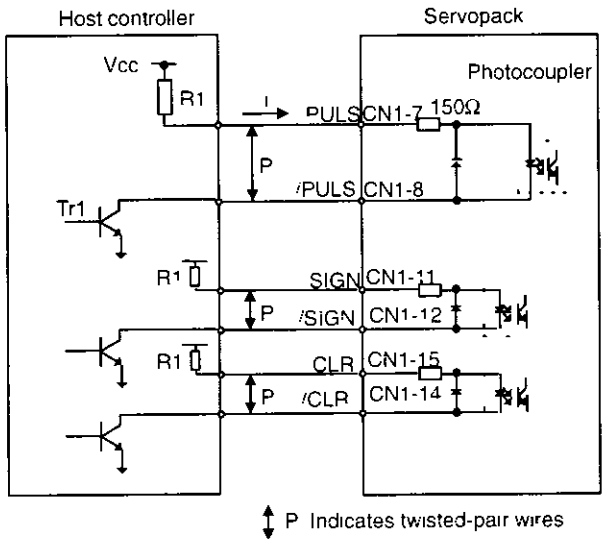

Input current I: 7 to 15 mA


◀EXAMPLE▶

- With a Vcc of +12 V, R1 = 1 kΩ
- When Vcc is +5 V, R1 = 180 Ω

Note The following table shows the signal logic for an open-collector output

When Tr1 is ON	Equivalent to high-level input
When Tr1 is OFF	Equivalent to low-level input

This circuit uses the 12-V power supply built into the Servopack. Input is not insulated in this case when the Servopack is 0 V.

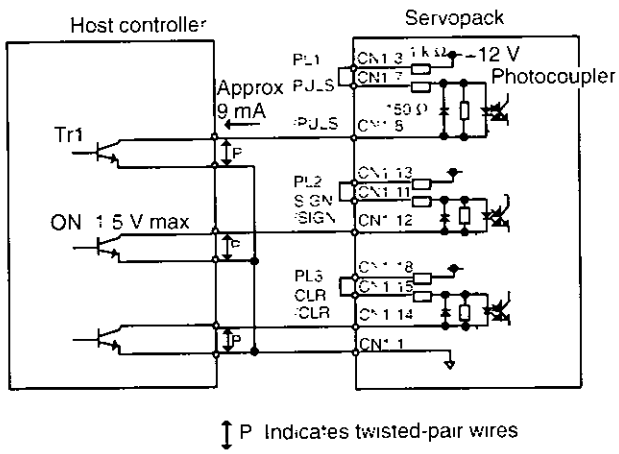

IMPORTANT The noise margin of the input signal will decrease if the reference pulse is given using an open-collector output. Set user constant Pn200.3 to 1 if the position drifts due to noise.

■ Selecting a Reference Pulse Form


Use the following user constants to select the reference pulse form used

→ Input PULS CN1-7	Reference Pulse Input	Position Control
→ Input /PULS CN1-8	Reference Pulse Input	Position Control
→ Input SIGN CN1-11	Reference Code Input	Position Control
→ Input /SIGN CN1-12	Reference Code Input	Position Control

The Servomotor only rotates at an angle proportional to the input pulse

Pn200 0	Reference Pulse Form	Factory Setting	Position Control
		0	


Set reference pulse form input to the Servopack from the host controller

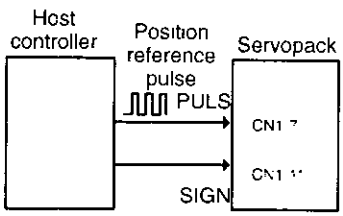

Since the reference pulse form can be selected from among those listed below, set one according to host controller specifications


User Constant Pn200 0	Reference Pulse Form	Input Pulse Multiplier	Logic	Forward Rotation Reference	Reverse Rotation Reference
0	Sign + pulse train	–	Positive logic	PULS (CN1-7) / SIGN (CN1-11) High	PULS (CN1-7) / SIGN (CN1-11) Low
1	CW pulse + CCW pulse	–		PULS (CN1-7) Low / SIGN (CN1-11)	PULS (CN1-7) / SIGN (CN1-11) Low
2	Two-phase pulse train with 90° phase differential	×1		90° PULS (CN1-7) / SIGN (CN1-11)	90° PULS (CN1-7) / SIGN (CN1-11)
3		×2			
4		×4			
5	Sign + pulse train	–	Negative logic	PULS (CN1-7) / SIGN (CN1-11) Low	PULS (CN1-7) / SIGN (CN1-11) High
6	CW pulse + CCW pulse	–		PULS (CN1-7) High / SIGN (CN1-11)	PULS (CN1-7) / SIGN (CN1-11) High
7	Two-phase pulse train with 90° phase differential	×1		90° PULS (CN1-7) / SIGN (CN1-11)	90° PULS (CN1-7) / SIGN (CN1-11)
8		×2			
9		×4			

Input Pulse Multiplier

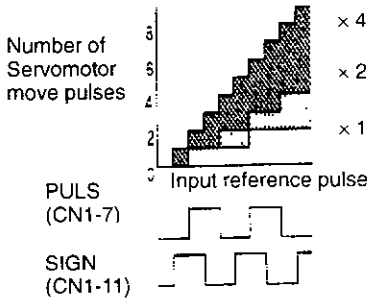

The input pulse multiplier function can be used if the reference form is a two-phase pulse train with a 90° phase differential. The electronic gear function can also be used to convert input pulses.




Example of I/O Signal Generation Timing

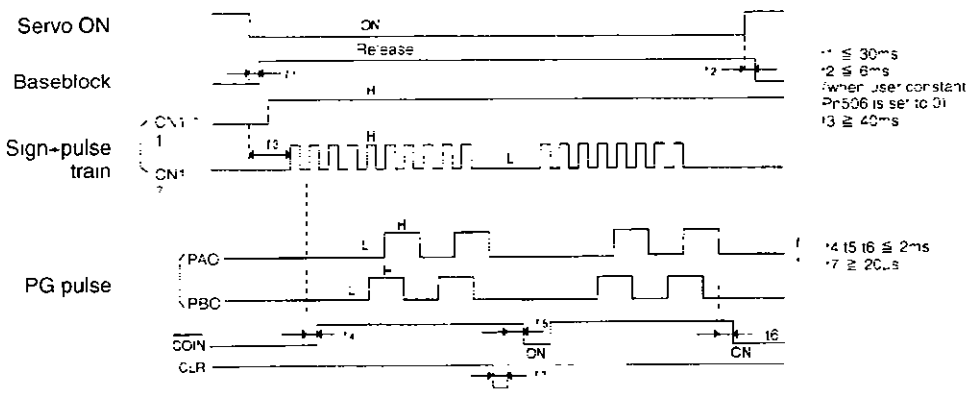

Note 1 The interval from the time the servo ON signal is turned ON until a reference pulse is input must be at least 40 ms. Otherwise the reference pulse may not be input.

2 The error counter clear signal must be ON for at least 20 μs.

Reference Pulse Input Signal Timing

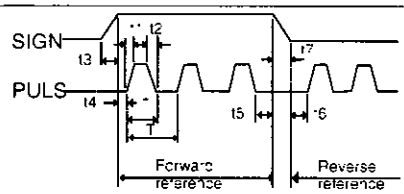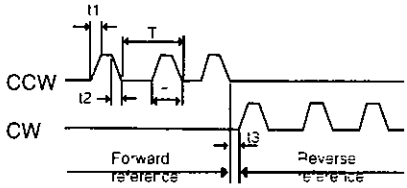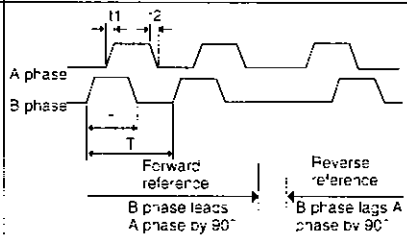
Reference Pulse Form	Electrical Specifications		Remarks
Sign + pulse train input (SIGN + PULS signal) Maximum reference frequency 500 kpps (200-kpps open-collector output)		t1, t2 ≦ 0.1 µs t3, t7 ≦ 0.1 µs t4, t5, t6 > 3 µs τ ≧ 1.0 µs (τ/T) × 100 ≦ 50 %	Sign (SIGN) H = Forward reference L = Reverse reference
CW pulse and CCW pulse Maximum reference frequency 500 kpps (200-kpps open-collector output)		t1, t2 ≦ 0.1 µs t3 > 3 µs τ ≧ 1.0 µs (τ/T) × 100 ≦ 50 %	–
Two-phase pulse train with 90° phase differential (A phase + B phase) Maximum reference frequency × 1 500 kpps (200-kpps open-collector output) ×2 400 kpps ×4 200 kpps		t1, t2 ≦ 0.1 µs τ ≧ 1.0 µs (τ/T) × 100 = 50 %	User constant Pn200 0 is used to switch the input pulse multiplier mode

■ Error Counter Clear Input

The procedure for clearing the error counter is described below

→ Input CLR CN1-15	Clear Input	Position Control
→ Input /CLR CN1-14	Clear Input	Position Control

The following occur when the CLR signal is set to high level






- The error counter inside the Servopack is set to 0
- Position loop control is prohibited

Use this signal to clear the error counter from the host controller or select the following clear operation through user constant Pn200 1


Pn200 1	Error Counter Clear Signal Form	Factory Setting	Position Control
		0	

Select the pulse form for the error counter clear signal CLR (CN1-15)


Pn200 1 Setting	Description	Clear Timing
0	Clears the error counter when the CLR signal goes high Error pulses do not accumulate as long as the signal remains high	
1	Clears the error counter on the rising edge of the CLR signal Clears the error counter only once on the rising edge of the CLR signal	 Cleared only once at this point
2	Clears the error counter when the CLR signal goes low Error pulses do not accumulate as long as the signal remains low	
3	Clears the error counter on the falling edge of the CLR signal Clears the error counter only once on the falling edge of the CLR signal	 Cleared only once at this point

5.2.3 Using the Encoder Signal Output

Encoder output signals divided inside the Servopack can be output externally. These signals can be used to form a position control loop in the host controller.

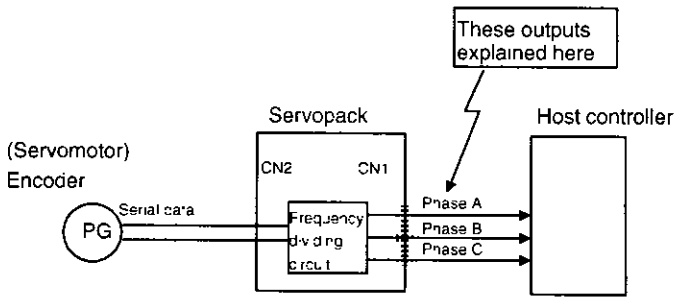

The output circuit is for line-driver output. Connect each signal line according to the following circuit diagram.

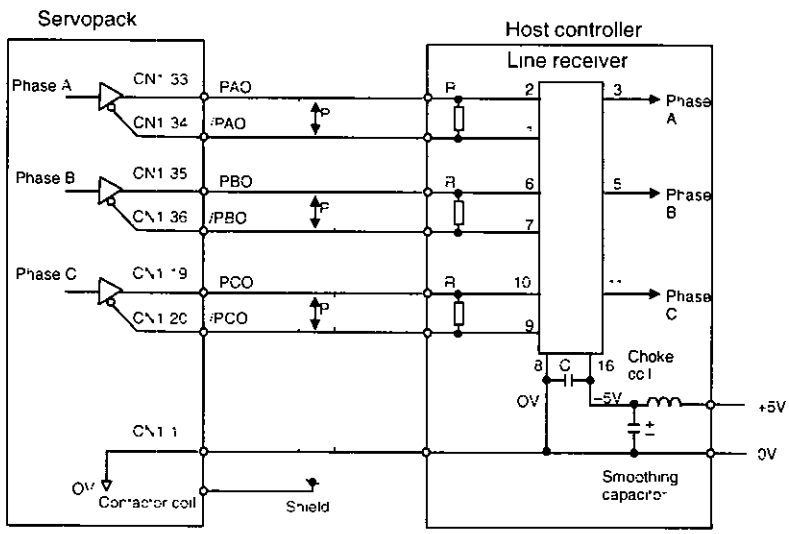

↕P Indicates twisted-pair wires

Applicable line receiver: SN75175 manufactured by Texas Instruments Inc. MC3486 or the equivalent

R (terminator): 220 to 470 Ω
C (decoupling capacitor): 0.1 μF



◆ Dividing

Dividing means converting an input pulse train from the encoder mounted on the Servomotor according to the preset pulse density and outputting the converted pulse. The units are pulses per revolution.

I/O Signals

I/O signals are described below

Output → PAO CN1-33	**Encoder Output Phase A**	**Speed/Torque Control, Position Control**
Output → /PAO CN1-34	**Encoder Output Phase /A**	**Speed/Torque Control, Position Control**
Output → PBO CN1-35	**Encoder Output Phase B**	**Speed/Torque Control, Position Control**
Output → /PBO CN1-36	**Encoder Output Phase /B**	**Speed/Torque Control, Position Control**
Output → PCO CN1-19	**Encoder Output Phase C**	**Speed/Torque Control, Position Control**
Output → /PCO CN1-20	**Encoder Output Phase /C**	**Speed/Torque Control, Position Control**

Divided encoder signals are output


Always connect these signal terminals when a position loop is formed in the host controller for position control

Set a dividing ratio at the following user constant

PG Dividing Ratio	Pn201

The dividing ratio setting is not related to the gear ratio setting (Pn202 and 203) for the Servopack electronic gear function during position control

Output Phase Form

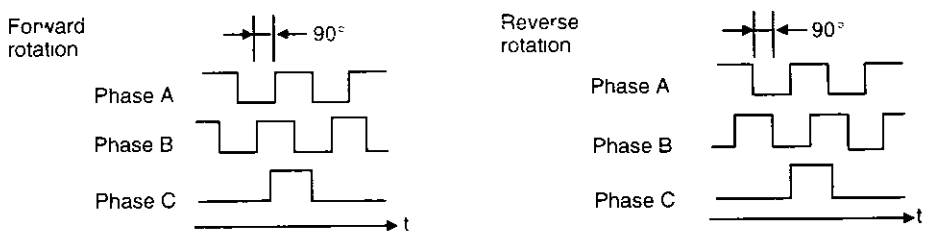

→ Input SEN CN1-4	SEN Signal Input	Speed/Torque Control
→ Input SG CN1-2	Signal Ground	Speed/Torque Control
Output → PSO CN1-48	Encoder Output Phase S	Speed/Torque Control, Position Control
Output → /PSO CN1-49	Encoder Output Phase /S	Speed/Torque Control, Position Control
→ Input BAT (+) CN1-21	Battery (+)	Speed/Torque Control, Position Control
→ Input BAT (–) CN1-22	Battery (–)	Speed/Torque Control, Position Control

Use SEN to BAT (–) signals for absolute encoders. See *5.7 Absolute Encoder* for more details.

Output → SG CN1-1	Single Ground	Speed/Torque Control, Position Control

SG: Connect to 0 V on the host controller.

5

IMPORTANT


When using the Servopack phase C pulse signal to return to the machine origin, always turn the Servomotor at least twice before starting the origin return operation. If the configuration of the mechanical system prevents turning the Servomotor before the origin return operation, then perform the origin return operation at a Servomotor speed of 600 r/min or below. The phase C pulse signal may not be correctly output if the Servomotor is turned faster than 600 r/min.

■ Pulse Divider Setting

Set the pulse dividing ratio in the following user constant.

Pn201 PG Divider	**Unit** P/R	**Setting Range:** 16 to 16384	**Factory Setting** 16384	**Speed/Torque Control, Position Control**

Set the number of pulses for PG output signals (PAO, /PAO, PBO, /PBO) externally output.

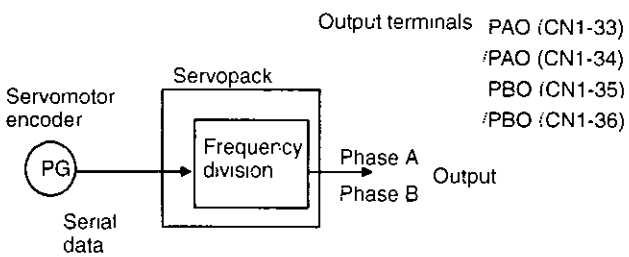


Pulses from the Servomotor encoder (PG) are divided by the preset number of pulses before being output.

The number of output pulses per revolution is set at this user constant Set the value using the reference units of the equipment or the controller used

The setting range varies with the encoder used

Setting Example

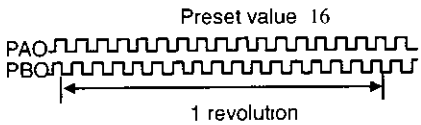

Servomotor Model and Encoder Specifications	Resolution (Bits)	Number of Encoder Pulses Per Revolution (P/R)	Setting Range
A	13	2048 P/R	16 to 2048
B 1	16	16384 P/R	16 to 16384
C 2	17	32768 P/R	

INFO


1. Turn OFF power once and turn ON again after changing the user constant
2. A 13-bit encoder will run at 2048 P/R even if the setting at Pn201 is set higher than 2049

5.2.4 Sequence I/O Signals

Sequence I/O signals are used to control Servopack operation Connect these signal terminals as required

■ Input Signal Connections

Connect the sequence input signals as shown below

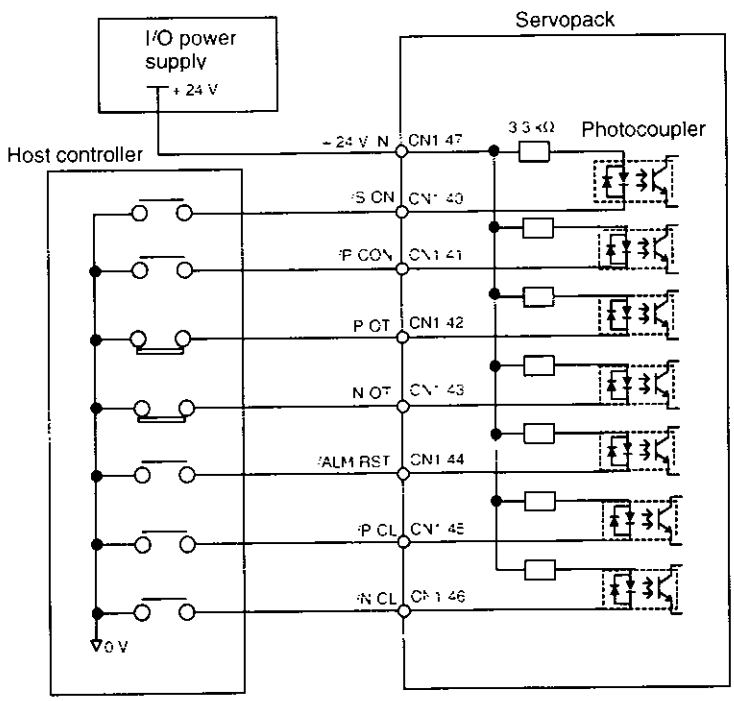

IMPORTANT

Provide an external input power supply the Servopack does not have an internal 24-V power supply

- External power supply specifications 24 ±1 VDC, 50 mA min


Yaskawa recommends using the same external power supply as that used for output circuits The allowable voltage range for the 24-V sequence input circuit power supply is 11 to 25 V Although a 12-V power supply can be used contact faults can easily occur for relays and other mechanical contacts under low currents Confirm the characteristics of relays and other mechanical contacts before using a 12-V power supply

The function allocation for sequence input signal circuits can be changed

See *5 3 3 Input Circuit Signal Allocation* for more details

→ Input +24VIN CN1-47	**External I/O Power Supply Input**	**Speed/Torque Control, Position Control**

The external power supply input terminal is common to sequence input signals

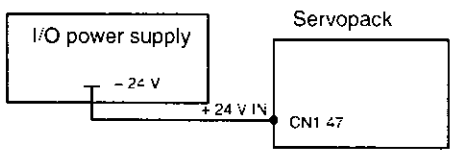


Connect an external I/O power supply

Contact input signals /S-ON (CN1-40)
/P-CON (CN1-41)
P-OT (CN1-42)
N-OT (CN1-43)
/ALM-RST (CN1-44)
/P-CL (CN1-45)
/N-CL (CN1-46)

■ Output Signal Connections

Connect the sequence output signals as shown in the following figure

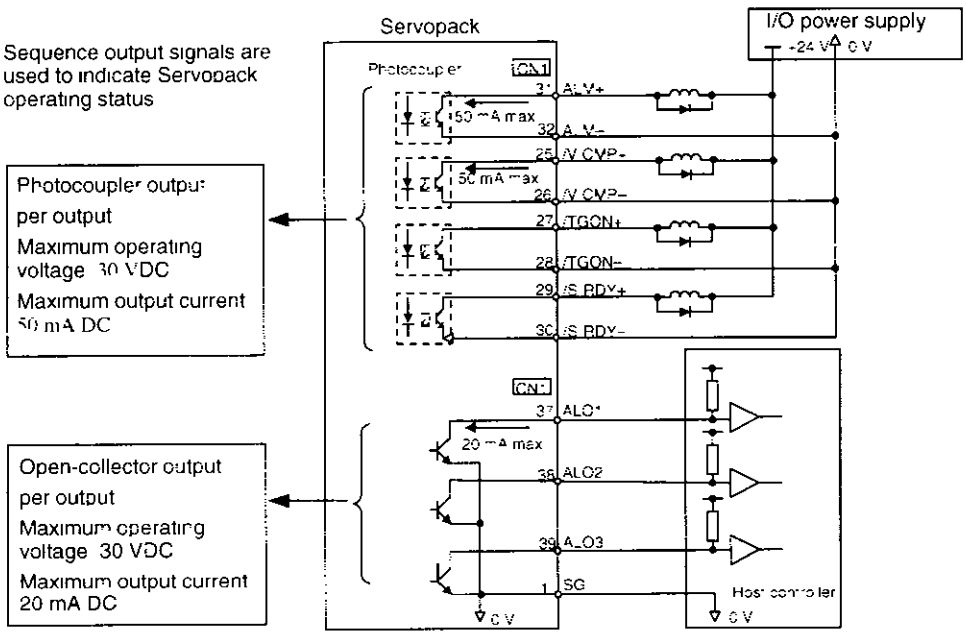

IMPORTANT Provide a separate external I/O power supply. The Servopack does not have an internal 24-V power supply. Yaskawa recommends using the same type of external power supply as that used for input circuits.


Function allocation for some sequence output signal circuits can be changed.

See *5.3.4 Output Circuit Signal Allocation* for more details.

5.2.5 Using the Electronic Gear Function

The electronic gear function enables the Servomotor travel distance per input reference pulse to be set to any value. It allows the host controller generating pulses to be used for control without having to consider the equipment gear ratio or the number of encoder pulses.


When the Electronic Gear Function is Not Used



To move a workpiece 10 mm (0.39 in)

1 revolution is 6 mm. Therefore
10 — 6 = 1.6666 revolutions
2048 × 4 pulses is 1 revolution. Therefore,
1.6666 × 2048 × 4 = 13653 pulses
13563 pulses are input as references.
The equation must be calculated at the host controller.

When the Electronic Gear Function is Used

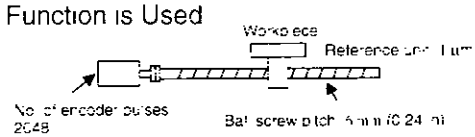

Equipment conditions and reference units must be defined for the electronic gear function beforehand.

To move a workpiece 10 mm (0.39 in)
Reference unit is 1 um. Therefore

$$\frac{10\ \text{mm}}{1\ \text{um}} = 10000\ \text{pulses}$$


■ Setting the Electronic Gear

Calculate the electronic gear ratio (B/A) using the following procedure, and set the values in user constants Pn202 and 203

1. Check equipment specifications

   Items related to the electronic gear

   - Deceleration ratio
   - Ball screw pitch
   - Pulley diameter

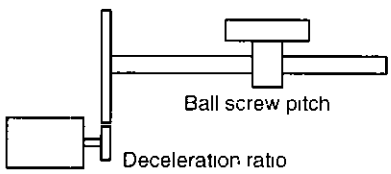

2. Check the number of encoder pulses for the SGM□H Servomotor

Servomotor Model and Encoder Specifications	Encoder Type	Number of Encoder Pulses Per Revolution (P/R)	
A	Incremental encoder	13-bit	2048
B		16-bit	16384
C		17-bit	32768
1	Absolute encoder	16-bit	16384
2		17-bit	32768


INFO

The number of bits representing the resolution of the applicable encoder is not the same as the number of encoder signal pulses (A and B phase) output from the Servopack

3 Determine the reference unit used

A reference unit is the minimum position data unit used to move a load (Minimum unit of reference from the host controller)

To move a table in 0.001 mm units

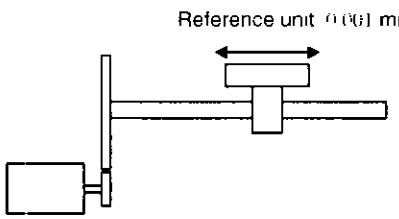

Determine the reference unit according to equipment specifications and positioning accuracy

◀EXAMPLE▶

- 0.01 mm (0.0004 in), 0.001 mm, 0.1°, 0.01 inch
  A reference unit of one pulse moves the load by one reference unit
- When the reference unit is 1 μm
  If a reference of 50000 units is input, the load moves 50 mm (1.97 in) (50000 x 1μm)




4 Determine the load travel distance per load shaft revolution in reference units

$$\text{Travel distance per load shaft revolution (reference unit)} = \frac{\text{Travel distance per load shaft revolution}}{\text{Reference unit}}$$

◀EXAMPLE▶

- When the ball screw pitch is 5 mm (0.20 in) and the reference unit is 0.001 mm

$$\frac{5}{0.001} = 5000 \text{ (reference figure unit)}$$

Ball Screw	Disc Table	Belt and Pulley
		
1figurerevolution = $\frac{P}{\text{referencefigu}}$	1figurerevo ution = $\frac{360^{\circ}}{\text{reference unit}}$	1 revolution = $\frac{\pi D}{\text{reference unit}}$

5 Electronic gear ratio is given as $\left(\frac{B}{A}\right)$

If the decelerator ratio of the motor and the load shaft is given as $\frac{n}{m}$
where m is the rotation of the motor and n is the rotation of the load shaft.

$$\text{Electronic gear ratio } \left(\frac{B}{A}\right) = \frac{\text{No. of encoder pulses} \times 4}{\text{Travel distance per load shaft revolution (reference unit)}} \times \frac{m}{n}$$

5

IMPORTANT

Make sure the electronic gear ratio satisfies the following condition

$$0.01 \leqq \text{Electronic gear ratiohairline}\left(\frac{B}{A}\right) \leqq 100$$

The Servopack will not work properly if the electronic gear ratio is outside this range. In this case, modify the load configuration or reference unit.

6. Set the user constants

Reduce the electronic gear ratio $\left(\frac{B}{A}\right)$ to the lower terms so that both A and B are integers smaller than 65535, then set A and B in the respective user constants.


$\left(\frac{B}{A}\right)$

Pn202	Electronic Gear Ratio (Numerator)
Pn203	Electronic Gear Ratio (Denominator)

That is all that is required to set the electronic gear ratio.

Pn202	**Electronic Gear Ratio (Numerator)**	**Unit** None	**Setting Range** 1 to 65535	**Factory Setting** 4	**Position Control**
Pn203	**Electronic Gear Ratio (Denominator)**	**Unit** None	**Setting Range** 1 to 65535	**Factory Setting** 1	**Position Control**

Set the electronic gear ratio according to equipment specifications.

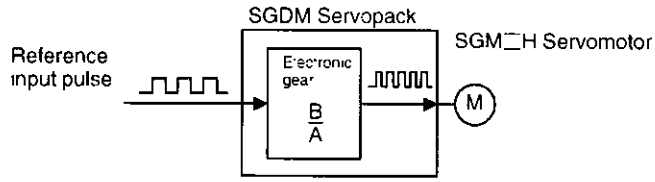


$$\text{Electronic gear ratio} \left(\frac{B}{A}\right) = \frac{Pn202}{Pn203}$$

- B = [(Number of encoder pulses) × 4] × [motor speed]
- A = [Reference units (travel distance per load shaft revolution)] × [load shaft revolution speed]

■ Electronic Gear Setting Examples

The following examples show electronic gear settings for different load mechanisms

Ball Screws

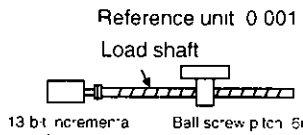


$$\text{Travel distance per load shaft revolution} = \frac{6\text{mm}}{0.001\text{mm}} = 6000$$

$$\text{Electronic gear ratio} \left(\frac{B}{A}\right) = \frac{2048 \times 4 \times 1}{6000 \times 1} = \frac{Pn202}{Pn203}$$

Preset Values	Pn202	8192
	Pn203	6000

Circular Tables

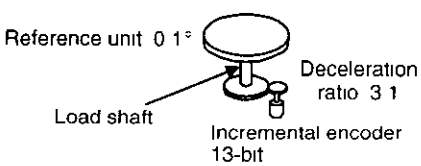


$$\text{Travel distance per load shaft revolution} = \frac{360^\circ}{0.1^\circ} =$$

$$\text{Electonic gear ratio} \left(\frac{B}{A}\right) = \frac{2048 \times 4 \times 3}{3600 \times 1} = \frac{Pn202}{Pn203}$$

Preset Values	Pn202	24576
	Pn203	3600

Belts and Pulleys

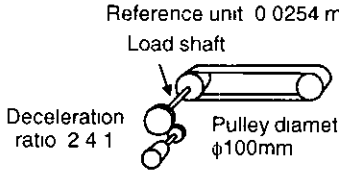

Set a PG dividing ratio equivalent to 1024 P/R for the absolute encoder

$$\text{Travel distance per load shaft revolution} = \frac{3.14 \times 100}{0.0254}$$


$$\text{Electronic gear ratio} \left(\frac{B}{A}\right) = \frac{1024 \times 4}{12362 \times}$$

$$= \frac{9830.4}{12362} = \frac{49152}{61810}$$

Preset Values	Pn202	49152
	Pn203	61810


■ Control Block Diagram

The following diagram illustrates a control block for position control

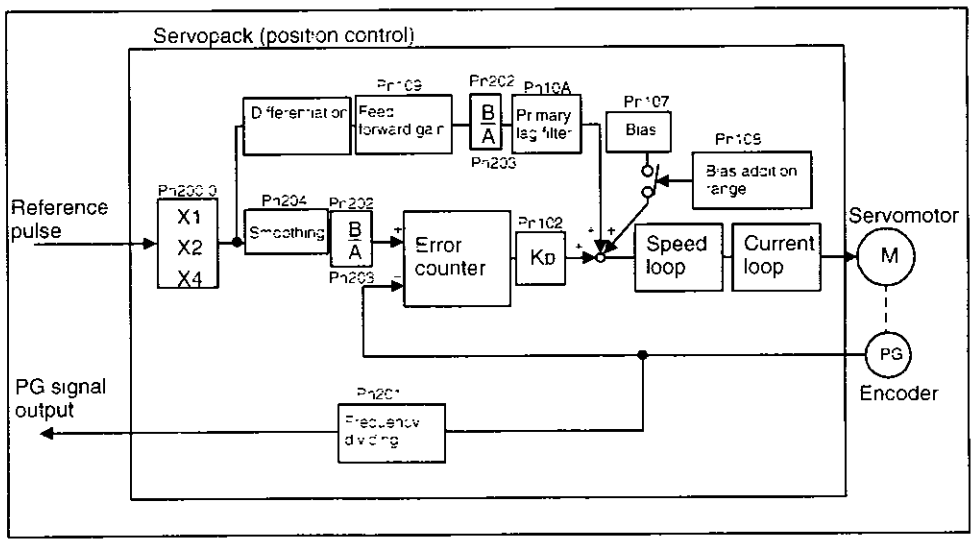

5.2.6 Contact Input Speed Control

The contact input speed control function provides easy-to-use speed control. It allows the user to initially set three different motor speeds with user constants, select one of the speeds externally by contact input, and operate the Servomotor.

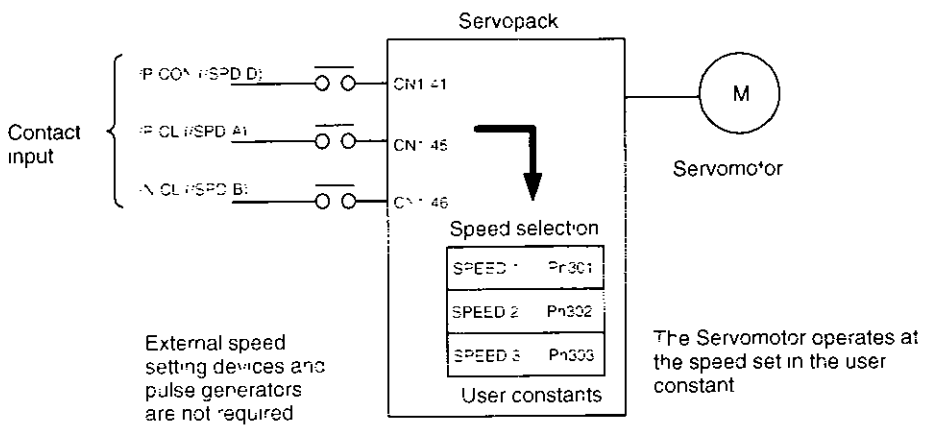


■ Using Contact Input Speed Control

Follow steps 1 to 3 below to use the contact input speed control function

1. Set contact input speed control as shown below

Pn000 1	Control Mode Selection	Factory Setting	Speed/Torque Control, Position Control
		0	

The speed can be controlled via contact inputs

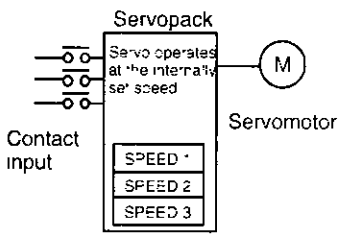

Meanings for the following signals change when the contact input speed control function is used

Pn000 1 Setting	Description	Input Signal			
0, 1, 2, 7, 8, 9, A, B	Contact input speed control function not used	/P-CON (CN1-41)		Used to switch between P and PI control	
		/P-CL (CN1-45)		Used to switch between forward external torque limit ON and OFF	
		/N-CL (CN1-46)		Used to switch between reverse external torque limit ON and OFF	
3, 4, 5, 6	Contact input speed control function used	/P-CON (/SPD-D)	/P-CL (/SPD-A)	/N-CL (/SPD-B)	Speed setting
		Direction of rotation	0	0	0 reference, etc
		0 Forward 1 Reverse	0	1	SPEED 1 (Pn301)
			1	1	SPEED 2 (Pn302)
			1	0	SPEED 3 (Pn303)

Note 1 0: OFF (high level) 1: ON (low level)

2 /P-CON, /P-CL and /N-CL functions differ from those in the table above when Pn000.1 is set to 3, 4, 5, or 6. The function is switched automatically when Pn50A.0 is set to 0.


3 The /SPD-D, /SPD-A, and /SPD-B signals can be used only when signals are allocated to the input circuits. See *5.3.3 Input Circuit Signal Allocation*.

2. Set the motor speeds with the following user constants

Pn301	Speed 1 (SPEED 1) (Contact Input Speed Control)	Unit r/min	Setting Range 0 to 10000	Factory Setting 100	Speed Control
Pn302	Speed 2 (SPEED 2) (Contact Input Speed Control)	Unit r/min	Setting Range 0 to 10000	Factory Setting 200	Speed Control
Pn303	Speed 3 (SPEED 3) (Contact Input Speed Control)	Unit r/min	Setting Range. 0 to 10000	Factory Setting 300	Speed Control

These user constants are used to set motor speeds when the contact input speed control function is selected. If the setting is higher than the maximum motor speed of the Servomotor, then the Servomotor will rotate at its maximum speed.

Contact Input Speed Control

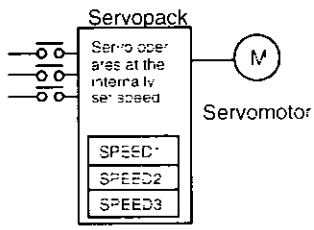


Speed selection input signals /P-CL(SPD-A)(CN1-45) and /N-CL(/SPD-B)(CN1-46) and the rotation direction selection signal /P-CON (/SPD-D)(CN1-41) enable the Servomotor to run at the preset speeds.

3. Set the soft start time.

Pn305	Soft Start Acceleration Time	Unit ms	Setting Range 0 to 10000	Factory Setting 0	Speed Control
Pn306	Soft Start Deceleration Time	Unit ms	Setting Range 0 to 10000	Factory Setting. 0	Speed Control

The Servopack internal speed reference controls speed by applying this acceleration setting.

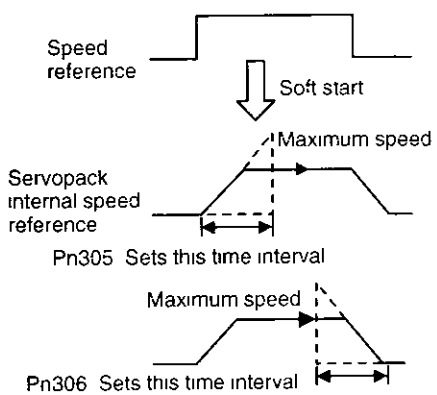

Smooth speed control can be performed by inputting a progressive speed reference or using contact input speed control. Set each constant to 0 for normal speed control.

Set each user constant to the following time intervals.

- Pn305: Time interval from when the Servomotor starts until it reaches maximum speed
- Pn306: Time interval from when the Servomotor maximum speed until it stops

■ Operation by Contact Input Speed Control

The following describes operation by contact input speed control.

Start and Stop

The following input signals are used to start and stop the Servomotor.

→ Input /P-CL CN1-45	**Speed Selection 1 (Forward External Torque Limit Input)**	**Speed/Torque Control, Position Control**
→ Input /N-CL CN1-46	**Speed Selection 2 (Reverse External Torque Limit Input)**	**Speed/Torque Control, Position Control**

- Use the following table when contact input speed control is used.

Contact Signal			User Constant	Selected Speed
/P-CON(/SPD-D)	/P-CL (/SPD-A)	/N-CL (/SPD-B)	Pn000 1	
–	0	0	3	Stopped by an internal speed reference of 0
			4	Analog speed reference (V-REF) input
			5	Pulse reference input (position control)
			6	Analog torque reference input (torque control)
Direction of rotation	0	1	3 4 5 6 Common	SPEED 1 (Pn301)
0: Forward	1	1		SPEED 2 (Pn302)
1: Reverse	1	0		SPEED 3 (Pn303)

Note 1. 0: OFF (high level) 1: ON (low level)

2. Input signals indicated by the horizontal bar (–) are optional.

- When contact input speed control is not used, input signals are used as external torque limit inputs.

INFO The contact input speed control function is used only when signals are allocated to /SPD-D /SPD-A and /SPD-B

Direction of Rotation Selection

The input signal /P-CON(/SPD-D) is used to specify the direction of Servomotor rotation

→ Input P-CON CN1-41	Proportional Control Reference, etc	Speed/Torque Control, Position Control

- When contact input speed control is used, the input signal /P-CON (/SPD-D) specifies the direction of Servomotor rotation

/P-CON (/SPD-D)	Meaning
0	Forward rotation
1	Reverse rotation


Note 0 OFF (high level) 1 ON (low level)

- When contact input speed control is not used the /P-CON signal is used for proportional control, zero clamping, and torque/speed control switching

■ Example of Contact Input Speed Control Operation

The following example shows operation by contact input speed control. Using the soft start function reduces physical shock when the speed is changed.


Contact Input Speed Control

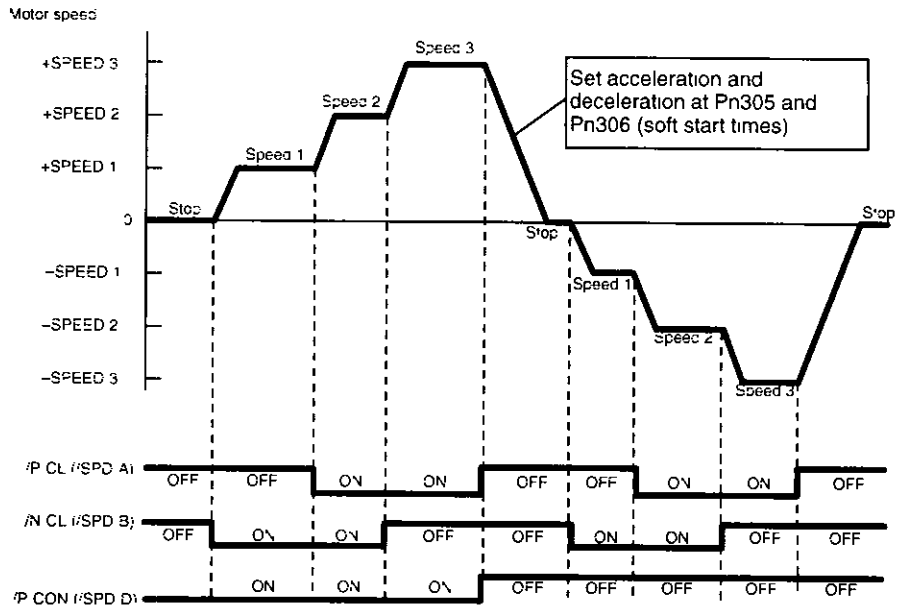

IMPORTANT

The soft start function is available only when contact input speed control is used with Pn000.1 set to 5 and is not available when a pulse reference input is used. If Contact Input Speed Control Mode is switched to Pulse Reference Input Mode while the Servomotor is operating at speed 1, speed 2, or speed 3, the Servopack will not receive a reference pulse until the positioning completed signal /COIN is output. Always start pulse reference output from the host controller after a positioning completed signal is output from the Servopack.

Signal Generation Timing for Position Control

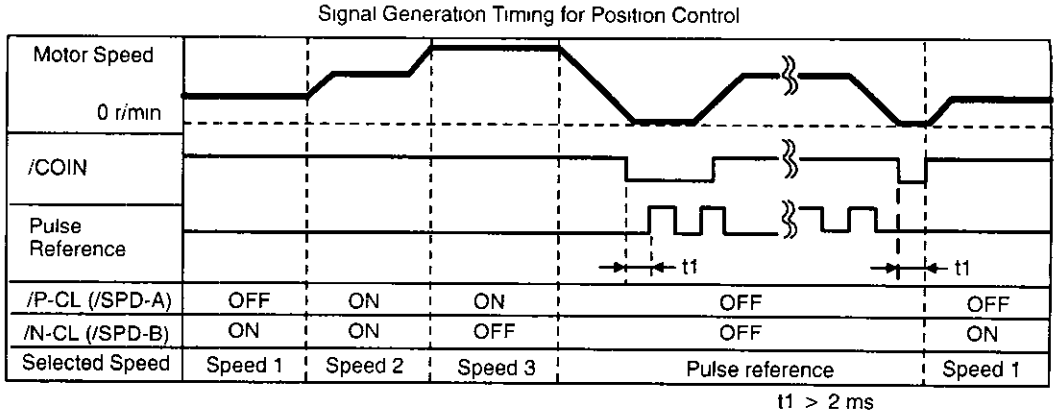

Note 1. The above figure illustrates signal generation timing when the soft start function is used.

2. The value of t1 is not affected by the use of the soft start function. A maximum 2-ms delay occurs when the /P-CL(/SPD-A) or /N-CL(/SPD-B) signal is read.

5.2.7 Using Torque Control

The SGDM Servopack limits torque as shown below

- Level 1 Limits maximum output torque to protect the equipment or workpiece
- Level 2 Limits torque after the Servomotor moves the equipment to a specified position (internal torque limit)
- Level 3 Always control torque rather than speed output
- Level 4 Switches between speed and torque control

The following describes uses for levels 3 and 4 in the torque control function

■ Torque Control Selection




Set in the following user constants to select level 3 or 4 torque control

Pn000 1	Control Method Selection	Factory Setting	Speed/Torque Control, Position Control
		0	

A torque reference is input from the host controller to the Servopack in order to control torque

Application Examples

- Tension control
- Pressure control

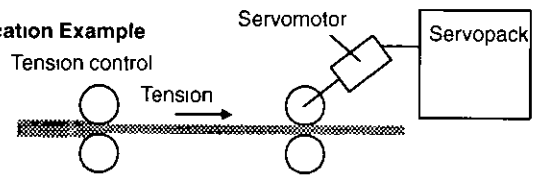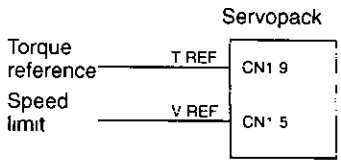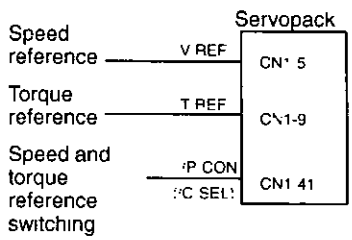Pn000.1	Control Mode
2	**Torque Control** This is a dedicated Torque Control Mode • A torque reference is input from T-REF (CN1-9) • Speed reference input V-REF (CN1-5) cannot be used for speed control if Pn002.1 is set to 1 • User constant Pn407 can be used for maximum speed control **Application Example** Tension control  
9	**Torque Control <–> Speed Control (Analog Reference)** Switches between torque and speed control • V-REF (CN1-5) inputs a speed reference or speed limit • T-REF (CN1-9) inputs a torque reference, torque feed-forward reference or torque limit depending on the control mode • /P-CON (/C-SEL)(CN1-41) is used to switch between torque and speed control CN1-41 is open: Torque control CN1-41 is 0 V: Speed control **Torque Control When /P-CON (/C-SEL) is OFF** • The T-REF reference controls toque • V-REF can be used to limit Servomotor speed when Pn002.1 is set to 1. V-REF voltage (+) limit Servomotor speed during forward and reverse rotation • User constant Pn407 can be used to limit the maximum Servomotor speed 

5

Pn000 1	Control Method

9 **Speed Control When /P-CON (/C-SEL) is ON**

Set the user constant Pn002 0 as shown below

User Constant Pn002 0	Speed Reference Input (V-REF) (CN1-5,6)	Torque Reference Input (T-REF) (CN1-9,10)	Remarks
0	Speed control		
	Speed reference	Cannot be used	
1	Torque limit speed control by analog voltage reference		See 5 2 10 for more details on torque limit speed control by analog voltage reference
	Speed reference	Torque limit	
2	Speed control with torque feed-forward		See 5 2 8 for more details on torque feed-forward speed control
	Speed reference	Torque feed-forward	

8 **Position Control ↔ Torque Control**

Can be used to switch between speed (contact reference) and torque control

- /P-CON (/C-SEL)(CN1-41) is used to switch control

CN1-41 is open	Position control
CN1-41 is 0 V	Torque control

Position Control When /P-con (/C-SEL) is ON

Set the user constant Pn002 0 as shown below

User Constant Pn002 0	Torque Reference Input (T-REF) (CN1-9,10)	Remarks
0	Position control	
	Cannot be used	
1	Torque limit position control by analog voltage reference	See 5 2 10 for more details on torque limit position control by analog voltage reference
	Torque limit	
2	Position control with torque feed-forward	See 5 2 8 for more details on torque feed-forward position control
	Torque feed-forward	

6 **Speed Control (Contact Reference) ↔ Torque Control**

Can be used to switch between speed (contact reference) and torque control

- /P-CON (/C-SEL)(CN1-45) and /N-CL(SPD-B)(CN1-46) are used to switch control

/P-CL (/SPD-A) CN1-45	/N-CL (/SPD-B) CN1-46	–
0	0	Torque control
0	1	Speed control (Contact reference)
1	1	
1	0	


0 OFF
1 ON

Note Input signal /C-SEL can be used only when a signal is allocated to the input circuit. See *5 3 3 Input Circuit Signal Allocation*.

■ Input Signals

Torque Reference Inputs


The following input signals are used for torque control

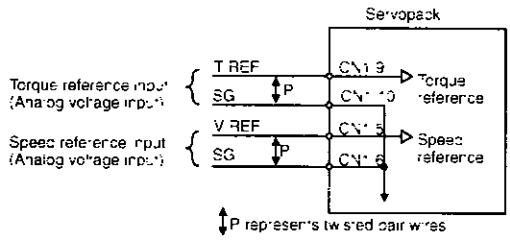

→ Input T-REF CN1-9	**Torque Reference Input**	**Speed/Torque Control**
→ Input SG CN1-10	**Signal Ground for the Torque Reference Input**	**Speed/Torque Control**

These signals are used when torque control is selected

Servomotor torque is controlled so that it is proportional to the input voltage between T-REF and SG

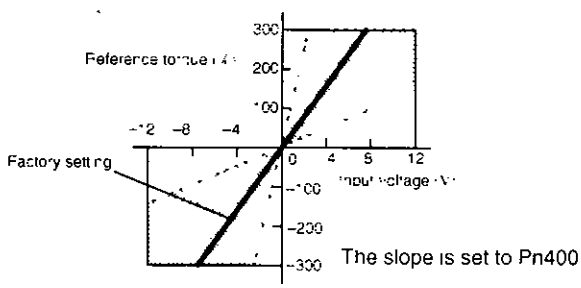

- Factory Settings


Pn400 = 30 This setting means that 3 V is equivalent to the rated torque

◀EXAMPLE▶

+3 V input Rated torque in the forward direction
+9 V input 300% of rated torque in the forward direction
–0.3 V input 10% of rated torque in the reverse direction

User constant Pn400 can be used to change the voltage input range

- Example of an Input Circuit

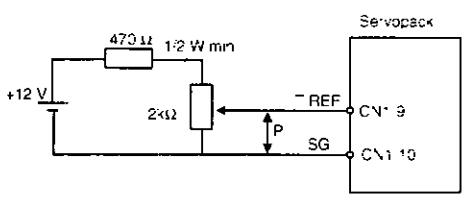

- Always use twisted-pair cables for noise control
- Recommended variable resistor Model 25HP-10B manufactured by Sakae Tsushin Kogyo Co. Ltd


Speed Reference Inputs

Refer to 5 2 1

Using the /P-CON Signal

→ Input /P-CON CN1-41	Proportional Control, etc	Speed/Torque Control, Position Control

The function of the input signal /P-CON varies with the setting at Pn000 1

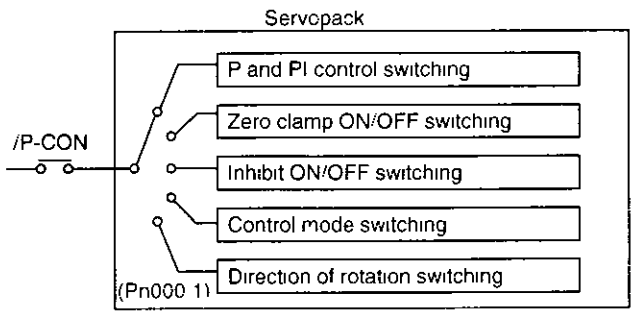

Pn000 1 Setting	/P-CON Function
0	Switches between P (proportional) and PI (proportional-integral) control
2	Not used
3 4 5 6	Switches the direction of rotation in Contact Input Speed Control Mode
7 8 9	Switches the control mode
A	Turns ON/OFF zero clamp
B	Turns inhibit ON/OFF

INFO The /P-CON signal function switches automatically when Pn50A 0 is set to 0


■ User Constant

The following user constant is used for torque control Set the user constant according to the servo system used

Pn400	Torque Reference Input Gain	Unit	Setting Range	Factory Setting	Speed/Torque Control
		0 1 V/rated torque	10 to 100	30	

The user constant sets the voltage range for torque reference input T-REF (CN1-9) according to the output form of the host controller or external circuit

The factory setting is 30, so the rated torque output is 3 V (30 × 0 1)

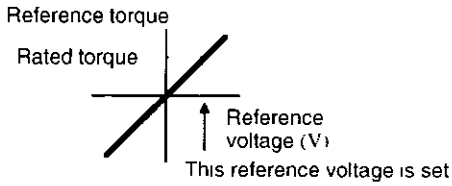

Two speed limit functions during torque control are available by the user constant setting as shown below

Pn002 1 setting	Description
0	Uses speed limit set by Pn407 (internal speed limit function)
1	Uses V-REF (CN1-5 and 6) as external speed limit input and sets speed limit by voltage which input to V-REF and Pn300 (external speed limit function)

Internal speed limit function


Pn407	Speed Limit during Torque Control	Unit r/min	Setting Range	Factory Setting.	Speed/Torque Control
			0 to 10000	10000	

The user constant sets a motor speed limit when torque control is selected

It is used to prevent excessive equipment speed during torque control

Since the speed limit detection signal /VLT functions the same in torque control as the /CLT signal. see *5 1 3 Limiting Torque* where the /CLT signal is described

Torque Control Range

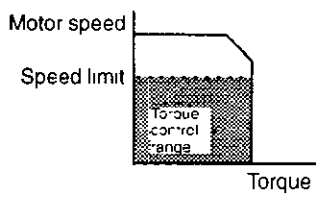

The maximum speed of the Servomotor will be used if Pn407 is set to a value higher than the maximum speed of the Servomotor

External speed limit function


This is function uses V-REF (CN1-5) as external speed limit input and sets input voltage range by Pn300 Set the range according to host computer and the output state of external circuit

Pn300	Speed Reference Input Gain	Unit	Setting Range	Factory Setting:	Speed/Torque Control
		0 01V/Rated Speed	150 to 3000	600	

The factory setting is ±1% of the rated motor speed or 6 V

INFO

Principle of Speed Control
Torque reversely proportional to the difference between the speed limit and the speed is fed back to return the system to within the control speed range when the control speed range is exceeded The actual motor speed limit will thus be increased by negative loads




5.2.8 Torque Feed-forward Function

The torque feed-forward function is used only in control mode except for torque control

This function shortens positioning time differentiates a speed reference at the host controller to generate a torque feed-forward reference and inputs this reference together with the speed reference to the Servopack

Too high a torque feed-forward value will result in overshooting or undershooting To prevent this, set the optimum value while observing system response

Connect a speed reference signal line to V-REF (CN1-5 and 6) and a torque feed-forward reference signal line to T-REF (CN1-9 and 10)

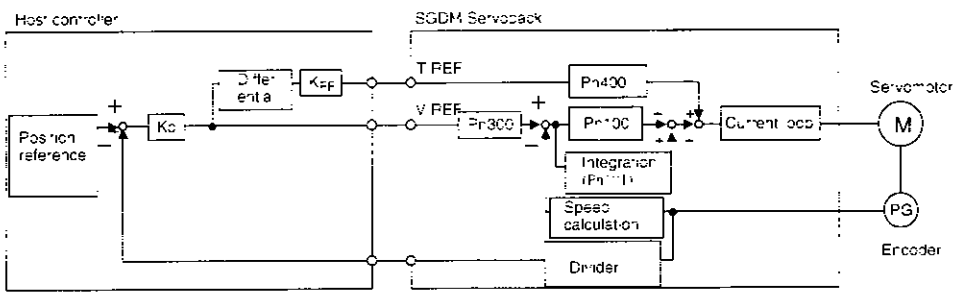

Kp Position loop gain
K_{FF} Feed-forward gain

■ Using the Torque Feed-Forward Function

To use the torque feed-forward function set the following user constant to 2

Pn002 0	Speed Control Option (T-REF Terminal Allocation)	Factory Setting 0	Speed Control Position Control

This setting enables the torque feed-forward function

Pn002 0 Setting	Description
0	None
1	T-REF terminal used for external torque limit input
2	T-REF terminal used for torque feed-forward input

The torque feed-forward function cannot be used with torque limiting by analog voltage reference described in *5 2 10 Using Torque Limiting by Analog Voltage Reference*

■ Setting

Torque feed-forward is set using user constant Pn400

The factory setting at Pn400 is 30 If for example, the torque feed-forward value is ±3 V, then torque is limited to ±100% of the rated torque

Pn400	Torque Reference Input Gain	Unit· 0 1V/Rated Torque	Setting Range. 10 to 100	Factory Setting. 30	Speed Control Position Control

5.2.9 Speed Feed-forward Function


INFO The speed feed-forward function described in this section is supported only by the new version of the SGDM Servopacks (SGDM-□DA)

The speed feed-forward function uses analog voltages and is effective only for position control

The feed-forward function can be used to shorten positioning time The host controller creates a feed-forward reference based on the differential of the position reference This reference is provided to the Servopack with the position reference

Overshooting and undershooting can result if too much feed-forward is used Set the optimum settings based on the actual response

The position reference from the host controller is connected to PULS and SIGN (CN1-7, 8, 11, and 12) and the speed feed-forward reference is connected to V-REF (CN1-5 and 6)

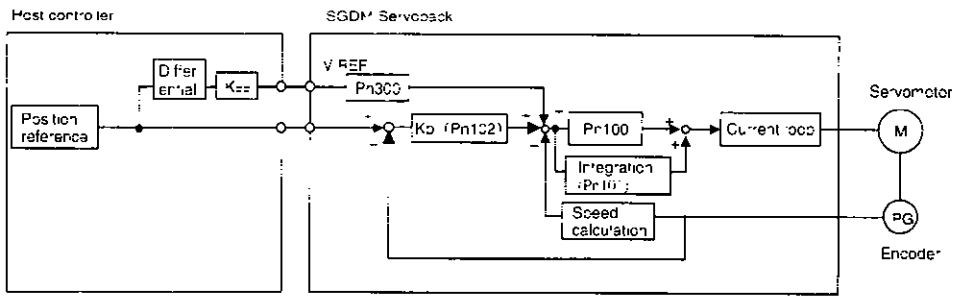

Kp Position loop gain
K_{FF} Feed-forward gain

■ Using the Speed Feed-forward Function

Set the following user constant to 1 to use the analog voltage speed feed-forward function

Pn207 1	Speed Control Option	Factory Setting 0	Position Control

This setting will enable the speed feed-forward function

Pn207 1 Setting	Description
0	No feed-forward function
1	V-REF terminal used a speed feed-forward input

■ Setting


The speed feed-forward value is set in user constant Pn300

The factory setting of Pn300 is 600, for which a speed feed-forward value of ±6 V will produce the rated speed

Pn300	Speed Reference Input Gain	Unit	Setting Range	Factory Setting	Speed/Torque Control/Position Control
		0 01V/Rated Speed	150 to 3000	600	

5.2.10 Torque Limiting by Analog Voltage Reference, Function 1

Torque limiting by analog voltage reference limits torque by assigning a torque limit in an analog voltage to the T-REF terminal (CN1-9 and 10) It cannot be used for torque control because the torque reference input terminal T-REF is used as an input terminal

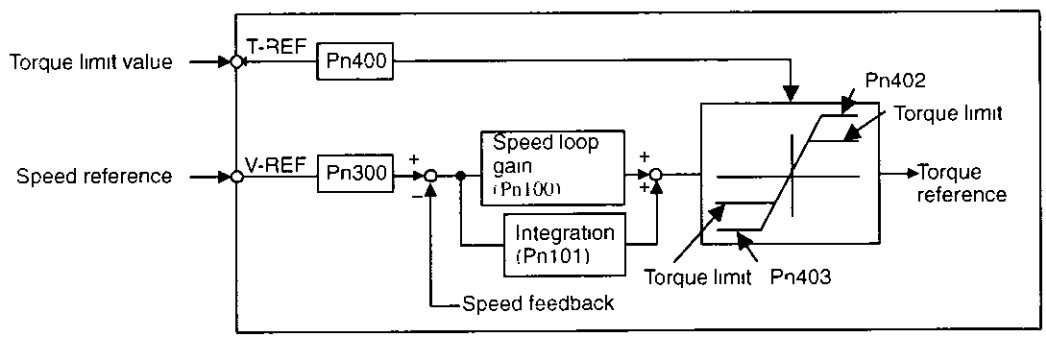

■ Using Torque Limiting by Analog Voltage Reference

To use this function, set the following user constant to 1

Pn002 0	Speed Control Option (T-REF Terminal Allocation)	Factory Setting	Speed Control, Position Control
		0	

This parameter can be used to enable torque limiting by analog voltage reference

Torque limiting cannot be set separately for forward and reverse rotation

Pn002 0 Setting	Description
0	None
1	T-REF terminal used for external torque limit input
2	T-REF terminal used for torque feed-forward input

This function cannot be used with the torque feed-forward function described in *5 2 8 Using the Torque Feed-forward Function*

■ Setting

The torque limit input gain is set at user constant Pn400


The factory setting at Pn400 is 30 If, for example, the torque limit is ±3 V, then torque is limited to 100% of the rated torque (A torque value higher than 100% torque is clamped at 100%)

Pn400	Torque Reference Input Gain	Unit	Setting Range	Factory Setting:	Speed/Torque Control
		0 1V/Rated Torque	10 to 100	30	Position Control

5.2.11 Torque Limiting by Analog Voltage Reference, Function 2

INFO The torque limiting function described in this section is supported only by the new version of the SGDM Servopacks (SGDM-□DA)

Torque limiting by analog voltage reference limits torque by assigning a torque limit in an analog voltage to the T-REF terminals (CN1-9 and 10) This function cannot be used for torque control because the torque reference input terminal T-REF is used as an input terminal If the /P-CL signal (CN1-45) is ON, a forward torque limit is applied, and if the /N-CL signal (CN1-46) is ON, a reverse torque limit is applied

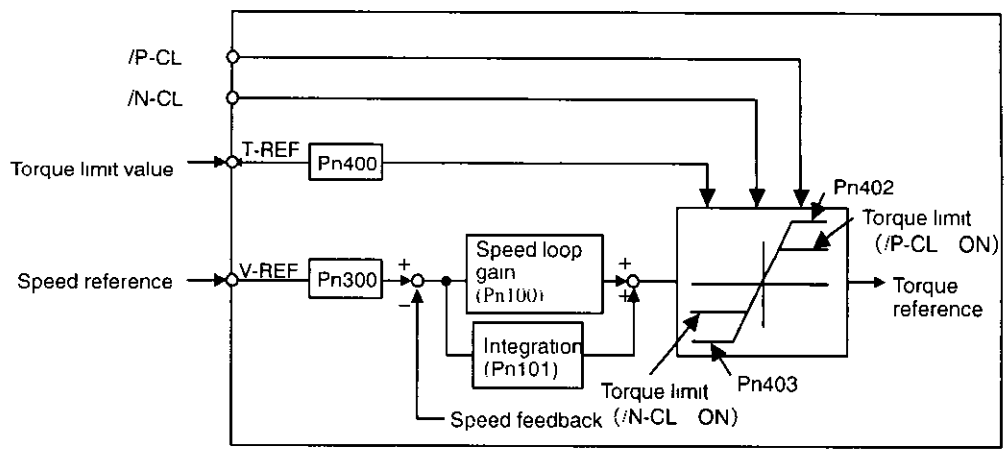

■ Using Torque Limiting by Analog Voltage Reference

To use this function, set the following user constant to 3

Pn002 0	Speed Control Option (T-REF Terminal Allocation)	Factory Setting	Speed Control, Position Control
		0	

This setting will enable torque limiting by analog voltage reference, function 2

Pn002 0 Setting	Description
0	None
1	T-REF terminal used for external torque limit input
2	T-REF terminal used for torque feed-forward input
3	T-REF terminal used for external torque limiting input when P-CL or N-CL is ON

This torque limiting function cannot be used at the same time as the torque feed-forward function

Confirm the allocation of input signals when using this function (Refer to *5 3 3 Input Circuit Signal Allocation*.) The factory settings are shown in the following table

/P-CL	ON and CN1-45 is low	Forward torque limit applied	Limit Pn404 or T-REF input whichever is smaller
	OFF and CN1-45 is high	Forward torque limit not applied i e normal operation	–
/N-CL	ON and CN1-46 is low	Reverse torque limit applied	Limit Pn405 or T-REF input whichever is smaller
	OFF and CN1-46 is high	Reverse torque limit not applied i e normal operation	–

5

■ Setting

The torque limit input gain is set at user constant Pn400

The factory setting at Pn400 is 30 If, for example, the torque limit is ±3 V, then torque is limited to 100% of the rated torque


Pn400	Torque Reference Input Gain	Unit	Setting Range	Factory Setting	Speed/Torque Control/Position Control
		0 1V/Rated Torque	10 to 100	30	

The settings of the following user constants are also valid The torque limit will be either the torque limit value for the analog voltage reference or the setting of Pn404/Pn405, whichever is smaller

Pn404	Forward External Torque Limit	Unit	Setting Range	Factory Setting	Speed/Torque Control/Position Control
		%	0 to 800	100	
Pn405	Reverse External Torque Limit	Unit	Setting Range	Factory Setting	Speed/Torque Control/Position Control
		%	0 to 800	100	

5.2.12 Reference Pulse Inhibit Function (INHIBIT)

This function inhibits the Servopack from counting input reference pulses during position control. The Servomotor remains locked (clamped) while the function is in use. The /P-CON(/INHIBIT) signal is used to enable or disable the function.

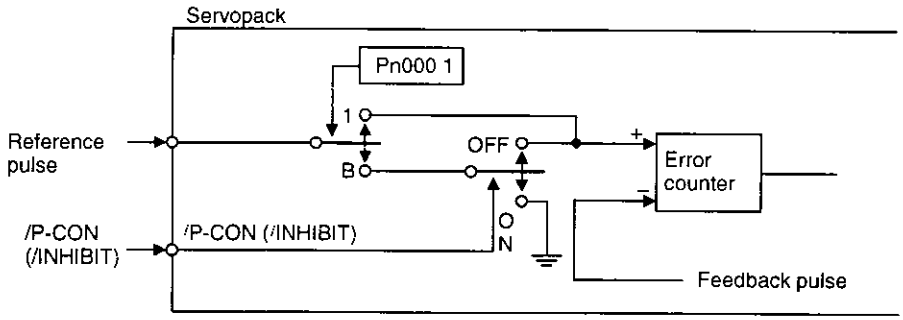

■ Using Reference Pulse Inhibit Function (INHIBIT)

To use the inhibit function, set the user constant as shown below.

Pn000 1	Control Method Selection	Factory Setting	Position Control
		0	


The following settings enable the inhibit function.

Pn000 1 Setting	Description
1	Enables the inhibit function Always counts reference pulses
B	Enables the inhibit function. The /P-CON (/INHIBIT) signal is used to enable or disable the inhibit function.

/P-CON (/INHIBIT)	Description
OFF	Counts reference pulses
ON	Prohibits the Servopack from counting reference pulses The Servomotor remains locked

Note Parentheses ( ) around an /INHIBIT signal indicate that a signal has been allocated to the input circuit. See *5.3.3 Input Circuit Signal Allocation* for more details.

■ Relationship between Inhibit Signal and Reference Pulses

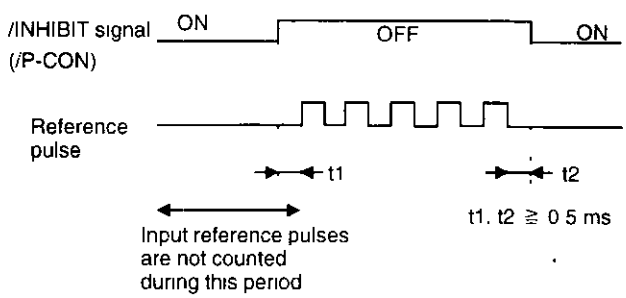


5.3 Setting Up the Servopack

This section describes the procedure for setting user constants to operate the SGDM Servopack

5.3.1 User Constants

The Σ-II Series Servopack provides many functions and has parameters called user constants that allow the user to specify functions and perform fine adjustments

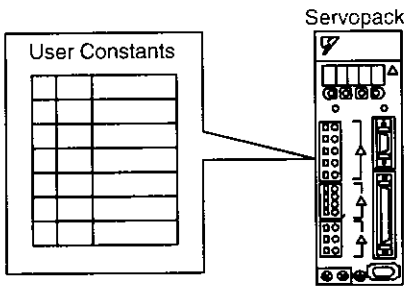

A Panel Operator or Digital Operator is used to set user constants

User constants are divided into the following three groups

User Constant	Function
Pn000 to Pn601	Specify Servopack functions, set servo gains etc
Fn000 to Fn012	Execute auxiliary functions such as JOG Mode operations and origin searches
Un000 to Un00D	Enable monitoring the motor speed and torque reference on the panel display


Appendix B shows a list of user constants provided for reference See *7.1.6 Operation in User Constant Setting Mode* for more details on the procedure for setting user constants

5.3.2 JOG Speed


Use the following user constant to set or modify motor speed when operating the Servomotor from a Panel or Digital Operator

Pn304	Jog Speed	Unit	Setting Range	Factory Setting	Speed/Torque Control, Position Control
		r/min	0 to 10000	500	

Use this constant to set the motor speed when operating the Servopack from a Panel or Digital Operator If the setting is higher than the maximum motor speed of the Servomotor, then the Servomotor will rotate at its maximum speed

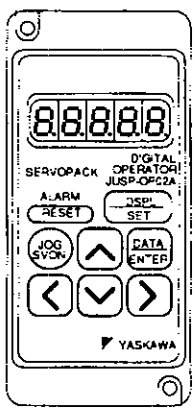

Digital Operator



Panel Operator

5.3.3 Input Circuit Signal Allocation

The functions allocated to sequence input signal circuits can be changed CN1 connector input signals are allocated with the factory settings as shown in the following table

CN1 Connector Terminal Numbers	Input Terminal Name	Factory Setting	
		Symbol	Name
40	SI0	/S-ON	Servo ON
41	SI1	/P-CON	(Proportional control reference) *
42	SI2	P-OT	Forward run prohibit
43	SI3	N-OT	Reverse run prohibit
44	SI4	/ALM-RST	Alarm reset
45	SI5	/P-CL	(Forward current limit) *
46	SI6	/N-CL	(Reverse current limit) *

* The functions of these input signals are automatically switched according to the setting at user constant Pn000 1 as long as Pn50A 0 is set to 0

The following user constant is used to enable input signal allocation


Pn50A 0	Input Signal Allocation Mode	Factory Setting	Speed/Torque Control, Position Control
		0	

Pn50A 0 Setting	Description
0	Factory setting for sequence input signal allocation This setting is the same as Yaskawa SGDB-□AD□ Servopacks
1	Enables any sequence input signal settings

INFO In the factory setting Pn50A 0 is set to 0 Functions in this manual are generally described for the factory settings

■ Input Signal Allocation

The following signal can be allocated when Pn50A 0 is set to 1

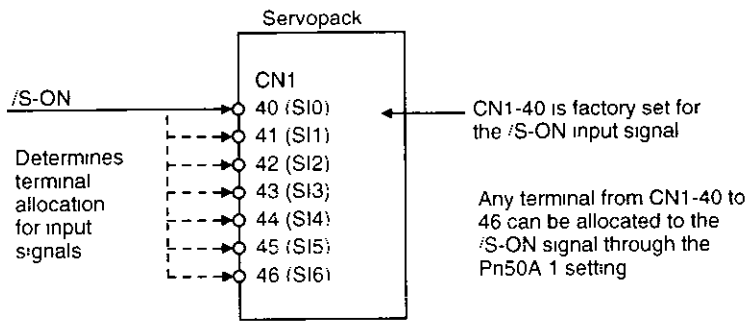

The following table shows the user constant factory settings for input signal selections 1 to 4

Pn50A	Input Signal Selections 1	Factory Setting	Speed/Torque Control, Position Control
		2100	
Pn50B	Input Signal Selections 2	Factory Setting	Speed/Torque Control, Position Control
		6543	
Pn50C	Input Signal Selections 3	Factory Setting	Speed/Torque Control, Position Control
		8888	
Pn50D	Input Signal Selections 4	Factory Setting	Speed/Torque Control, Position Control
		8888	

Select the input terminal on the CN1 connector that will be used for each input signal

- Examples of Input Signal Allocation

The procedure used to allocate sequence input signals is described using the /S-ON signal as a typical example

Pn50A.1 Setting	Description	Remarks
0	Inputs the /S-ON signal from the SI0 (CN1-40) input terminal	Signal Polarity: Normal Example: Servo-ON signal (/S-ON) is valid when low (ON)
1	Inputs the /S-ON signal from the SI1 (CN1-41) input terminal	
2	Inputs the /S-ON signal from the SI2 (CN1-42) input terminal	
3	Inputs the /S-ON signal from the SI3 (CN1-43) input terminal	
4	Inputs the /S-ON signal from the SI4 (CN1-44) input terminal	
5	Inputs the /S-ON signal from the SI5 (CN1-45) input terminal	
6	Inputs the /S-ON signal from the SI6 (CN1-46) input terminal	
7	Sets /S-ON signal so that it is always valid	Set the Servo-ON signal (/S-ON) so that is is always valid or always invalid
8	Sets /S-ON signal so that it is always invalid	
9	Inputs the /S-ON signal from the SI0 (CN1-40) input terminal	Signal Polarity: Reversed Example: Servo-ON signal (/S-ON) is valid when high (OFF)
A	Inputs the /S-ON signal from the SI1 (CN1-41) input terminal	
B	Inputs the /S-ON signal from the SI2 (CN1-42) input terminal	
C	Inputs the /S-ON signal from the SI3 (CN1-43) input terminal	
D	Inputs the /S-ON signal from the SI4 (CN1-44) input terminal	
E	Inputs the /S-ON signal from the SI5 (CN1-45) input terminal	
F	Inputs the /S-ON signal from the SI6 (CN1-46) input terminal	

Note Settings 9 through F can be used to reverse signal polarity. This function is supported only by the new version of the SGDM Servopacks (SGDM-□DA).

IMPORTANT

If reverse polarity is set for the Servo-ON, Forward Run Prohibit, or Reverse Run Prohibit signals, safe operation may not occur when troubles such as broken signal lines occur. You must confirm operational safety if setting reverse polarity is necessary for one or more of these signals.

As shown in the table above, the /S-ON signal can be allocated to any input terminal from SI0 to SI6. /S-ON is always input when Pn50A.1 is set to 7, and an external signal line would therefore not be needed because the Servopack will determine whether the servo is ON or OFF.

The /S-ON signal is not used when Pn50A.1 is set to 8. This setting is meaningful only in the following instances:

- When the factory set input signal are to be replaced by another input signal.
- The signal must be left ON (low level) during normal operation to make the signal valid when OFF (high level) when forward run prohibit (P-OT) and reverse run prohibit

(N-OT) are input. The input terminal signal line must be left ON even in system configurations that do not require this signal, but unnecessary wiring can be eliminated by setting Pn50A.1 to 8.



Signals are input with OR logic when multiple signals are allocated to the same input circuit.

- Allocating Other Input Signals

Input signal allocation can be changed as shown below

Input Signal		User Constant		Description
Name	Applicable Logic	Number	Setting	
Proportional Control Reference (/P-CON)	ON (low level)	Pn50A.2	0	Inputs the signal on the left from SI0 (CN1-40)
			1	Inputs the signal on the left from SI1 (CN1-41)
			2	Inputs the signal on the left from SI2 (CN1-42)
			3	Inputs the signal on the left from SI3 (CN1-43)
			4	Inputs the signal on the left from SI4 (CN1-44)
			5	Inputs the signal on the left from SI5 (CN1-45)
			6	Inputs the signal on the left from SI6 (CN1-46)
			7	Sets the signal on the left to always enabled
			8	Sets the signal on the left to always disabled
			9*2	Inputs the reverse of the signal on the left from SI0 (CN1-40)
			A*2	Inputs the reverse of the signal on the left from SI1 (CN1-41)
			B*2	Inputs the reverse of the signal on the left from SI2 (CN1-42)
			C*2	Inputs the reverse of the signal on the left from SI3 (CN1-43)
			D*2	Inputs the reverse of the signal on the left from SI4 (CN1-44)
			E*2	Inputs the reverse of the signal on the left from SI5 (CN1-45)
			F*2	Inputs the reverse of the signal on the left from SI6 (CN1-46)
Forward Run Prohibit (P-OT)	OFF (high level)	Pn50A.3	0 to F*2	Same as above *1
Reverse Run Prohibit (N-OT)	OFF (high level)	Pn50B.0	0 to F*2	Same as above *1
Alarm Reset (/ARM-RST)	ON (low level)	Pn50B.1	0 to F*2	Same as above *1
Forward Current Limit (/P-CL)	ON (low level)	Pn50B.2	0 to F*2	Same as above *1
Reverse Current Limit (/N-CL)	ON (low level)	Pn50B.3	0 to F*2	Same as above *1
Contact Input Speed Control Selection (/SPD-D)	–	Pn50C.0	0 to F*2	Same as above *1
Contact Input Speed Control Selection (/SPD-A)	–	Pn50C.1	0 to F*2	Same as above *1
Contact Input Speed Control Selection (/SPD-B)	–	Pn50C.2	0 to F*2	Same as above *1

Input Signal		User Constant		Description
Name	Applicable Logic	Number	Setting	
Control Mode Selection (/C-SEL)	ON (low level)	Pn50C.3	0 to F*2	Same as above *1
Zero Clamp (/ZCLAMP)	ON (low level)	Pn50D.0	0 to F*2	Same as above *1
Reference Pulse Inhibit (/INHIBIT)	ON (low level)	Pn50D.1	0 to F*2	Same as above *1
Gain Switching (/G-SEL)	ON (low level)	Pn50D.2	0 to F*2	Same as above *1

*1 Same as above indicates that the user constant can be set to from 0 to F to allocate input signals to the following terminals, as shown in the example for the Proportional Control Reference (/P-CON).

1 Allocation to input terminals SI0 to SI6

2 Setting to always valid or always invalid

3 Allocation to input terminals SI0 to SI6 and receiving the signals at the Servopack with the reverse logic of the input signal

*2 Settings 9 and A to F for the user constants can be used only for the new version of the SGDM Servopacks (SGDM-□DA).

5.3.4 Output Circuit Signal Allocation


Output signal functions can be allocated to the sequence signal output circuits shown below

CN1 Connector Terminal Numbers	Output Terminal Name	Factory Setting		Comments
		Symbol	Name	
25	SO1	/V-CMP+ (/COIN+)	Speed coincidence detection (positioning completed)	The signal output will vary depending on the control mode
26 (SG)		/V-CMP– (/COIN–)		
27	SO2	/TGON+	Rotation detection	
28 (SG)		/TGON–		
29	SO3	/S-RDY+	Servo ready	
30 (SG)		/S-RDY–		

The output signal selection user constants and their factory settings are shown below

Pn50E	**Output Signal Selections 1**	**Factory Setting 3211**	**Speed/Torque Control, Position Control**
Pn50F	**Output Signal Selections 2**	**Factory Setting. 0000**	**Speed/Torque Control, Position Control**
Pn510	**Output Signal Selections 3**	**Factory Setting 0000**	**Speed/Torque Control, Position Control**

Select the CN1 connector terminals that will output the signals

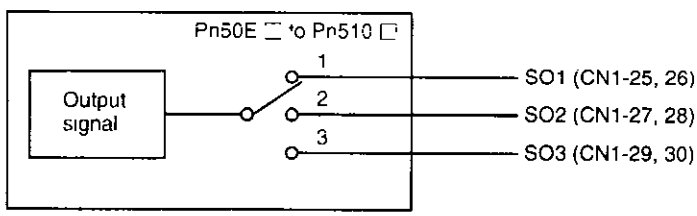

Output Signal	User Constant		Description
	Number	Setting	
Positioning Completed (/COIN)	Pn50E 0	0	Disabled (Not used for the output signal on the left.)
		1	Outputs the signal on the left from the SO1 (CN1-25 and 26) output terminal
		2	Outputs the signal on the left from the SO2 (CN1-27 and 28) output terminal
		3	Outputs the signal on the left from the SO3 (CN1-29 and 30) output terminal
Speed Coincidence Detection (/V-CMP)	Pn50E 1	0 to 3	Same as above
Rotation Detection (/TGON)	Pn50E 2	0 to 3	Same as above
Servo Ready (/S-RDY)	Pn50E 3	0 to 3	Same as above
Torque Limit Detection (/CLT)	Pn50F 0	0 to 3	Same as above
Speed Limit Detection (/VLT)	Pn50F 1	0 to 3	Same as above
Brake Interlock (/BK)	Pn50F 2	0 to 3	Same as above
Warning (/WARN)	Pn50F 3	0 to 3	Same as above
Near (/NEAR)	Pn510 0	0 to 3	Same as above
Not used	–	–	–

Note Same as above means output signals are disabled or allocated to output terminals SO1 to SO3 through user constant settings 0 to 3.

INFO

Signals are output with OR logic when multiple signals are allocated to the same output circuit. Signals that are not detected are invalid. For example, the positioning completed signal /COIN is invalid in Speed Control Mode.

The following user constant can be used to reverse the signals output on output terminals SO1 to SO3.

Pn512	Output Signal Reversal Settings	Factory Setting	Speed/Torque Control, Position Control
		0000	

The settings specify which of the connector CN1 output signals are to be reversed.

Output Terminals	User Constant		Meaning
	Number	Setting	
SO1 (CN1-25, 26)	Pn512.0	0	Output signal not reversed
		1	Output signal reversed
SO2 (CN1-27, 28)	Pn512.1	0	Output signal not reversed
		1	Output signal reversed
SO3 (CN1-29, 30)	Pn512.2	0	Output signal not reversed
		1	Output signal reversed
Not used	Pn512.3	–	–

INFO

The Output Signal Reversal Settings (Pn512) are supported only by the new version of the SGDM Servopacks (SGDM-□DA).

5.3.5 Control Mode Selection

The SGDM Servopack offers speed control, position control, torque control, and the other control modes shown in the following table.

The following user constant is used to set the control mode.

Pn000 1	Control Mode Selection	Factory Setting: 0	Speed/Torque Control, Position Control

Pn000 1 Setting	Control Mode
0	Speed Control (Analog Reference)
1	Position Control (Pulse Train Reference)
2	Torque Control (Analog Reference)
3	Contact Input Speed Control Selection (Contact Reference)
4	Contact Input Speed Control Selection (Contact Reference) ↔ Speed Control (Analog Reference)
5	Contact Input Speed Control Selection (Contact Reference) ↔ Position Control (Pulse Train Reference)
6	Contact Input Speed Control Selection (Contact Reference) ↔ Torque Control (Analog Reference)
7	Position Control (Pulse Train Reference) ↔ Speed Control (Analog Reference)
8	Position Control (Pulse Train Reference) ↔ Torque Control (Analog Reference)
9	Torque Control (Analog Reference) ↔ Speed Control (Analog Reference)
A	Speed Control (Analog Reference) ↔ Zero Clamp Control
B	Position Control (Pulse Train Reference) ↔ Position Control (Inhibit)

■ Description of Control Modes

The control modes are described below.

Speed Control (Analog Reference)

This mode controls speed using an analog voltage input reference. See *5 2 1 Speed Reference*.

Position Control (Pulse Train Reference)

This mode controls positioning using a pulse train input reference. See *5 2 2 Position Reference*.

Torque Control (Analog Reference)

This mode controls torque using an analog voltage input reference. See *5 2 7 Using Torque Control*.

Contact Input Speed Control Selection (Contact Reference)

This mode uses the /P-CON (/SPD-D), /P-CL (/SPD-A), and /N-CL (/SPD-B) input signals to control speed as it switches among the three preset operating speeds in the Servopack. See *5 2 6 Contact Input Speed Control*.

Contact Input Speed Control Selection (Contact Reference) ↔ Speed Control (Analog Reference)

This mode controls speed by switching between contact reference and analog voltage reference speed control. Analog voltage reference speed control is enabled when both /P-CL (/SPD-A) and /N-CL (/SPD-B) input signals are OFF (high level). See *5.2.6 Contact Input Speed Control*.

Contact Input Speed Control Selection (Contact Reference) ↔ Position Control (Pulse Train Reference)

This mode switches between contact reference speed control and pulse train reference position control. Pulse train reference position control is enabled when both /P-CL (/SPD-A) and /N-CL (/SPD-B) input signals are OFF (high level). See *5.2.6 Contact Input Speed Control*.

Contact Input Speed Control Selection (Contact Reference) ↔ Torque Control (Analog Reference)

This mode switches between contact reference speed control and analog voltage reference torque control. Torque control using an analog voltage reference is enabled when both /P-CL (/SPD-A) and /N-CL (/SPD-B) input signals are OFF (high level). See *5.2.6 Contact Input Speed Control*.

Position Control (Pulse Train Reference) ↔ Speed Control (Analog Reference)

This mode switches between position and speed control through the /P-CON (/C-SEL) signal.

Position Control (Pulse Train Reference) ↔ Torque Control (Analog Reference)

This mode switches between position and torque control through the /P-CON (/C-SEL) signal.

Torque Control (Analog Reference) ↔ Speed Control (Analog Reference)

This mode switches between torque and speed control through the /P-CON (/C-SEL) signal. See *5.2.7 Using Torque Control*.

Speed Control (Analog Reference) ↔ Zero Clamp

This speed control mode is used to set the zero clamp function when the Servopack is stopped. Zero clamp operates when the /P-CON (/ZCLAMP) signal is ON (low level). See *5.4.3 Using the Zero Clamp Function*.

Position Control (Pulse Train Reference) ↔ Position Control (Inhibit)

This mode controls positioning by inhibiting reference pulse input through the /P-CON (/INHIBIT) signal. See *5.2.12 Using Reference Pulse Inhibit Function (/INHIBIT)*.

5.3.6 DC Power Input

The following describes how to operate the SGDM Servopack with DC power

■ Setting

1 Connect the main power as follows

+1 terminal +280 V
+140 V (For 100 V input SGDM-□□BD (A) type)
- terminal 0 V

2 Enter the control power to the L1C and the L2C as follows (No polarity)

280 VDC
140 VDC (For 100 V input SGDM-□□BD (A) type)

3 Set user constant Pn001 2 to 1

Pn001 2	AC/DC Power Selection	Factory Setting	Speed/Torque Control, Position Control
		0	

4 Turn ON the control power again

■ Precautions

Observe the following precautions

- Input voltage must have the following specifications

270 to 320 VDC SGDM-□□AD (A)
130 to 155 VDC SGDM-□□BD (A)

- The motor converts the regenerated energy to power when regenerating The Servopack with DC power input specifications does not regenerate Process regenerated energy on the power side
- Rapid discharging is not possible as a DC power input specifications after the main power is turned OFF High voltage remains in the Servopack even after the power is turned OFF


5.4 Setting Stop Functions

This section describes the procedure used to stop the Servopack stably

5.4.1 Adjusting Offset

■ When the Servomotor Will Not Stop

The Servomotor may rotate at very low speed and not stop even when 0 V is specified as the reference voltage for Servopack speed and torque control (analog reference) This happens when the reference voltage from the host controller or external circuit is slightly offset (in mV units) The Servomotor will stop if this offset is properly adjusted to 0 V

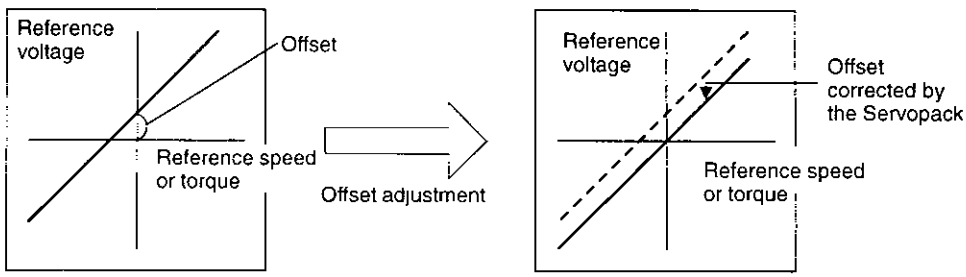

■ Reference Offset Adjustment

The following methods can be used to adjust the reference offset to 0 V

Automatic Adjustment of Reference Offset	The reference offset is automatically adjusted to 0 V
Manual Adjustment of Reference Offset	The reference offset can be set to a specified value

IMPORTANT Use manual rather than automatic adjustment if a position control loop is formed in the host controller

See the following sections in *Chapter 7 Using the Digital Operator* for more details on adjustment procedures

Automatic Adjustment of Reference Offset	*7.2.3 Automatic Adjustment of the Speed and Torque Reference Offset*
Manual Adjustment of Reference Offset	*7.2.4 Manual Adjustment of the Speed and Torque Reference Offset*


5.4.2 Using the Dynamic Brake

To stop the Servomotor by applying the dynamic brake (DB), set the desired mode in the following user constant. The Servomotor will stop due to equipment friction if the dynamic brake is not applied.

Pn001 0	Servo OFF or Alarm Stop Mode	Factory Setting	Speed/Torque Control, Position Control
		0	

The SGDM Servopack turns OFF under the following conditions:

- The Servo ON input signal (/S-ON, CN1-40) is turned OFF
- A Servo alarm occurs
- Power is turned OFF

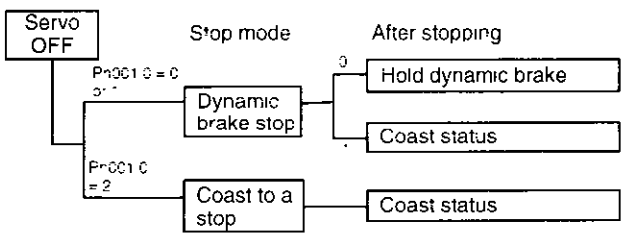

Specify the Stop Mode if any of these occurs during operation.

Pn001 0 Setting	Description
0	Uses the dynamic brake to stop the Servomotor Maintains dynamic brake after the Servomotor stops *1
1	Uses the dynamic brake to stop the Servomotor Releases dynamic brake after the Servomotor stops and the servomotor coasts to a stop
2	Coasts the Servomotor to a stop *2 The Servomotor is turned OFF and motion stops due to equipment friction


*1 If the Servomotor is stopped or moving at extremely low speed, it will coast to a stop.

*2 A dynamic brake is used when control power is turned ON and main power is turned OFF.

TERMS

◆ Dynamic brake (DB)

The dynamic brake is a common way of suddenly stopping a Servomotor. Built into the Servopack, the dynamic brake suddenly stops a Servomotor by electrically shorting its electrical circuit.



IMPORTANT

The dynamic brake is an emergency stop function. Do not repeatedly start and stop the Servomotor using the servo ON signal (/S-ON) or by repeatedly turning power ON and OFF.


INFO

During control power is turned OFF, the state of the dynamic brake changes as follows:
30 W to 1.5 kW: Dynamic brake ON
2.0 kW or more: Dynamic brake OFF

5.4.3 Using the Zero Clamp Function

■ Zero Clamp Function

The zero clamp function is used for systems where the host controller does not form a position loop for the speed reference input. In other words, this function is used to stop and lock the Servomotor even when the input voltage of speed reference V-REF is not 0 V. An internal position loop is temporarily formed to clamp the Servomotor within one pulse when the zero clamp function is turned ON. Even if the Servomotor is forcibly rotated by external force, it will still return to the zero clamp position.

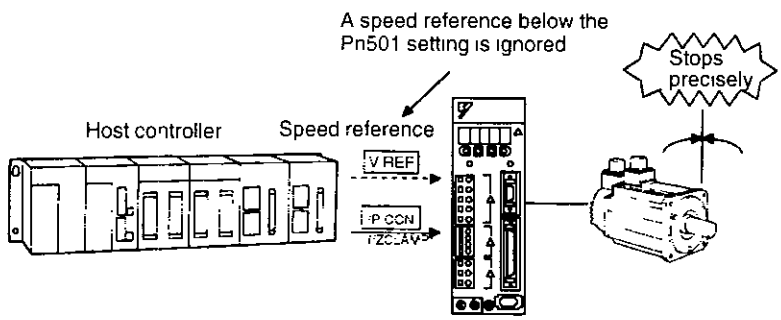


■ User Constant Setting

Set the following user constant so that the input signal /P-CON (/ZCLAMP) can be used to enable or disable the zero clamp function.

Pn000.1	Control Method Selection	Factory Setting	Speed Control
		0	
→ Input /P-CON CN1-41	Proportional Control, etc		Speed/Torque Control, Position Control

INFO

The /ZCLAMP signal can be used when an input circuit signal is allocated. See *5.3.3 Input Circuit Signal Allocation* for more details.

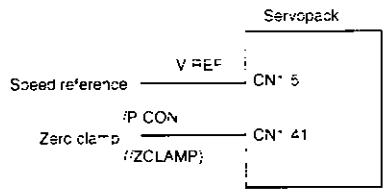Pn000 1 Setting	Control Mode
A	**Zero Clamp Control Mode** This mode allows the zero clamp function to be set when the Servomotor stops • The speed reference is input from V-REF (CN1-5) • /P-CON (/ZCLAMP)(CN1-41) is used to turn the zero clamp function ON and OFF CN1-41 is open (OFF): Turns the zero clamp function OFF CN1-41 is 0 V (ON): Turns the zero clamp function ON  Zero clamp is performed when the following two conditions are satisfied Condition 1: /P-CON (/ZCLAMP) is ON Condition 2: Speed reference is below the setting at Pn501

■ Setting

Use the following user constant to set the motor speed level at which zero clamp is performed


Pn501	Zero Clamp Level	Unit	Setting Range	Factory Setting	Speed Control
		r/min	0 to 10000	10	

Set the motor speed at which zero clamp is performed if zero clamp speed control is selected. Even if this value is set higher than the maximum speed of the Servomotor, the maximum speed will be used.

Zero Clamp Conditions

Zero clamp is performed when all the following conditions are satisfied.


- Zero clamp speed control is selected (user constant Pn000 1 is set to A).
- /P-CON (/ZCLAMP)(CN1-41) is ON (0 V).
- Speed reference drops below the setting of Pn501.

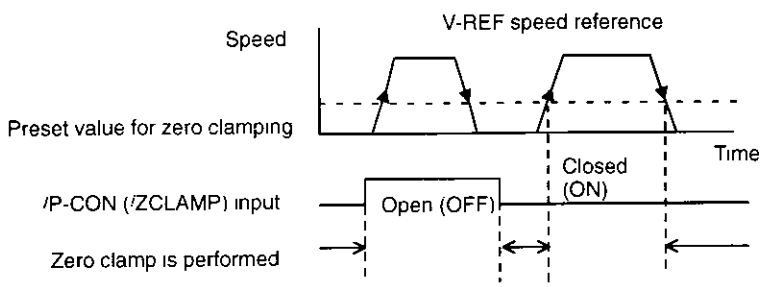

INFO When the /ZCLAMP signal is allocated the zero clamp operation will be used even for speed control (Pn000 1 = 0)

5.4.4 Using the Holding Brake

The holding brake is used when a Servodrive controls a vertical axis In other words, a Servomotor with brake prevents the movable part from shifting due to gravity when system power goes OFF

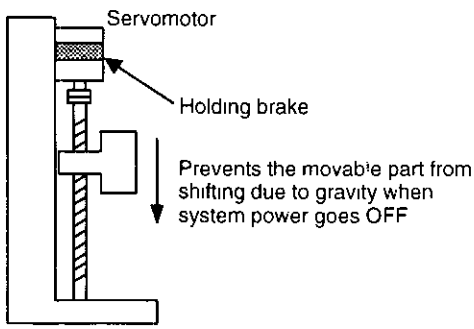


IMPORTANT The brake built into the Servomotor SGM□H with brakes is a de-energization brake which is used only to hold and cannot be used for braking Use the holding brake only to hold a stopped motor Brake torque is at least 120% of the rated motor torque

5

■ Wiring Example

Use the Servopack contact output signal /BK and the brake power supply to form a brake ON/OFF circuit The following diagram shows a standard wiring example

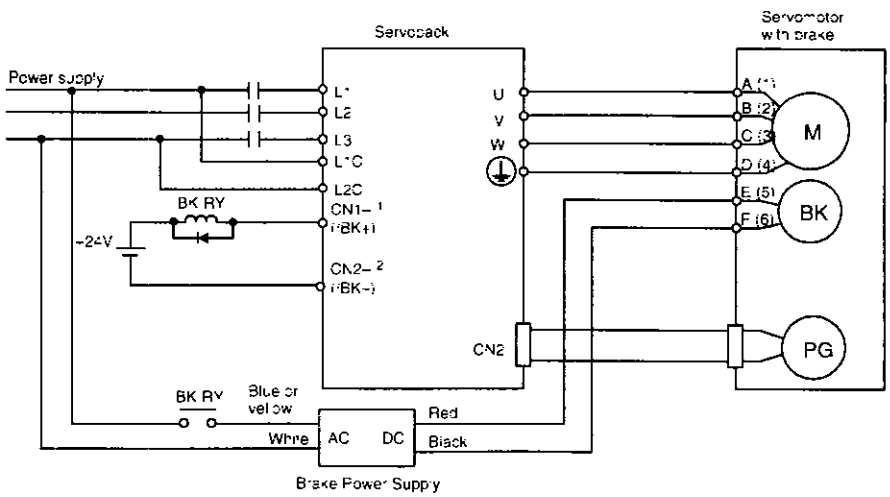

BK-RY Brake control relay

Brake power supplies are available in 200-V and 100-V models

*1 and *2 are the output terminals allocated with Pn510 0

Output → /BK	Brake Interlock Output	Speed/Torque Control, Position Control

This output signal controls the brake when using a Servomotor with a brake and does not have to be connected when using a Servomotor without a brake.


ON	Closed or low level	Releases the brake
OFF	Open or high level	Applies the brake

Related User Constants

Pn506	Time Delay from Brake Reference until Servo OFF
Pn507	Speed Level for Brake Reference Output during Motor Operation
Pn508	Timing for Brake Reference Output during Motor Operation

The output signal in the following user constant must be selected when the /BK signal is used.

Pn50F	Output Signal Selections 2	Setting Range 0000	Speed/Torque Control, Position Control

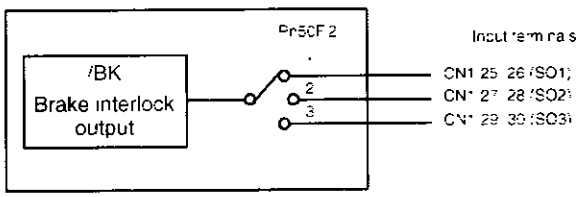

Select the /BK output terminal.

User Constant	Setting	Output Terminal (CN1)	
		*1	*2
Pn50F 2	0	–	–
	1	25	26
	2	27	28
	3	29	30


Note Signals are output with OR logic when multiple signals are allocated to the same output circuit. Set other output signals to a value other than that allocated to the /BK signal in order to output the /BK signal alone. See *5 3 4 Output Circuit Signal Allocation*.

■ Brake ON Timing

If the equipment moves slightly due to gravity when the brake is applied, set the following user constant to adjust brake ON timing

Pn506	Brake Reference Servo OFF Delay Time	Unit: 10 ms	Setting Range: 0 to 50	Factory Setting: 0	Speed/Torque Control, Position Control

This user constant is used to set the output time from the brake control signal /BK until the servo OFF operation (Servomotor output stop) when a Servomotor with a brake is used

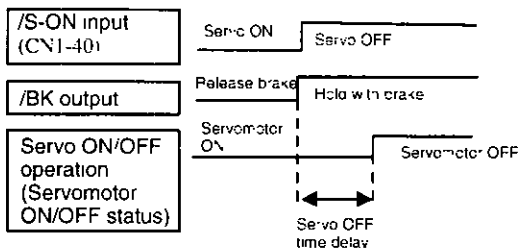

With the standard setting, the servo is turned OFF when the /BK signal (brake operation) is output The equipment may move slightly due to gravity depending on equipment configuration and brake characteristics If this happens, use this user constant to delay servo OFF timing

This setting sets the brake ON timing when the Servomotor is stopped Use Pn507 and 508 for brake ON timing during operation

IMPORTANT


The Servomotor will turn OFF immediately if an alarm occurs The equipment may move due to gravity in the time it takes for the brake to operate

■ Holding Brake Setting

Set the following user constants to adjust brake ON timing so the holding brake is applied when the Servomotor stops

Pn507	**Brake Reference Output Speed Level**	**Unit** r/min	**Setting Range** 0 to 10000	**Factory Setting** 100	**Speed/Torque Control, Position Control**
Pn508	**Timing for Brake Reference Output during Motor Operation**	**Unit** 10ms	**Setting Range** 10 to 100	**Factory Setting** 50	**Speed/Torque Control, Position Control**

Set the brake timing used when the servo is turned OFF by input signal /S-ON (CN1-40) or when an alarm occurs during Servomotor with brake operation

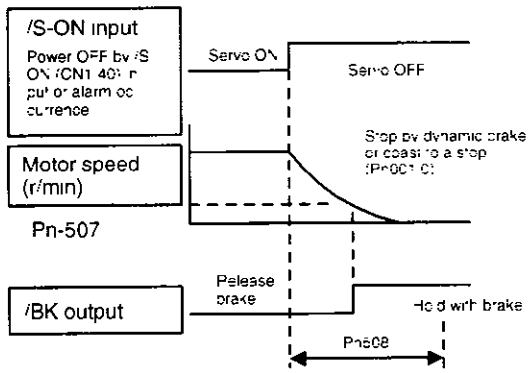

Brake ON timing when the Servomotor stops must be adjusted properly because Servomotor brakes are designed as holding brakes. Adjust the user constant settings while observing equipment operation

/BK Signal Output Conditions During Servomotor Operation

The circuit is open under either of the following conditions

1	Motor speed drops below the setting at Pn507 after servo OFF
2	The time set at Pn508 has elapsed since servo OFF


The actual setting will be the maximum speed even if Pn507 is set higher than the maximum speed

5.5 Forming a Protective Sequence

This section describes the procedure for using I/O signals from the Servopack to form a protective safety sequence

5.5.1 Using Servo Alarm and Alarm Code Outputs

The basic procedure for connecting alarm output signals is described below

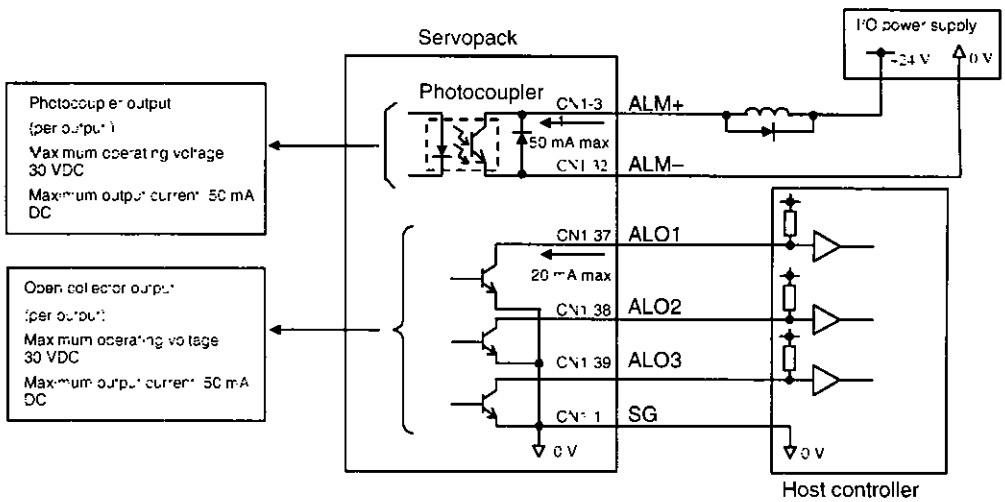


A suitable external I/O power supply must be provided by the user separately because there is no internal 24-V power supply in the Servopack

The use of the photocoupler output signals is described below

Output → ALM+ CN1-31	**Servo Alarm Output**	**Speed/Torque Control, Position Control**
Output → ALM– CN1-32	**Signal Ground for Servo Alarm Output**	**Speed/Torque Control, Position Control**

These alarms are output when a Servopack alarm is detected

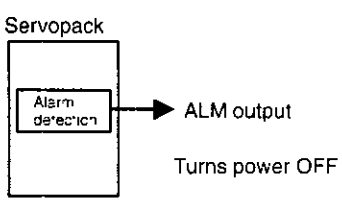

Form an external circuit so this alarm output (ALM) turns the Servopack OFF

ON	Circuit between CN1-31 and 32 is closed, and CN1-31 is at low level	Normal state
OFF	Circuit between CN1-31 and 32 is open, and CN1-31 is at high level	Alarm state

Alarm codes ALO1, ALO2 and ALO3 are output to indicate each alarm type

The uses of open-collector output signals ALO1, ALO2 and ALO3 is described below

Output → ALO1 CN1-37	**Alarm Code Output**	**Speed/Torque Control, Position Control**
Output → ALO2 CN1-38	**Alarm Code Output**	**Speed/Torque Control, Position Control**
Output → ALO3 CN1-39	**Alarm Code Output**	**Speed/Torque Control, Position Control**
Output → SG CN1-1	**Signal Ground for Alarm Code Output**	**Speed/Torque Control, Position Control**

These signals output alarm codes to indicate the type of alarm detected by the Servopack. Use these signals to display alarm codes at the host controller. See *9 2 3 Alarm Display Table* for more on the relationship between alarm display and alarm code output.

When a Servo alarm (ALM) occurs, eliminate the cause of the alarm and set the following /ALM-RST input signal to high level (ON) to reset the alarm.

→ Input /ALM-RST CN1-44	**Alarm Reset**	**Speed/Torque Control, Position Control**

The alarm reset signal is used to reset a Servo alarm.

Form an external circuit so the Servopack turns OFF when an alarm occurs. Alarms are reset automatically when the control power supply is turned OFF.


Alarms can also be reset using a Panel or Digital Operator.

IMPORTANT

1. Encoder alarms cannot always be reset by inputting the /ALM-RST signal. In that case, turn the control power supply OFF to reset the alarm.
2. When an alarm occurs, always eliminate the cause before resetting the alarm. See *9 2 1 Troubleshooting Problems with Alarm Displays* for more details on troubleshooting the system when an alarm occurs.

5.5.2 Using the Servo ON Input Signal

The basic use and wiring procedure for the Servo ON (/S-ON) input signal (sequence input signal) is described below. Use this signal to forcibly turn OFF the Servomotor from the host controller.

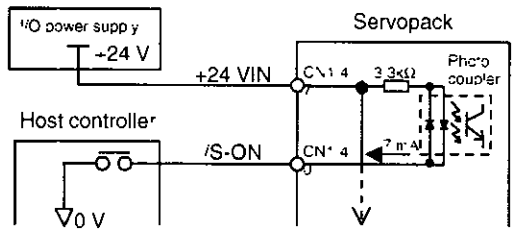

→ Input /S-ON CN1-40	Servo ON	Speed/Torque Control, Position Control


This signal is used to turn the Servomotor ON and OFF.

CN1-40 is ON (Low Level)	Turns the Servomotor ON. This is the normal state (called the Servo ON state)	**Servo ON**	**Servomotor is ON** The Servomotor operates according to signal input
CN1-40 is OFF (High Level)	The Servomotor is OFF and cannot operate (called the Servo OFF state). Do not turn the Servomotor OFF while it is operating except in an emergency.	**Servo OFF**	**Servomotor is OFF** Servomotor can not operate

IMPORTANT Do not use the Servo ON (/S-ON) signal but rather always use an input reference signal to start or stop the Servomotor.

Set the following user constant to 7 if the /S-ON signal will not be used.

Pn50A.1	/S-ON Signal Mapping	Factory Setting	Speed/Torque Control, Position Control
		0	




The external short-circuit wiring shown in the figure can be omitted if the Servo ON (/S-ON) input signal is not used.

Pn50A.1 Setting	Description
0	Enables the Servo ON (/S-ON) input signal. (The Servo is OFF when CN1-40 is open and is ON when CN1-40 is at 0 V.)
7	Disables the Servo ON (/S-ON) input signal. (The Servo is always ON and has the same effect as shorting CN1-40 to 0 V.)

Note See *5.3.3 Input Circuit Signal Allocation* for other Pn50A.1 settings.


5.5.3 Using the Positioning Completed Output Signal

The basic use and wiring procedure for the positioning completed (/COIN) output signal (photocoupler output signal) is described below. The signal is output to indicate that Servomotor operation is completed.

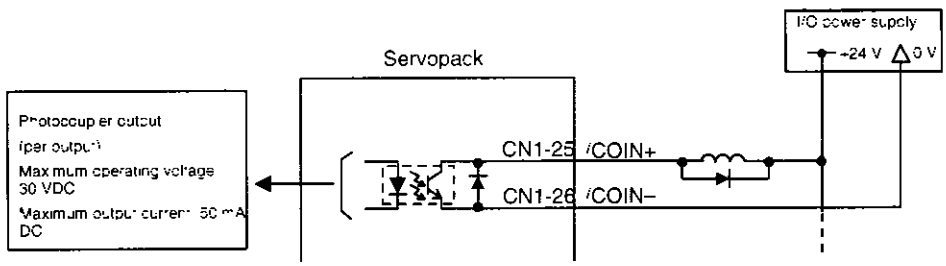

Output → /COIN: CN1-25	Positioning Completed Output Signal	Position Control

This signal indicates that Servomotor movement has been completed during position control. The host controller uses the signal as an interlock to confirm on the host controller that positioning is completed.

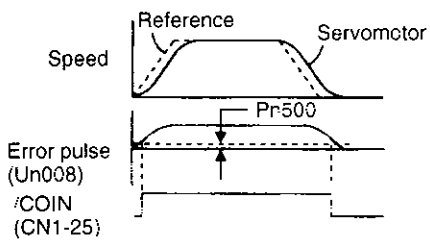

ON	Circuit between CN1-25 and 26 is closed and CN1-25 is at low level	Positioning is completed (Position error is below the setting.)
OFF.	Circuit between CN1-25 and 26 is open and CN1-25 is at high level	Positioning is not completed (Position error is above the setting.)

Setting: Pn500 (positioning completed width)

The following user constant setting is used to change the CN1 connector terminal that outputs the /COIN signal.

Pn50E	Output Signal Selections 1	Factory Setting	Position Control
		3211	

The user constant is factory set so the /COIN signal is output between CN1-25 and 26. See *5.3.4 Output Circuit Signal Allocation* for more details on user constant Pn50E.

The following user constant is used to set the number of error pulses and to adjust the output timing of the positioning completed signal.

Pn500	Positioning Completed Width	Unit. reference units	Setting Range	Factory Setting	Position Control
			0 to 250	7	

This user constant is used to set output timing for the positioning completed signal (/COIN) when the position reference pulse is input and Servomotor operation is completed

Set the number of error pulses in reference units (the number of input pulses defined using the electronic gear function)

Too large a value set at this user constant may output only a small error during low-speed operation that will cause the /COIN signal to be output continuously

The positioning completed width setting has no effect on final positioning accuracy

INFO


/COIN is a position control signal

With the factory setting, this signal is used for the speed coincidence output /V-CMP for speed control, and it is always ON for torque control

5.5.4 Speed Coincidence Output

5

The basic use and wiring procedures for the speed coincidence (/V-CMP) output signal used to indicate a match with the speed reference (photocoupler output signal) are described below The host controller uses the signal as an interlock

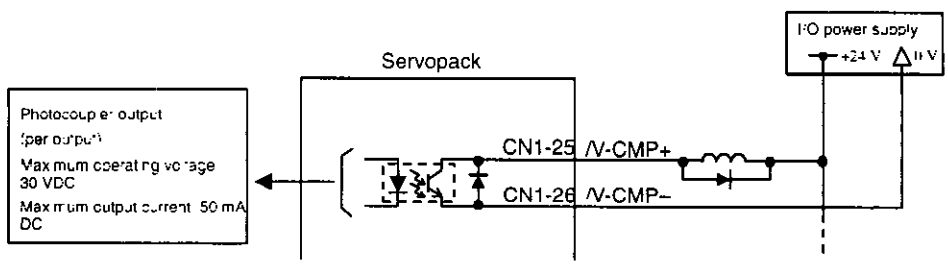


Output → /V-CMP CN1-25	Speed Coincidence Output	Speed Control

This signal is output when the actual motor speed during speed control is the same as the speed reference input

ON	Circuit between CN1-25 and 26 is closed, and CN1-25 is at low level	Speed coincides (Speed error is below the setting)
OFF	Circuit between CN1-25 and 26 is open and CN1-25 is at high level	Speed does not coincide (Speed error is above the setting)

Preset value Pn503 (Speed Coincidence Signal Output Width)

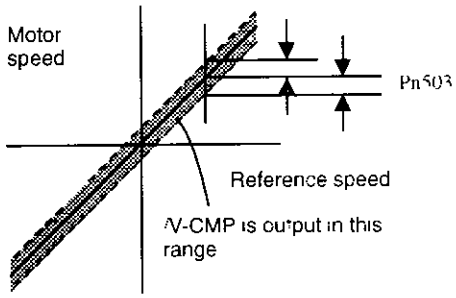

The following user constant setting is used to change the CN1 connector terminal that outputs the /V-CMP signal

Pn50E	Output Signal Selections 1	Factory Setting	Speed Control
		3211	

The user constant is factory set so the /V-CMP signal is output between CN1-25 and 26. See *5 3 4 Output Circuit Signal Allocation* for more details on user constant Pn50E.

The following user constant is used to set conditions for speed coincidence output.

Pn503	Speed Coincidence Signal Output Width	Unit	Setting Range	Factory Setting	Speed Control
		r/min	0 to 100	10	

This user constant is used to set conditions for speed coincidence signal /V-CMP output.

The /V-CMP signal is output when the difference between the speed reference and actual motor speed is below this setting.

◀EXAMPLE▶ The /V-CMP signal turns ON at 1900 to 2100 r/min if the user constant is set to 100 and the reference speed is 2000 r/min.


INFO

/V-CMP is a speed control signal.

With the factory setting this signal is used as the positioning completed signal /COIN for position control, and it is always ON for torque control.

5.5.5 Using the Running Output Signal

The basic use and wiring procedures for the running (/TGON) output signal (photocoupler output signal) are described below. The signal is output to indicate that the Servomotor is currently operating.

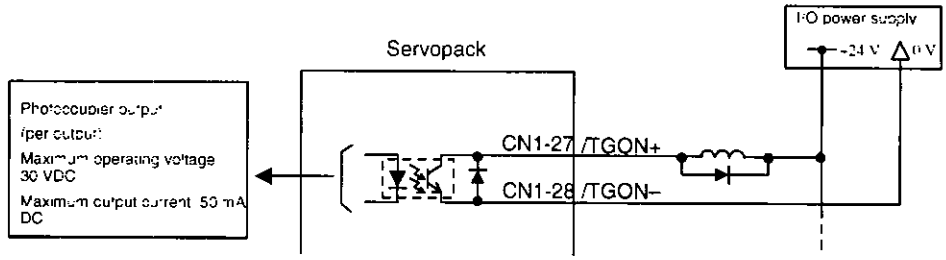


Output → /TGON CN1-27	Running Output Signal	Speed/Torque Control, Position Control

This signal is output to indicate that the Servomotor is currently operating. It is used as an external interlock.

ON	Closed or low level	Servomotor is operating (Motor speed is above the setting.)
OFF	Open or high level	Servomotor is not operating. (Motor speed is below the setting.)

Preset value: Pn502 (Running Output Level)

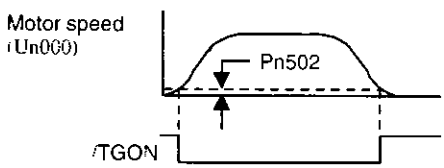

The following user constant setting is used to change the CN1 connector terminal that outputs the /TGON signal.

Pn50E	Output Signal Selections 1	Factory Setting: 3211	Speed/Torque Control, Position Control

The user constant is factory set so the /V-CMP signal is output between CN1-27 and 28. See *5.3.4 Output Circuit Signal Allocation* for more details on user constant Pn50E.

This user constant is used to set output conditions for the operation detection output signal /TGON.

Pn502	Rotation Detection Level	Unit: r/min	Setting Range: 1 to 10000	Factory Setting: 20	Speed/Torque Control, Position Control

This user constant is used to set the speed at which the Servopack determines Servomotor operation and outputs a signal. The following signals are output when motor speed exceeds the preset level.


Signals output when Servomotor operation is detected

- /TGON
- Status Indication Mode
- Monitor Mode Un006

5.5.6 Using the Servo Ready Output Signal

The basic use and wiring procedures for the Servo Ready (/S-RDY) output signal (photocoupler output signal) are described below.

Servo Ready means there are no Servo alarms and the main circuit power supply is turned ON. An added condition with absolute encoder specifications is that the SEN signal is at high level and absolute data was output to the host controller.

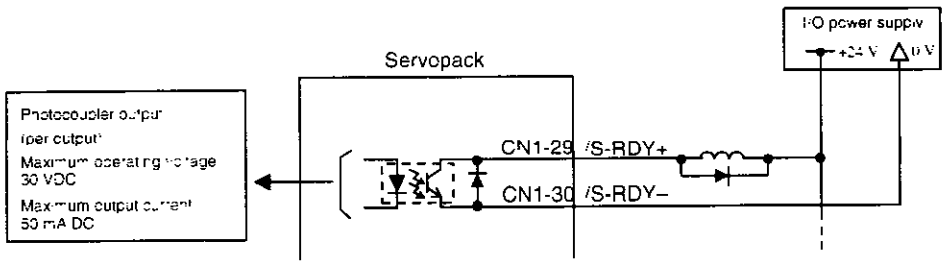

Output → /S-RDY CN1-29	Servo Ready Output Signal	Speed/Torque Control, Position Control

This signal indicates the Servopack received the Servo ON signal and completed all preparations.

ON	Closed or low level	Servo is ready
OFF	Open or high level	Servo is not ready

The following user constant setting is used to change the CN1 connector terminal that outputs the /S-RDY signal.

Pn50E	Output Signal Selections 1	Factory Setting	Speed/Torque Control, Position Control
		3211	


The user constant is factory set so the /V-CMP signal is output between CN1-29 and 30. See *5 3 4 Output Circuit Signal Allocation* for more details on user constant Pn50E.

5.5.7 Using the Warning Output Signal

The basic use and wiring procedure for the warning (/WARN) output signal (photocoupler output signal) are given below

The signal consists of the following two output signals

/WARN signals Overload and regenerative overload

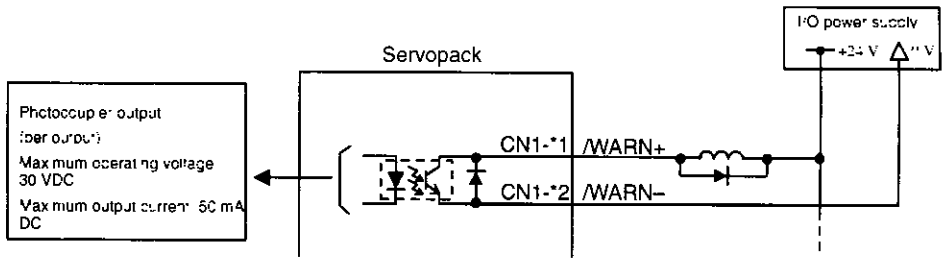

Note User constant Pn503F 3 is used to allocate output terminals for *1 and *2

Output → /WARN	Warning Output Signal	Speed/Torque Control, Position Control

This output signal indicates an overload or regenerative overload warning

OFF	Open or high level	Normal operation
ON	Closed or low level	Error warning status


The following user constant setting is used to change the CN1 connector terminal that outputs the /WARN signal

Pn50F	Output Signal Selections 2	Factory Setting	Speed/Torque Control, Position Control
		0000	

Pn50F 3 is used to allocate the /WARN output signals above

User Constant	Setting	Output Terminal (CN1-)	
		*1	*2
Pn50F 3	0	–	–
	1	25	26
	2	27	28
	3	29	30

Note Multiple signals allocated to the same output circuit are output using OR logic Set other output signals to a value other than that allocated to the /WARN signal in order to use the /WARN output signal alone See *5 3 4 Output Circuit Signal Allocation*

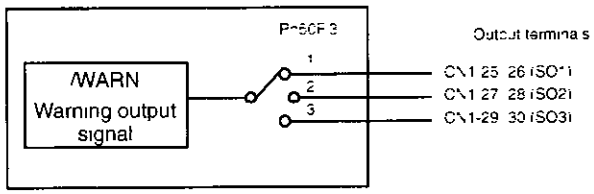

The following user constant is used to output warning details with an alarm code

Pn001 3	Warning Code Output Selection	Factory Setting	Speed/Torque Control, Position Control
		0	


Pn001 3 Setting	Description
0	Outputs alarm codes alone for alarm codes ALO1, ALO2 and ALO3
1	Outputs both alarm and warning codes for alarm codes ALO1, ALO2 and ALO3 and outputs an alarm code when an alarm occurs

The following warning codes are output in 3 bits

Warning Indication	Warning Code Output			Warning Description
	ALO1	ALO2	ALO3	
A.91	ON signal (low level)	OFF signal (high level)	OFF signal (high level)	Overload
A.92	OFF signal (high level)	ON signal (low level)	OFF signal (high level)	Regenerative overload

5.5.8 Using the Near Output Signal

The basic use and wiring procedures for the near (/NEAR) output signal (photocoupler output signal) are described below. The signal is a sequence signal that is generally output together with the positioning completed signal (/COIN), and it is used to indicate the Servomotor is close to completing operation.

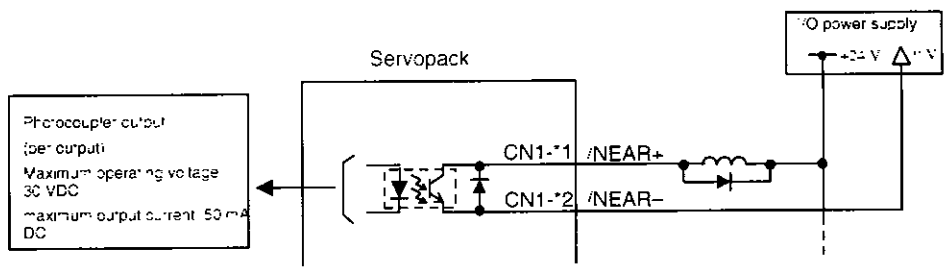

*1 and *2 are the output terminals allocated with Pn510.0

Output → /NEAR	Near Output Signal	Position Control

The Servopack receives the near signal before the host controller checks the positioning completed signal and prepares the following sequence signal in order to reduce the number of operations required to complete Servomotor operation during position control.

ON	Closed or low level	The Servomotor is close to completing operation (Position error is below the near signal setting range)
OFF	Open or high level	The Servomotor is not close to completing operation (Position error is above the near signal setting range)

Setting Pn504 (near signal width)

To use the /NEAR signal, an output terminal must be allocated using the user constant below

Pn510	Output Signal Selections 3	Factory Setting	Position Control
		0000	

Pn510 0 is used to allocate the /NEAR output signals above


User Constant	Setting	Output Terminal (CN1-)	
		*1	*2
Pn510 0	0	–	–
	1	25	26
	2	27	28
	3	29	30

Note Multiple signals allocated to the same output circuit are output using OR logic Set other output signals to a value other than that allocated to the /NEAR signal in order to use the /NEAR output signal alone See *5 3 4 Output Circuit Signal Allocation*

The following user constant is used to set the timing for /NEAR signal output

Pn504	NEAR Signal Width	Unit	Setting Range	Factory Setting	Position Control
		reference units	1 to 250	7	

Generally set the near signal width higher than the positioning completed width Also see *5 5 3 Using the Positioning Completed Output Signal*

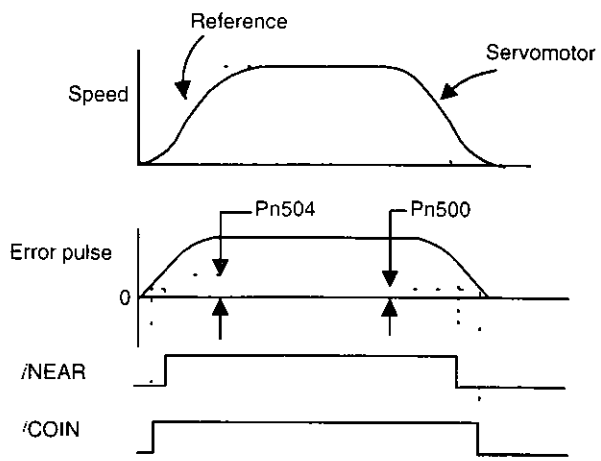

5.5.9 Handling Power Loss

The following user constant is used to specify whether the Servomotor holds or continues when a power loss occurs


Pn509	Momentary Hold Time	Unit	Setting Range	Factory Setting	Speed/Torque Control, Position Control
		ms	20 to 1000	20	

The Servopack turns the Servomotor OFF if it detects an instantaneous voltage drop in the power supply This factory setting of 20 ms means that Servomotor operation will continue if power is lost for less than 20 ms

In the following instances, however, a Servo alarm is generated or control is lost (equivalent to normal power OFF operation) regardless of the user constant setting

- When an insufficient voltage alarm (A 41) occurs during power loss with a large Servomotor load
- When control is lost (equivalent to normal power OFF operation) with loss of the control power supply

In power loss detection, the status of the main circuit power supply is detected and OFF status is ignored so Servomotor operation will continue if the Servomotor turns back ON within the time set at user constant Pn509

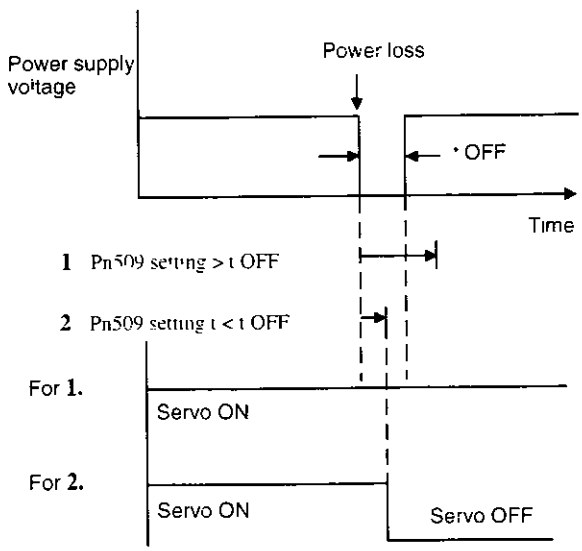

5.6 Selecting a Regenerative Resistor

When the Servomotor is driven in generator mode, power is returned to the Servopack. This is called regenerative power. The regenerative power is absorbed by charging the smoothing capacitor, but when the chargeable energy is exceeded, the regenerative power is further consumed by the regenerative resistor.

The Servomotor is driven in regeneration (generator) mode in the following circumstances.

- While decelerating to a stop during acceleration and deceleration operation
- With a load on the vertical axis
- During continuous operation with the Servomotor rotated from the load side (negative load)

The capacity of the Servopack's built-in regenerative resistor is sufficient for short-time operation only, such as for the deceleration stop period. Operation under a negative load is not possible.

If the regenerative power exceeds the processing capacity of the Servopack, then install an external regenerative resistor. The following table shows the specifications of the Servopack's built-in resistor and the amount of regenerative power (average values) that it can process.

Applicable Servopacks		Specifications of Built-in Resistor		Regenerative Power Processed by Built-in Resistor* (W)	Minimum Allowable Resistance (Ω)
		Resistance (Ω)	Capacity (W)		
200 V	SGDM-A3AD to -04AD SGDM-A3ADA to -04ADA	–	–	–	40
	SGDM-05AD to -10AD SGDM-05ADA to -10ADA	50	60	12	40
	SGDM-15AD, -15ADA	30	70	14	20
	SGDM-20AD, -20ADA	25	140	28	12
	SGDM-30AD, -30ADA	12.5	140	28	12
	SGDM-50ADA	8	280	56	8
	SGDM-60ADA	(6.25)*2	(880)*2	(180)*2	5.8
	SGDM-75ADA	(3.13)*3	(1760)*3	(350)*3	2.9
100 V	SGDM-A3BD to -02BD SGDM-A3BDA to -02BDA	–	–	–	40

Note 1 The average regenerative power that can be handled is 20% of the rated capacity of the regenerative resistor built into the Servopack.

2 The values in parentheses are for the optional JUSP-RA04 Regenerative Resistor Unit.

3 The values in parentheses are for the optional JUSP-RA05 Regenerative Resistor Unit.

When installing an external regenerative resistor, make sure that the resistance is the same as that of the Servopack's built-in resistor. If combining multiple small-capacity regenerative resistors to in-

crease the regenerative resistor capacity (W) select resistors so that the resistance value including error is at least as high as the minimum allowable resistance shown in the above table

5.6.1 External Regenerative Resistors

When installing an external regenerative resistor, a user constant setting must be changed as shown below

Pn600	Regenerative Resistor Capacity	Unit	Setting Range	Factory Setting	Speed/Torque Control, Position Control
		10 W	0 to Servopack capacity	0	

The factory setting of "0" in the above table is the set value used when the Servopack's built-in resistor is used or when a Servopack without a built-in resistor is used

When installing an external regenerative resistor set the regenerative resistor's capacity (W)

◀EXAMPLE▶ When the external regenerative resistor's actual consumable capacity is 100 W, set the user constant to 10

5

IMPORTANT


1. In general, when resistors for power are used at the rated load ratio, the resistor temperature increases to between 200°C and 300°C The resistors must be used at or below the rated values Check with the manufacturer for the resistor's load characteristics Use resistors at no more than 20% of the rated load ratio with natural convection cooling and no more than 50% of the rated load ratio with forced air cooling
2. For safety's sake it is recommended that resistors with thermoswitches be used

■ Connecting Regenerative Resistors

The method for connecting regenerative resistors is shown below


Servopacks with Capacities of 400 W or Less

Connect an external regenerative resistor between the Servopack's B1 and B2 terminals

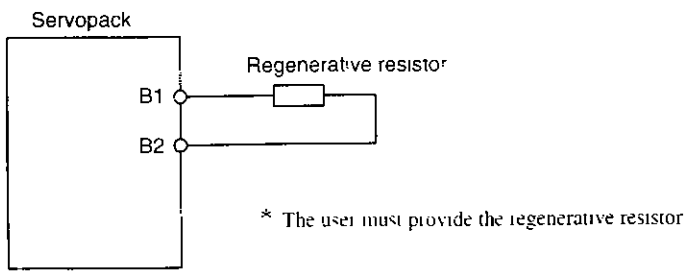

Servopacks with Capacities of 0.5 to 5.0 kW

Disconnect the wiring between the Servopack's B2 and B3 terminals and connect an external regenerative resistor between the B1 and B2 terminals

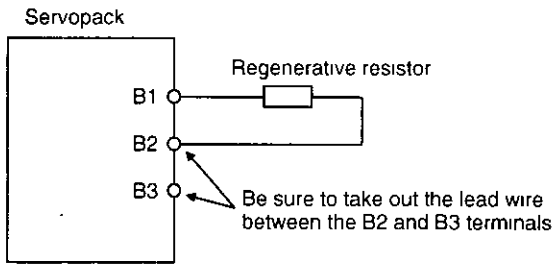


* The user must provide the regenerative resistor

Servopacks with Capacities of 6.0 kW or More

Servopacks with capacities of 6 0 kW or more do not have regenerative resistors built in A regenerative resistor must be connected externally The following Regenerative Resistor Units are available for this purpose

Servopack	Applicable Regenerative Resistor Unit	Resistance (Ω)	Specifications
SGDM-60ADA	JUSP-RA04	6 25	25 Ω (220 W) × 4 resistors in parallel
SGDM-75ADA	JUSP-RA05	3 13	25 Ω (220 W) × 8 resistors in parallel

Connect the Servopack and Regenerative Resistor Unit as shown in the following diagram

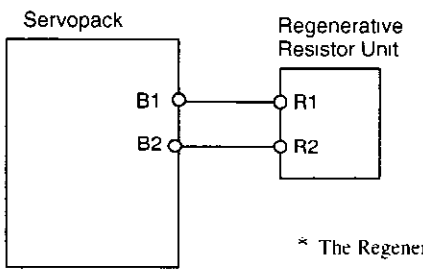

* The Regenerative Resistor Unit is sold as an option

IMPORTANT

Regenerative resistors reach high temperatures so be careful to cool them Also use heat-resistant. non-flammable wiring and make sure that the wiring does not come into contact with the resistors

5.6.2 Calculating the Required Capacity of Regenerative Resistors

■ By Means of a Simple Calculation

When driving a Servomotor normally with the horizontal axis, check the external regenerative resistor requirements using the calculation method shown below

Servopacks with Capacities of 400 W or Less

Servopacks with capacities of 400 W or less do not have built-in regenerative resistors The energy that can be charged by capacitors is shown in the following table If the rotational energy in the servo system exceeds these values, then connect a regenerative resistor externally

Voltage	Applicable Servopacks	Regenerative Energy that Can be Processed (joules)	Remarks
200 V	SGDM-A3AD,-A5AD -A3ADA -A5ADA	18 5	Value when input voltage is 200 VAC
	SGDM-01AD to -04AD -01ADA -04ADA	37 1	
100 V	SGDM-A3BD -A3BDA	7 8	Value when input voltage is 100 VAC
	SGDM-A5BD to -02BD -A5BDA, -02BDA	15 7	

Calculate the rotational energy in the servo system from the following equation

$E_S = J \times (N_M)^2/182$ (joules)

- $J = J_M + J_L$
- J_M Servomotor rotor inertia (kg m^2) (oz in s^2)
- J_L Motor axis conversion load inertia (kg m^2) (oz in s^2)
- N_M Rotation speed used by Servomotor (r/min)

Servopacks with Capacities of 0.5 to 5.0 kW

Servomotors with capacities of 0 5 to 5 0 kW have built-in regenerative resistors The allowable frequencies for just the Servomotor in acceleration and deceleration operation, during the rotation speed cycle from 0 to the maximum rotation speed to 0. are summarized in the following table

Convert the data into the values obtained with actual rotation speed used and load inertia to determine whether an external regenerative resistor is needed

Series / Capacity Symbol	03	05	06	08	09	10	12	13	15	20	30
	Allowable Frequencies in Regeneration Mode (r/min)										
SGMAH	–	–	–	89	–	–	–	–	–	–	–
SGMPH	–	–	–	29	–	–	–	–	17	–	–
SGMGH-□A□A	–	34	–	–	13	–	–	10	–	12	8
SGMGH-□A□B	96	–	39	–	22	–	15	–	–	20	13
SGMSH	–	–	–	–	–	39	–	–	31	48	20

Series	Allowable Frequencies in Regeneration Mode (r/min)				
Capacity Symbol	22	32	40	44	50
SGMGH-□A□A	–	–	–	11	–
SGMGH-□A□B	–	–	–	20	–
SGMSH	–	–	29	–	22
SGMDH	7	11	8	–	–

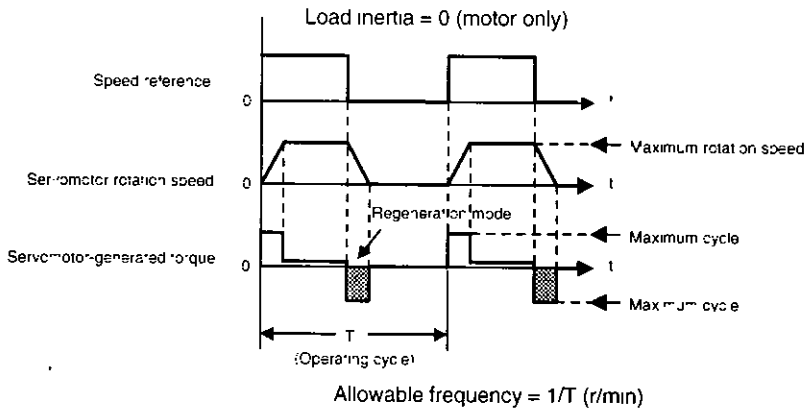


Figure 5 1 Operating Conditions for Allowable Regenerative Frequency Calculation

Use the following equation to calculate the allowable frequency for regeneration mode operation

$$\text{Allowable frequency} = \frac{\text{Allowable frequency for Servomotor only}}{(1 + n)} \times \left(\frac{\text{Max rotation speed}}{\text{Rotation speed used}}\right)^2 \text{(r/min)}$$

- $n = J_L/J_M$
- J_M Servomotor rotary inertia (kg m^2) (oz in s^2)
- J_L Motor axis conversion load inertia (kg m^2) (oz in s^2)

Servopacks with Capacities of 6.0 kW or More


Servopacks with capacities of 6 0 kW or more do not have built-in regenerative resistors The following table shows the allowable frequencies in regeneration mode when the Servopack is combined with the JUSP-RA04 or JUSP-RA05 Regenerative Resistor Unit

The equation used to calculate the allowable frequency from the Servomotor drive conditions and load inertia are the same as the one give above for Servopack with capacities of 0 5 to 5 0 kW

Series	Allowable Frequencies in Regeneration Mode (r/min)		
Capacity Symbol	55	60	75
SGMGH-□A□A	26	–	36
SGMGH-□A□B	–	44	–

■ By Calculating the Regenerative Energy

This section shows the procedure for calculating the regenerative resistor capacity when acceleration and deceleration operation is as shown in the following diagram

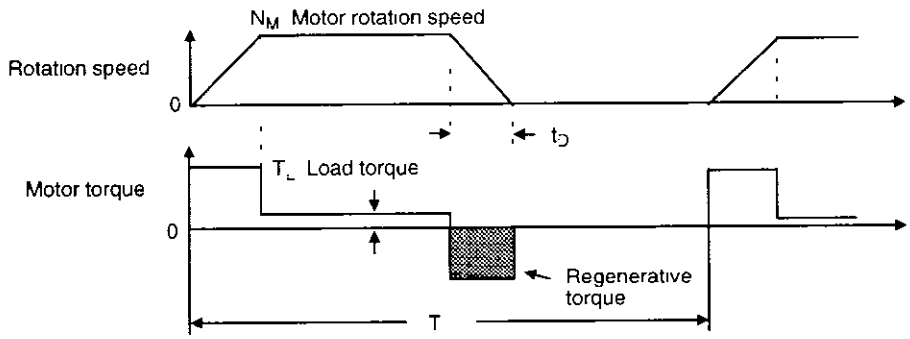

Calculation Procedure

The procedure for calculating the capacity is as follows

Step	Item	Symbol	Equation
1	Find the rotational energy of the servo system	E_S	$E_S = JN_M^2/182$
2	Find the energy consumed by load system loss during the deceleration period	E_L	$E_L = (\pi/60)\, N_M T_L t_D$
3	Calculate the energy lost from Servomotor winding resistance	E_M	(Value calculated from Servomotor Winding Resistance Loss' diagrams) × t_D
4	Calculate the servoamp energy that can be absorbed	E_C	Calculate from the Absorbable Servoamp Energy" diagrams
5	Find the energy consumed by the regenerative resistor	E_K	$E_K = E_S - (E_L+E_M+E_C)$
6	Calculate the required regenerative resistor capacity	W_K	$W_K = E_K/(0.2\times T)$

Note 1 The 0.2 in the equation for calculating W_K is the value for when the regenerative resistor's utilized load ratio is 20%.

2 The units for the various symbols are as follows

E_S to E_K Energy joules (J) T_L Load torque (N m) (oz in)

W_K Regenerative resistor required capacity (W) t_D Deceleration stopping time (s)

J (= $J_M - J_L$)(kg m^2) (oz in s^2) T Servomotor repeat operation period (s)

N_M Rotation speed used by Servomotor (r/min)

If the above calculation determines that the amount of regenerative power (Wk) that can be processed by the built-in resistor is not exceeded, then an external regenerative resistor is not required.

If the amount of regenerative power that can be processed by the built-in resistor is exceeded, then install an external regenerative resistor for the capacity obtained from the above calculation.

If the energy consumed by load system loss (in step 2 above) is unknown, then perform the calculation using $E_L = 0$.

When the operation period in regeneration mode is continuous, add the following items to the above calculation procedure in order to find the required capacity (W) for the regenerative resistor.

- Energy for continuous regeneration mode operation period E_G (joules)
- Energy consumed by regenerative resistor $E_K = E_S - (E_L + E_M + E_C) + E_G$
- Required capacity of regenerative resistor $W_K = E_K / (0.2 \times T)$


Here, $E_G = (2\pi/60) N_{MG} T_G t_G$

- T_G Servomotor's generated torque (N·m) (oz·in) in continuous regeneration mode operation period
- N_{MG} Servomotor rotation speed (r/min) for same operation period as above
- t_G Same operation period (s) as above


Servomotor Winding Resistance Loss

The following diagrams show the relationship, for each Servomotor, between the Servomotor's generated torque and the winding resistance loss.


- **SGMAH Servomotor, 200 V**

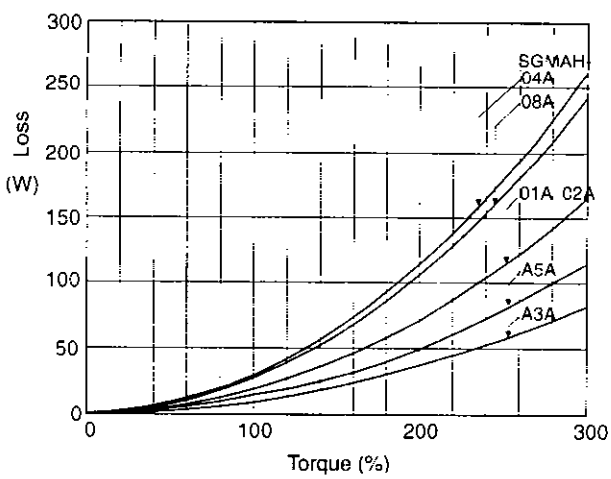


- **SGMAH Servomotor, 100 V**

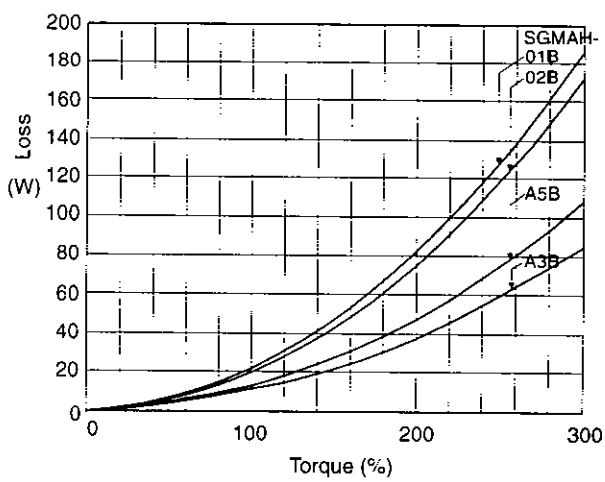


- **SGMPH Servomotor, 200 V**

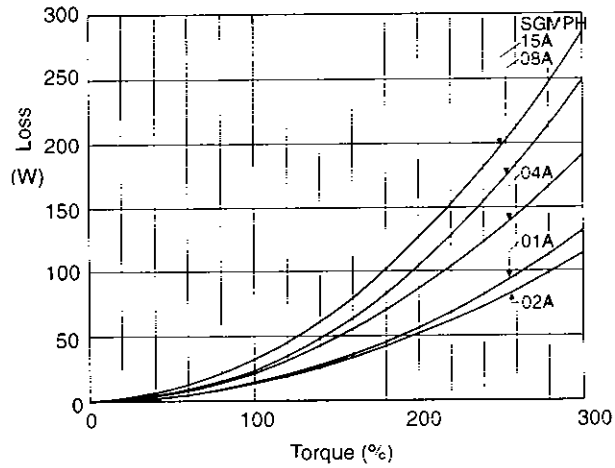


- **SGMPH Servomotor. 100 V**

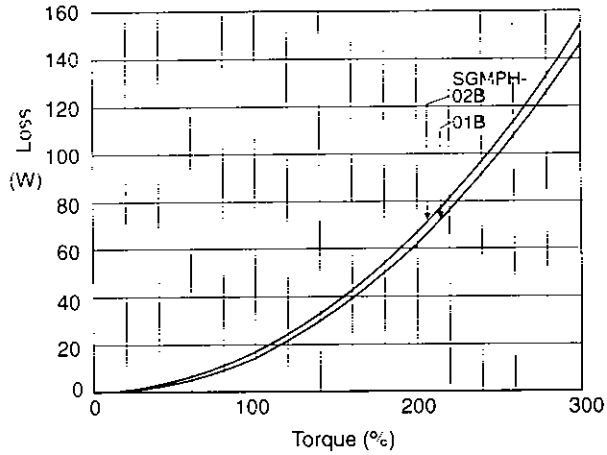


- **SGMGH Servomotor, 1500 r/min**

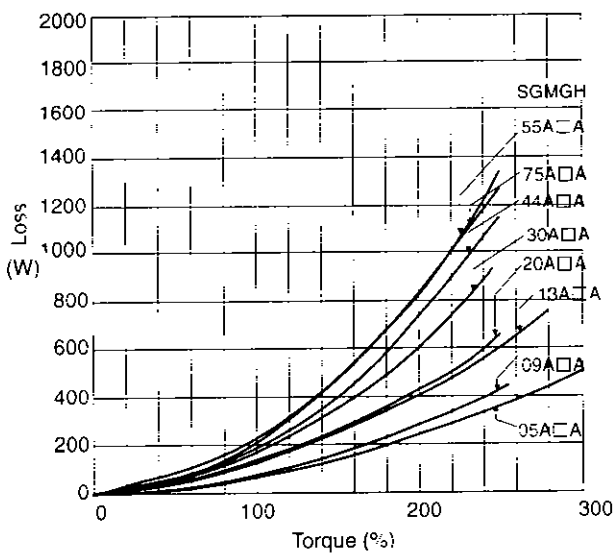


- **SGMGH Servomotor, 1000 r/min**

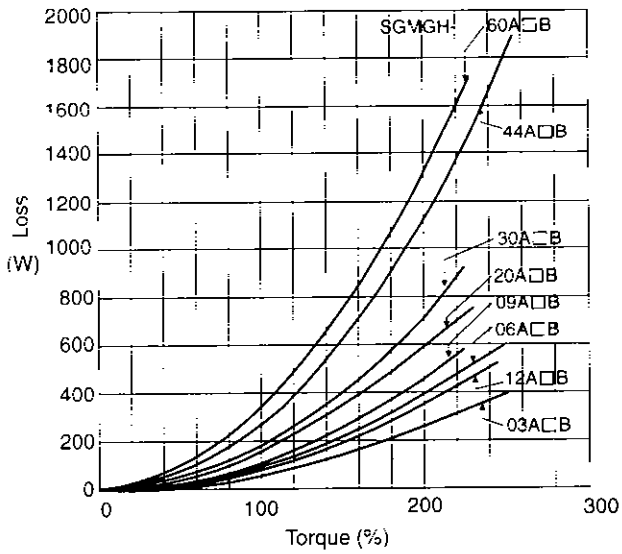

- **SGMSH Servomotor**

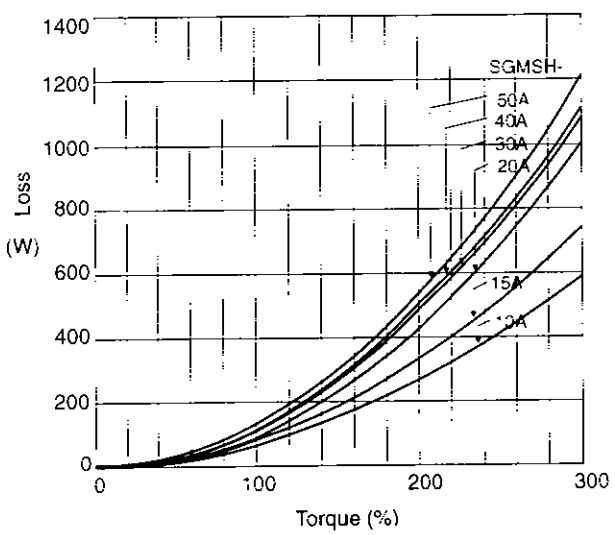


- **SGMDH Servomotor**

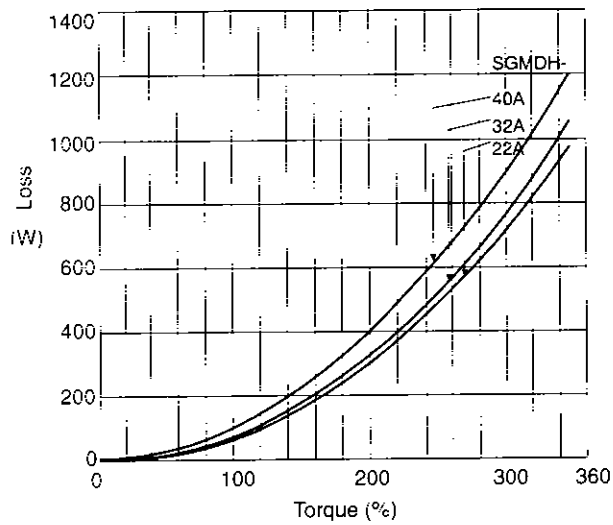


Servopack's Absorbable Energy

The following diagrams show the relationship between the Servopack's input power supply voltage and its absorbable energy


- **Servopack for 200 V**

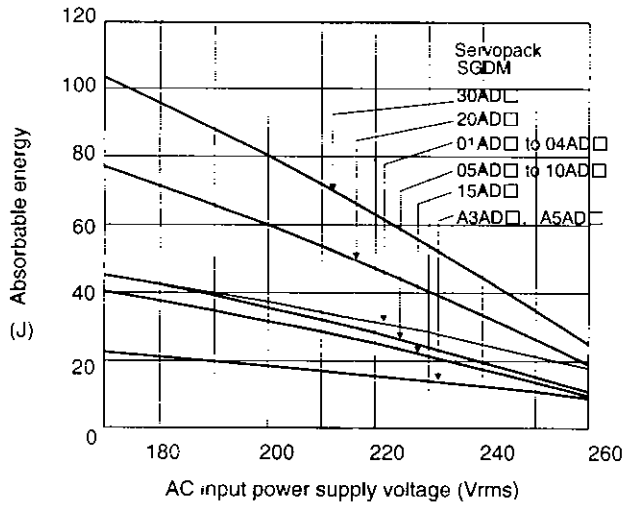

- **Servopack for 200 V, Continued**

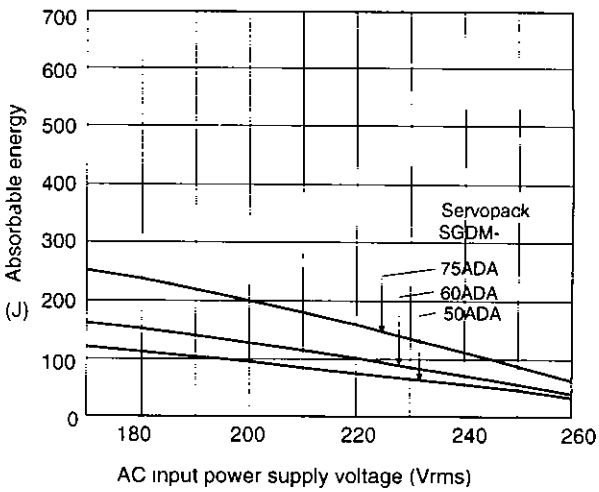

- **Servopack for 100 V**

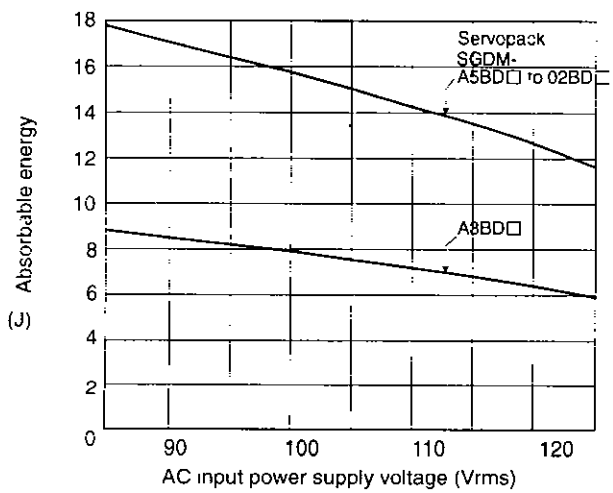


5

5.7 Absolute Encoders

If a motor with an absolute encoder is used a system to detect the absolute position can be made in the host controller If such a system is to be combined with a host controller. use a Servomotor with an absolute encoder Consequently. operation can be performed without origin return operation immediately after the power is turned ON

Motor SGM□H-□□□1□ With 16-bit absolute encoder
SGM□H-□□□2□ With 17-bit absolute encoder

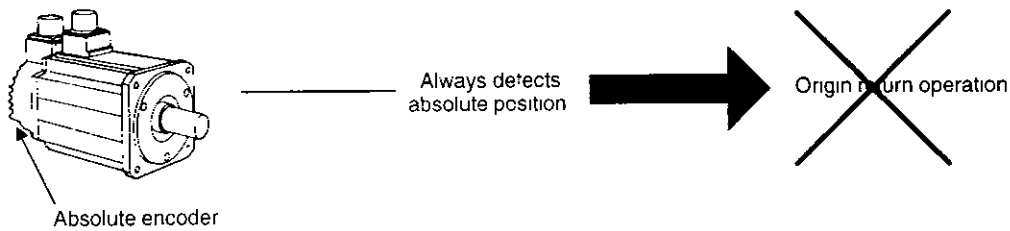

⚠ WARNING


- The output range of multiturn data for Σ- II series absolute detection system differs from that for conventional systems (15-bit encoder and 12-bit encoder) Specially when "Infinite length positioning system" of conventional type is to be configured with Σ - II series. be sure to make the following system modification

Absolute Encoder Type	Output Range of Multiturn Data	Motion When Exceeds the Limit
Conventional Types (12-bit and 15-bit)	-99999 to +99999	• When exceeds the upper limit (+99999) in the positive direction the multiturn data is 0 • When exceeds the lower limit (-99999) in the negative direction the multiturn data is 0
Σ- II Series (16-bit and 17-bit)	-32768 to +32767	• When exceeds the upper limit (+32767) in the positive direction the multiturn data is -32768 • When exceeds the lower limit (-32768) in the negative direction the multiturn data is +32767 *

* When the multiturn limit setting (Pn205) is changed the motion differs Refer to *5 7 6 Multiturn Limit Setting*

5.7.1 Interface Circuit


The following diagram shows the standard connections for an absolute encoder mounted to a Servomotor

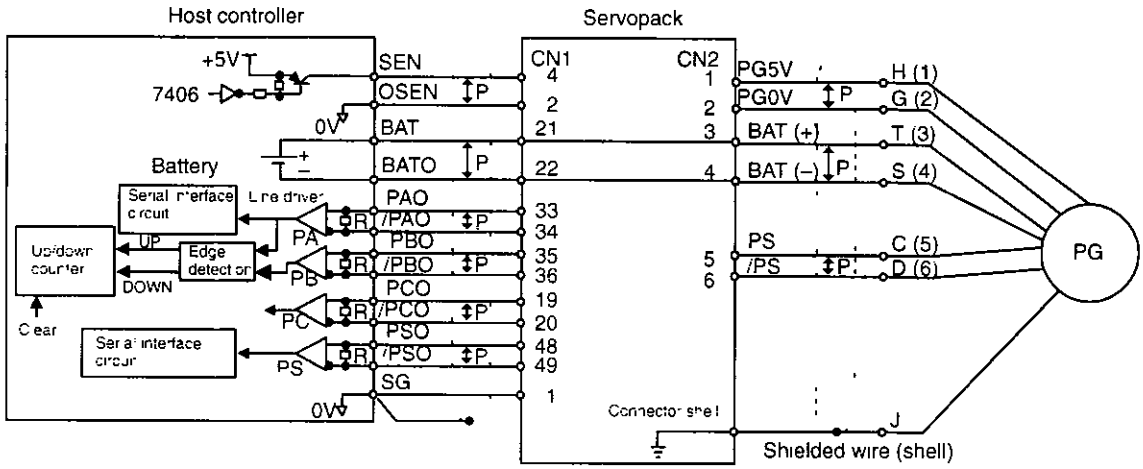

Applicable line drivers SN75175 or MC3486 by T/I

Terminating resistance R 220 to 470 Ω

■ SEN Signals

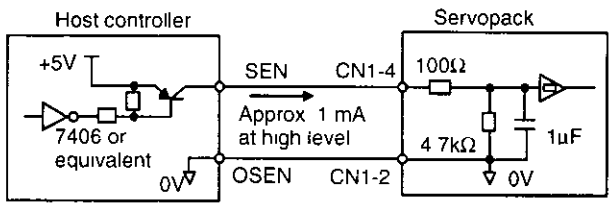

PNP is recommended for transistors


Signal Levels

High level 4.0 V min Low level 0.8 V max

- Let at least three seconds elapse after turning on the power before raising the SEN signal to high level
- When the SEN signal is changed from low level to high level, the multi-turn data and initial incremental pulses are output
- Until these operations are completed, the motor cannot be operated regardless of the status of the servo ON signal (/S-ON)

IMPORTANT

If for some reason it is necessary to turn OFF a SEN signal that is already ON, and then to turn it back ON again, maintain the high level for at least 1.3 seconds before turning it ON and OFF

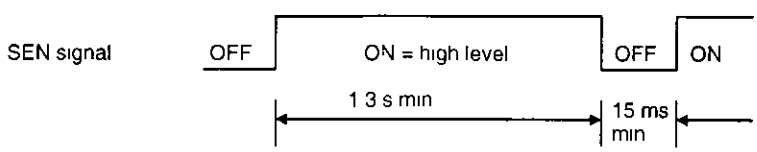

5.7.2 Selecting an Absolute Encoder

Select the absolute encoder usage with the following user constant

Pn002 2	Absolute Encoder Usage	Factory Setting	Speed, Torque Control,
		0	Position Control

0" in the following table must be set to enable the absolute encoder

Pn002 2 Setting	Contents
0	Use the absolute encoder as an absolute encoder
1	Use the absolute encoder as an incremental encoder

Note This user definition goes into effect when the power is turned OFF after the change has been made

5.7.3 Handling Batteries

In order for the absolute encoder to retain position data when the power is turned OFF, the data must be backed up by a battery

■ Installing the Battery at the Host Device

Lithium battery, by Toshiba ER6VC3 3 6 V, 2000 mAh

■ Battery Provided for Servopack

Lithium battery JZSP-BA01 (includes battery and connector)

Battery Toshiba ER3 V, 3 6 V, 1000 mAh

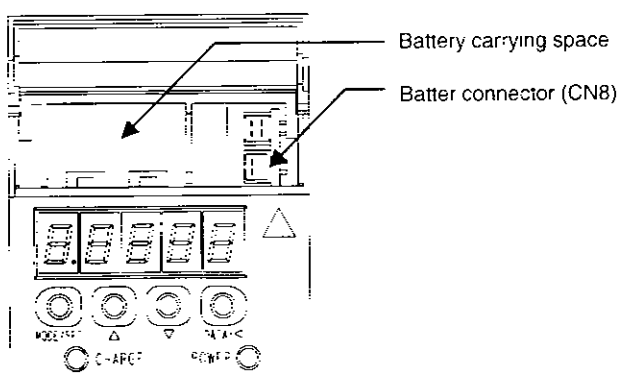


Figure 5 2 Servopacks with Capacities of 30 W to 5 0 kW

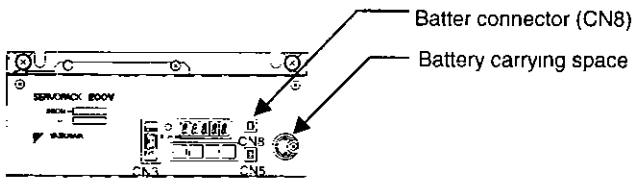


Figure 5 3 Servopacks with Capacities of 6 0 or 7.5 kW

⃠ PROHIBITED

- Install the battery at either the host controller or the Servopack It is dangerous to install batteries at both simultaneously. because that sets up a loop circuit between the batteries

5.7.4 Absolute Encoder Setup

Perform the setup operation for the absolute encoder in the following circumstances

- When starting the machine for the first time
- When an encoder backup alarm is generated
- When the Servopack's power supply is turned OFF and the encoder's cable is removed

The setup operation can be performed by using the Hand-held Digital Operator or the Servopack's Panel Operator. or else personal computer monitor software can be employed

The setup operation procedure shown here uses the Digital Operator For more details. refer to *Chapter 7 Using the Digital Operator*

INFO The absolute encoder setup operation is only possible when the servo is OFF After the setup processing is finished turn the power back ON again

■ Setup Using the Hand-held Digital Operator


1. Press the DSPL/SET Key to select the auxiliary function mode




2. Select the user constant Fn008 Press the Left or Right Cursor Key to select the digit to set. and then press the Up or Down Cursor Key to change the number




3. Press the DATA/ENTER Key The following display will appear



4. Pressing the Up Cursor Key will change the display as shown below Continue pressing the Up Cursor Key until PGCL5 is displayed If an erroneous key entry is made, "nO_OP" will flash for one second and the display will return to the auxiliary function mode In that case, go back to step 3 above and perform the operation again

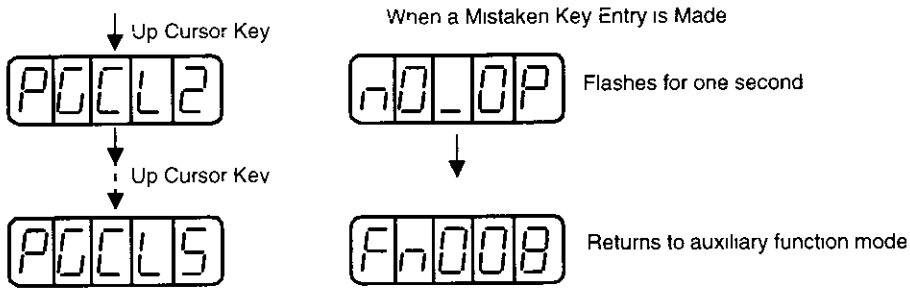

5 When "PGCL5" is displayed, press the DSPL/SET Key The display will change as follows, and the absolute encoder's multi-turn data will be cleared



6. Press the DATA/ENTER Key to return to the auxiliary function mode



This completes the absolute encoder's setup operation Turn the power OFF and then back ON again

■ Setup Using the Built-in Panel Operator

1. Press the DSPL/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn008




3. Press the DATA/SHIFT Key for at least one second The following display will appear



4 Pressing the Up Cursor Key will change the display as shown below Continue pressing the Up Cursor Key until "PGCL5" is displayed If an erroneous key entry is made, "nO_OP" will flash for one second and the display will return to the auxiliary function mode In that case, go back to step 3 above and perform the operation again

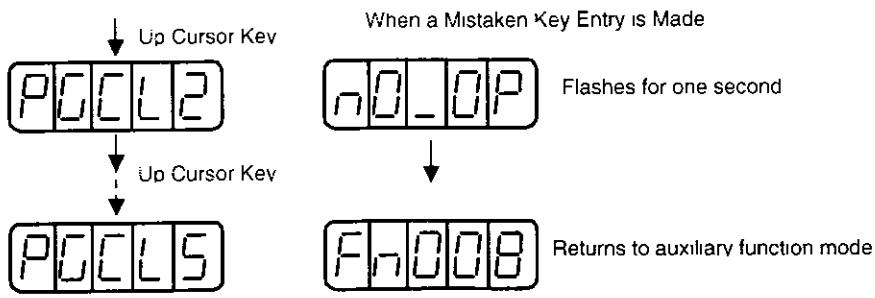

5. When "PGCL5" is displayed, press the MODE/SET Key. The display will change as follows, and the absolute encoder's multi-turn data will be cleared.



6. Press the DATA/SHIFT Key to return to the auxiliary function mode.



This completes the absolute encoder's setup operation. Turn the power OFF and then back ON again.

IMPORTANT

If the following absolute encoder alarms are displayed, the alarms must be cleared using the method described above for the setup operation. They cannot be cleared by the Servopack's alarm reset (/ARM-RST) input signal.

- Encoder backup alarm (A.81)
- Encoder sum check alarm (A.82)

In addition, if a monitoring alarm is generated in the encoder, the alarm must be cleared by turning OFF the power.


5.7.5 Absolute Encoder Reception Sequence

The sequence in which the Servopack receives outputs from the absolute encoder and transmits them to the host device is shown below.

Be sure you understand this section when designing the host device.

■ Outline of Absolute Signals


The absolute encoder's outputs are PAO, PBO, PCO, and PSO signals as shown below.

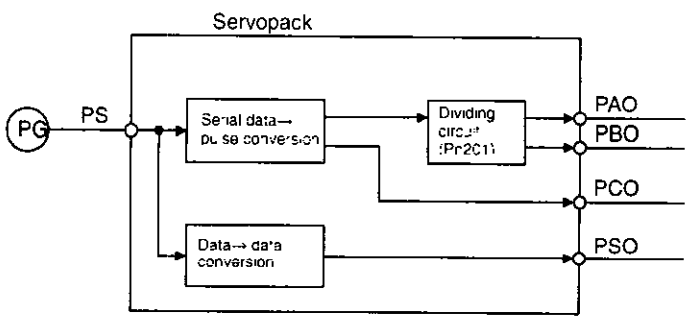

Signal Name	Status	Signal Contents
PAO	Initial state	Serial data
		Initial incremental pulse
	Normal state	Incremental pulse
PBO	Initial state	Initial incremental pulse
	Normal state	Incremental pulse
PCO	Normal state	Origin pulse
PSO	Normal state	Rotation count serial data

■ Contents of Absolute Data

- Serial data Indicates how many turns the motor shaft has made from the reference position (position specified at setup)
- Initial incremental pulse Outputs pulses at the same pulse rate as when the motor shaft rotates from the origin to the current position at approximately 2500 r/min (for 16 bits when the dividing pulse is at the factory setting)

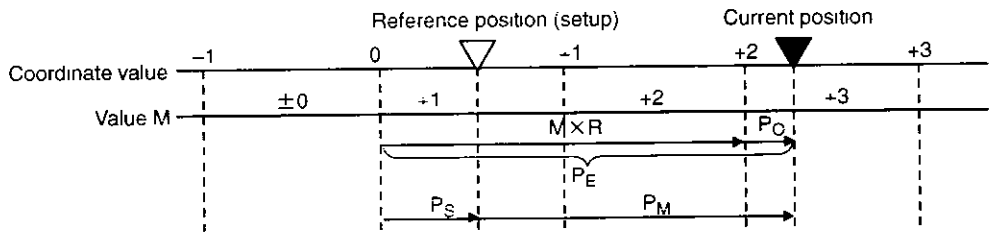

The final absolute data P_M can be found by using the following formula

$P_E = M \times R + P_O$

$P_M = P_E - P_S$

Use the following for reverse rotation mode (Pn000.0 = 1)


$P_E = -M \times R + P_O$

$P_M = P_E - R_S$

P_E	Current value read by encoder
M	Multi-turn data (rotation count data)
P_O	Number of initial incremental pulses
P_S	Number of initial incremental pulses read at setup (This is saved and controlled by the host controller.)
P_M	Current value required for the user's system
R	Number of pulses per encoder revolution (pulse count after dividing value of Pn201)

■ Absolute Encoder Transmission Sequence

1. Set the SEN signal at high level
2. After 100 ms set the system to serial data reception-waiting-state Clear the incremental pulse up/down counter to zero
3. Receive eight bytes of serial data
4. The system enters a normal incremental operation state approximately 50 ms after the last serial data is received

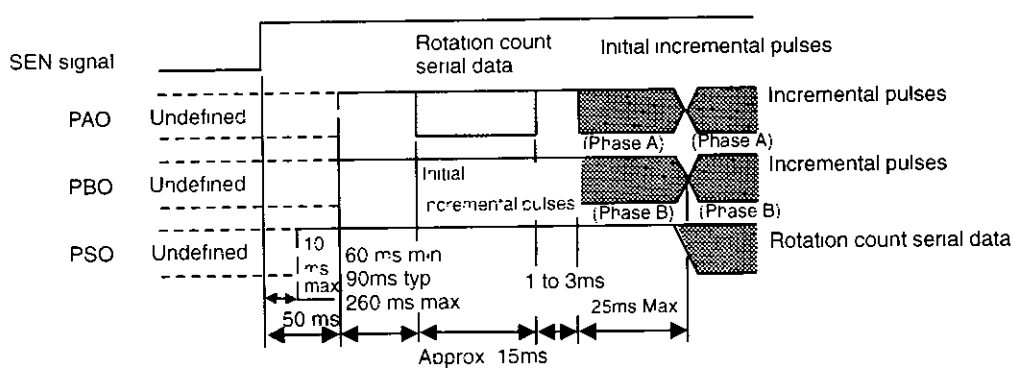


■ Detailed Signal Specifications

PAO Serial Data Specifications

The number of revolutions is output in five digits

Data Transfer Method	Start-stop Synchronization (ASYNC)
Baud rate	9600 bps
Start bits	1 bit
Stop bits	1 bit
Parity	Even
Character code	ASCII 7-bit code
Data format	8 characters, as shown below

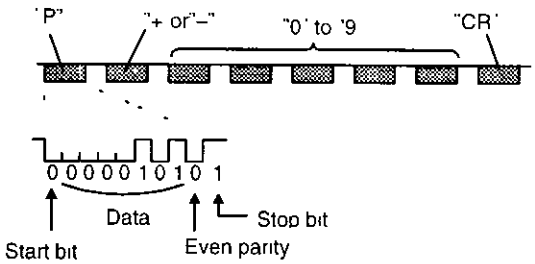


Note 1 Data is "P+00000" (CR) or "P–00000" (CR) when the number of revolutions is zero

2 The revolution range is "+32767" to "–32768". When this range is exceeded, the data changes from "+32767" to "–32768" or from "–32768" to "+32767". When changing multiturn limit, the range changes. For details, see *5 7 6 Multiturn Limit Setting*

PSO Serial Data Specifications

The number of revolutions and the absolute position within one revolution are always output in five and 7 digits, respectively. The data output cycle is approximately 40 ms

Data Transmission Method	Start-stop Synchronization (ASYNC)
Baud rate	9600 bps
Start bits	1 bit
Stop bits	1 bit
Parity	Even
Character code	ASCII 7-bit code
Data format	16 characters, as shown below

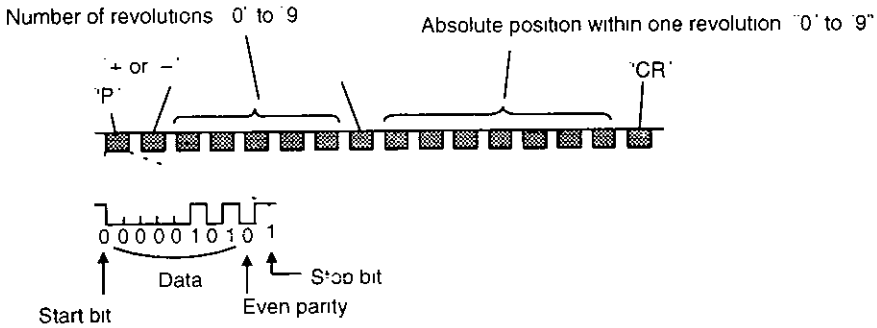


Note 1 The absolute position data within one revolution is the value before dividing

2 Absolute position data increases during forward rotation (Not valid in reverse rotation mode Forward rotation is defined as counterclockwise (CCW) rotation)

Incremental Pulses and Origin Pulses

Just as with normal incremental pulses, initial incremental pulses which provide absolute data are first divided by the frequency divider inside the Servopack and then output

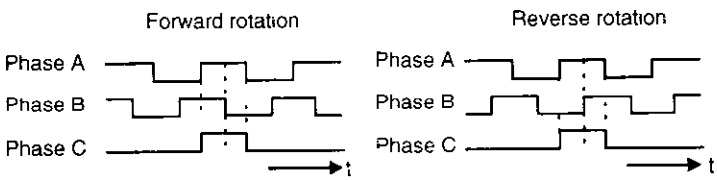

Setting the Pulse Dividing Ratio

Use the following user constant to set the pulse dividing ratio


Pn201	PG Divider	Unit	Setting Range	Factory Setting	Speed/Torque Control, Position Control
		P/R	16 to 16384	16384	

This user constant sets the number of output pulses for PG output signals (PAO, /PAO, PBO, /PBO) sent externally


Pulses from the motor encoder (PG) are divided by the number of pulses set here before being output

The set value is the number of output pulses per revolution Set this value according to the reference unit of the machine or controller to be used

The setting range varies according to the encoder used

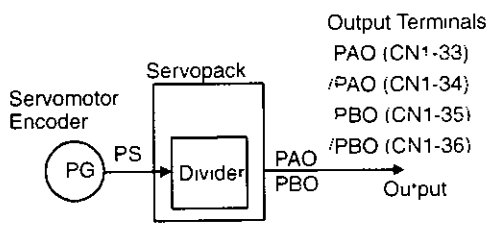

Setting Example

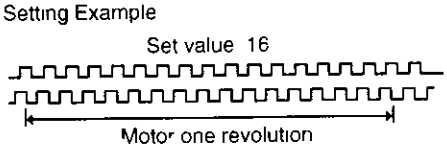

■ Transferring Alarm Contents

When an absolute encoder is used SEN signals can be utilized to transfer the alarm detection contents from PAO outputs to the host device as serial data

Table 5 1 Alarm Contents Output Example

SEN Signal	"H" Error detection ▼	"L"
Digital Operator Display	or run / bb	A.81 Absolute encoder backup alarm
PAO Serial Data	Incremental pulses	ALM81 CR

Refer to *9 2 3 Alarm Display Table* for a table of alarm contents

5.7.6 Multiturn Limit Setting

INFO The multiturn limit setting described in this section is supported by the new version of SGDM Servopacks (SGDM-□DA) only

5

When implementing absolute detection systems for machines that turn m times in response to n turns in the load shaft, such as round tables, it is convenient to reset the multiturn data from the encoder to 0 every m turns The Multiturn Limit Setting allows the value m to be set for the encoder

The use of an absolute encoder can be specified by setting the following user constant

Pn002 2 Absolute Encoder Usage	Factory Setting: 0	Speed/Torque Control, Position Control

"0" in the following table must be set in order to enable the absolute encoder

Pn002 2 Setting	Contents
0	Use the absolute encoder as an absolute encoder
1	Use the absolute encoder as an incremental encoder

TERM

◆ Multiturn limit


The multiturn limit is the upper limit of the multiturn data If Pn002 2 = 0 the multiturn data will vary between 0 and the value set for Pn205 (Multiturn Limit Setting)

The multiturn limit is set in the Servopack using the following user constant


Pn205	Multiturn Limit Setting	Unit	Setting Range	Factory Setting	Speed/Torque Control, Position Control
		rev	0 to 65535	65535	

If the Multiturn Limit Setting is set to 65535 (factory setting), the multiturn data will vary from –32768 to 32767. If any other value is set, the multiturn data will vary from 0 to the setting of Pn205.

- Variation of multiturn data when the multiturn limit value is 65535 (factory setting)

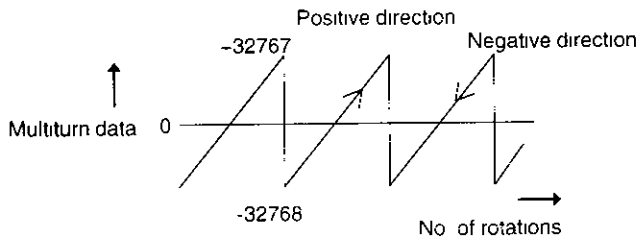

- Variation of multiturn data when the multiturn limit value is other than 65535 (factory setting)

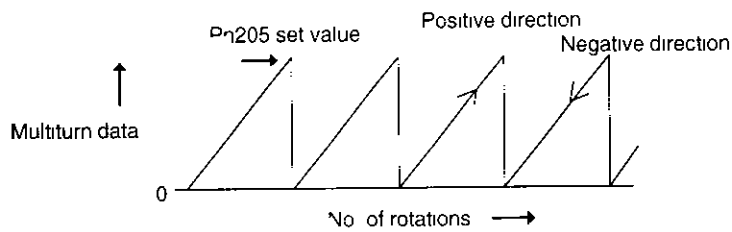

If the Servomotor rotates in the negative direction from 0, the multiturn data will change to the value set for Pn205. If the Servomotor rotates in the positive direction from the value set in Pn205, the multiturn data will change to 0. Set Pn205 to m – 1.

INFO Turn the power OFF and then back ON after changing the setting of user constant Pn002.2 or Pn205.

The multiturn limit value in the Encoder is factory set to 65535, the same as the Servopack. If the multiturn limit value in the Servopack is changed with Pn205 and then the Servopack power is turned OFF and ON, the following alarm will occur.

Alarm Name: Multiturn Limit Disagreement

Alarm Display	Alarm Code Outputs			Meaning of Alarm
	ALO1	ALO2	ALO3	
A.CC	ON	OFF	ON	The multiturn limit value is different in the Encoder and Servopack.

Note: ON signals are low level, OFF signals are high level.

When this alarm occurs, the multiturn limit in the Encoder must be changed. The auxiliary function mode of the Digital Operator is used to change this setting. It can also be set from a personal computer using the Monitor Software.

The procedure to set the multiturn limit in the Encoder using the Digital Operation is provided next. Refer also to *Chapter 7 Using the Digital Operator*.


INFO The multiturn limit setting in the Encoder can be changed only when the Multiturn Limit Disagreement alarm has occurred. After changing the setting, turn the power supply OFF and then back ON.

■ Changing the Setting with the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the auxiliary function mode.




2. Select the user function Fn013. Press the Left or Right Cursor Key to select the digit to set, and then press the Up or Down Cursor Key to change the number.




3. Press the DATA/ENTER Key. The following display will appear.



4. Press the DSPL/SET Key. The following display will appear and the multiturn limit setting in the absolute encoder will be changed.



5. Press the DATA/ENTER Key to return to the auxiliary function mode.



This completes the procedure to change the multiturn limit setting in the absolute encoder. Turn the power supply OFF and then back ON.

■ Changing the Setting with the Built-in Panel Operator

1. Press the DSPL/SET Key to select the auxiliary function mode.




2. Press the Up or Down Cursor Key to select the user constant Fn013



3. Press the DATA/SHIFT Key for at least one second The following display will appear



4. Press the MODE/SET Key The following display will appear and the multiturn limit setting in the absolute encoder will be changed



5 Press the DATA/SHIFT Key for at least one second to return to the auxiliary function mode



This completes the procedure to change the multiturn limit setting in the absolute encoder Turn the power supply OFF and then back ON

⚠ **WARNING** The multiturn limit value must be changed only for special applications Changing it inappropriately or unintentionally can be dangerous

⚠ **WARNING** If the Multiturn Limit Disagreement alarm occurs, check the setting of user constant Pn205 in the Servopack to be sure that it is correct If Fn013 is executed when an incorrect value is set in Pn205, an incorrect value will be set in the Encoder The alarm will disappear even if an incorrect value is set, but incorrect positions will be detected, resulting a dangerous situation where the machine will move to unexpected positions

5.8 Special Wiring

This section describes special wiring methods including the one for noise control. In addition to *5.8.1 Wiring Precautions* and *5.8.2 Wiring for Noise Control*, refer to other sections as necessary.

5.8.1 Wiring Precautions

To ensure safe and stable operation, always observe the following wiring precautions.

IMPORTANT

1. Always use the following cables for reference input and encoder wiring.

–	Cable Type	Yaskawa Drawing No	Maximum Allowable Length
Reference Input	Twisted-pair wires	JZSP-CKI01	3 m (118 in)
Encoder	Multiconductor shielded twisted-pair wire	JZSP-CMP09	20 m (787 in)
		JZSP-CMP19	50 m (1969 in)

   - Trim off the excess portion of the cable to minimize the cable length.

2. For a ground wire, use as thick a cable as possible (2.0 mm^2 or thicker).




   - At least class-3 ground (100 Ω max.) is recommended.
   - Ground to one point only.
   - If the motor is insulated from the machine, ground the motor directly.

3. Do not bend or apply tension to cables.

   The conductor of a signal cable is very thin (0.2 to 0.3 mm (0.0079 to 0.012 in)), so handle the cables with care.

4. Use a noise filter to prevent noise interference.
   (For details, refer to *5.8.2 Wiring for Noise Control*.)

   - If the equipment is to be used near private houses or may receive noise interference, install a noise filter on the input side of the power supply line.
   - Since this Servopack is designed as an industrial device, it provides no mechanism to prevent noise interference.



5 To prevent malfunction due to noise, take the following actions


- Position the input reference device and noise filter as close to the Servopack as possible
- Always install a surge absorber circuit in the relay solenoid and electromagnetic contactor coils
- The distance between a power line (such as a power supply line or motor cable) and a signal line must be at least 30 cm Do not put the power and signal lines in the same duct or bundle them together
- Do not share the power supply with an electric welder or electrical discharge machine When the Servopack is placed near a high-frequency oscillator install a noise filter on the input side of the power supply line

Note 1 Since the Servopack uses high speed switching elements signal lines may receive noise To prevent this always take the above actions

2 For details on grounding and noise filters refer to *5 8 2 Wiring for Noise Control*

6. Use a molded-case circuit breaker (MCCB) or fuse to protect the power supply line from high voltage

- This Servopack connects directly to a commercial power supply without a transformer so always use an MCCB or fuse to protect the servo system from accidental high voltage
- Select an appropriate MCCB or fuse according to the Servopack capacity and the number of Servopacks to be used as shown in the following table



■ MCCB or Fuse According to Power Capacity

The following table shows the MCCB or fuse capacity for each power supply capacity

Main Circuit Power Supply	Servopack Model		Applicable Motor	Power Capacity per Servopack (kVA) *1	Current Capacity per MCCB or Fuse (A_{rms}) *1,*2
	Capacity (kW)	SGDM-			
Single-phase 200 V	0 03	A3AD A3ADA	SGMAH-A3A	0 20	4
	0 05	A5AD, A5ADA	SGMAH-A5A	0 25	
	0 10	01AD 01ADA	SGMAH-01A	0 40	
			SGMPH-01A		
	0 20	02AD, 02ADA	SGMAH-02A	0 75	
			SGMPH-02A		
	0 40	04AD 04ADA	SGMAH-04A	1 2	8
			SGMPH-04A		
Three-phase 200 V	0 50	05AD, 05ADA	SGMGH-05A□A	1 4	4
			SGMGH-03A□B		
	0 75	08AD 08ADA	SGMAH-08A	1 9	7
			SGMPH-08A		
			SGMGH-06A□B		
	1 0	10AD 10ADA	SGMGH-09A□A	2 3	
			SGMGH-09A□B		
			SGMSH-10A		
	1 5	15AD, 15ADA	SGMPH-15A	3 2	10
			SGMGH-13A□A		
			SGMGH-12A□B		
			SGMSH-15A		
	2 0	20AD 20ADA	SGMGH-20A□A	4 3	13
			SGMGH-20A□B		
			SGMSH-20A		
	3 0	30AD 30ADA	SGMDH-22A	5 9	17
			SGMGH-30A□A		
			SGMGH-30A□B		
			SGMSH-30A		
	5 0	50ADA	SGMDH-32A	7 5	28
			SGMDH-40A		
			SGMSH-40A		
			SGMGH-44A□A		
			SGMGH-44A□B		
			SGMSH-50A		
	6 0	60ADA	SGMGH-55A□A	12 5	32
			SGMGH-60A□B		
	7 5	75ADA	SGMGH-75A□A	15 5	41
Single-phase 100 V	0 03	A3BD, A3BDA	SGMAH-A3B	0 15	4
	0 05	A5BD A5BDA	SGMAH-A5B	0 25	
	0 10	01BD 01BDA	SGMAH-01B	0 40	
			SGMPH-01B		
	0 20	02BD 02BDA	SGMAH-02B	0 60	6
			SGMPH-02B		

*1 This is the net value at the rated load. When actually selecting fuses, determine the capacity using the prescribed derating.

*2 Operating characteristics (at 25°C): 2 seconds or more for 200%, 0.01 second or more for 700%.

Note A fast-operating fuse cannot be used because the Servopack power supply is a capacitor input type. A fast-operating fuse may blow out when the power is turned ON.

IMPORTANT SGDM Servopacks do not have built-in ground protection circuits. To configure a safer system, install an earth leakage breaker for protection against overloads and short-circuiting, or else install an earth leakage breaker for ground protection in combination with a wiring circuit breaker.


5.8.2 Wiring for Noise Control

■ Wiring Example

This Servopack uses high-speed switching elements in the main circuit. It may receive "switching noise" from these high-speed switching elements if wiring or grounding around the Servopack is not appropriate. To prevent this, always wire and ground the Servopack correctly.

This Servopack has a built-in microprocessor (CPU), so it is necessary to protect it from external noise as much as possible by installing a noise filter in the appropriate place.

The following is an example of wiring for noise control.

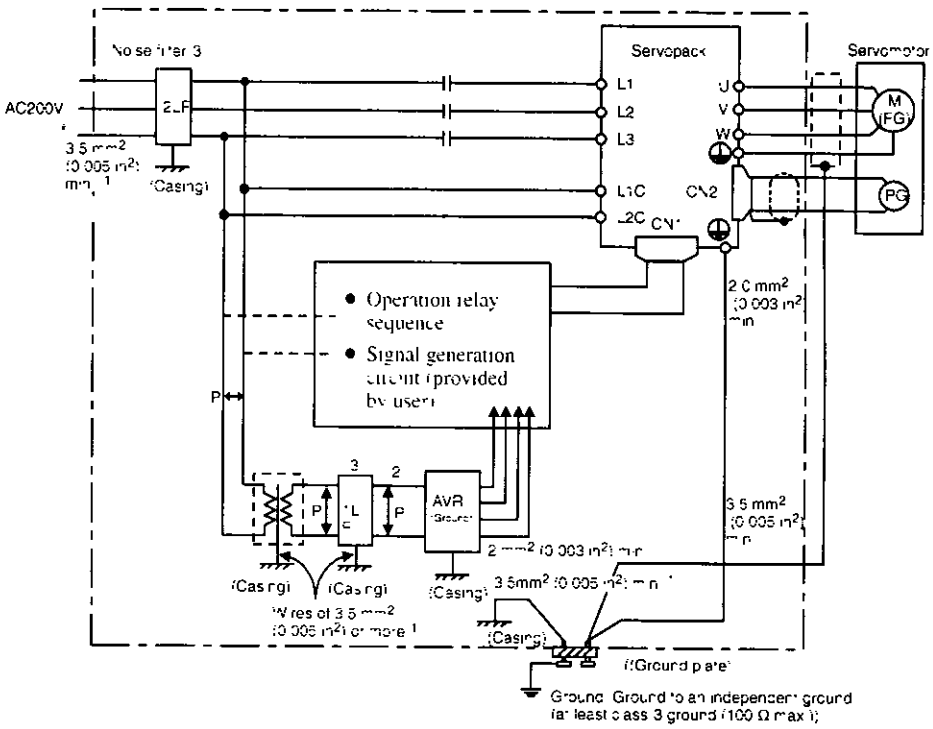

Note 1 For ground wires connected to the casing, use a thick wire with a thickness of at least 3.5 mm² (0.005 in²) (preferably plain stitch cooper wire).

2 For wires indicated by P, use twisted-pair wires whenever possible.

3 When using a noise filter, follow the precautions in ■ *Using Noise Filters*.

■ Correct Grounding

Grounding the Motor Frame

Always connect servomotor frame terminal FG to the Servopack ground terminal ⏚. Also be sure to ground the ground terminal ⏚.

If the servomotor is grounded via the machine, a switching noise current will flow from the Servopack power unit through motor stray capacitance. The above grounding is required to prevent the adverse effects of switching noise.

Noise on the Reference Input Line

If the reference input line receives noise, ground the 0 V line (SG) of the reference input line. If the main circuit wiring for the motor is accommodated in a metal conduit, ground the conduit and its junction box. For all grounding, ground at one point only.

All grounds must be made to only one point in the system.

■ Using Noise Filters

Use an inhibit type noise filter to prevent noise from the power supply line. The following table lists recommended noise filters for each Servopack model.

Install a noise filter on the power supply line for peripheral equipment as necessary.




Table 5.2 Noise Filters

Servopack Model	Recommended Noise Filter	
	Model	Manufacturer
SGDM-A3AD to -02AD SGDM-A3BD to -01BD SGDM-A3ADA to -02ADA SGDM-A3BDA to -01BDA	SUP-P5H-EPR	Okatani Electric Industrial
SGDM-02BD SGDM-02BDA	SUP-P8H-EPR	
SGDM-04AD SGDM-04ADA	SUP-P10H-EPR	


Servopack Model	Recommended Noise Filter	
	Model	Manufacturer
SGDM-05AD to -20AD SGDM-05ADA to -20ADA	LF-3200	Tokin Corp
SGDM-30AD SGDM-30ADA	LF-3300	
SGDM-50ADA	LF-3400	
SGDM-60ADA	LF-3500	
SGDM-75ADA	LF-3600	


Note These noise filters are manufactured by Tokin Corp and available from Yaskawa For noise filters contact your nearest Yaskawa representatives

Always observe the following installation and wiring instructions Incorrect use of a noise filter halves its benefits

- Separate input lines from output lines


  Do not put the input and output lines in the same duct or bundle them together



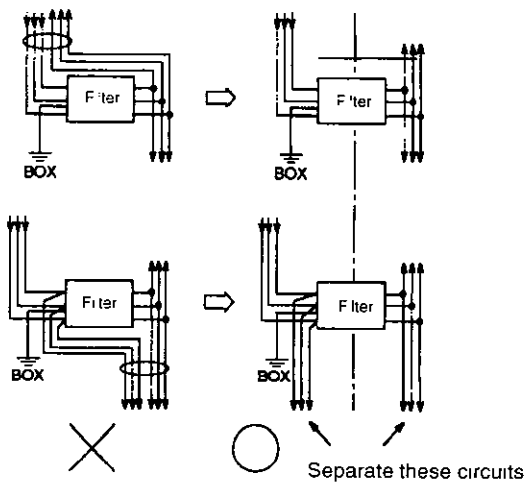


- Separate the noise filter ground wire from the output lines

  Do not accommodate the noise filter ground wire, output lines and other signal lines in the same duct or bundle them together

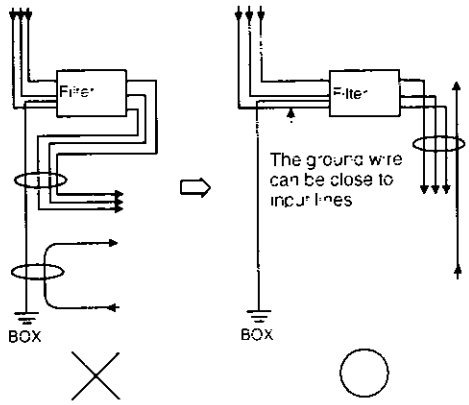


- Connect the noise filter ground wire directly to the ground plate

  Do not connect the noise filter ground wire to other ground wires

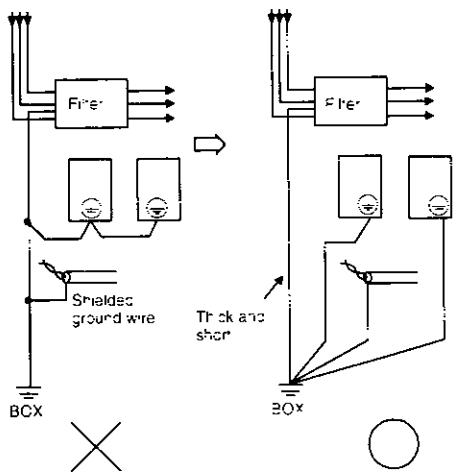


- When grounding a noise filter inside a Unit

  If a noise filter is located inside a Unit, connect the noise filter ground wire and the ground wires from other devices inside the Unit to the ground plate for the Unit first, then ground these wires

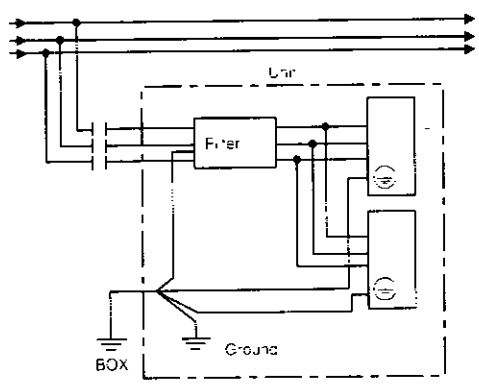

5.8.3 Using More Than One Servodrive

The following diagram is an example of the wiring when more than Servodrive is used

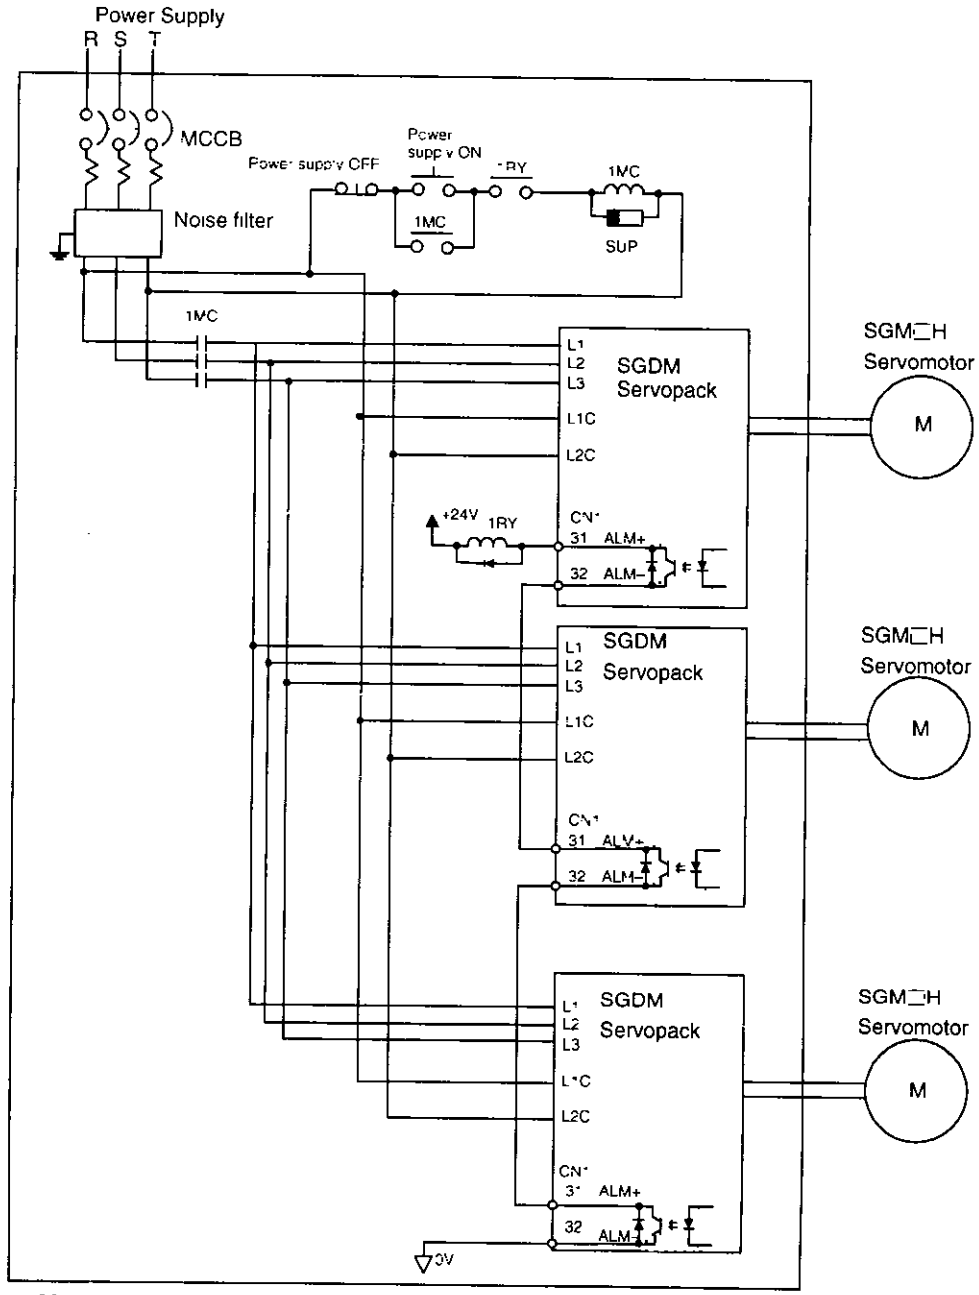

Note Wire the system so that the power supply's S phase is the ground

Connect the alarm output (ALM) terminals for the three Servopacks in series to enable alarm detection relay 1RY to operate

The output transistor is turned OFF when the ALM output signal invokes the alarm state

Multiple servos can share a single MCCB or noise filter Always select a MCCB or noise filter that has enough capacity for the total power capacity (load conditions) of those servos For details, refer to *5.8.1 Wiring Precautions*

5.8.4 Extending Encoder Cables

Standard encoder cables have a maximum length of 20 m. If a longer cable is required, prepare an extension cable as described below. The maximum allowable cable length is 50 m.

For more details, refer to the *Σ-II Series SGM□H/SGDM User's Manual Servo Selection and Data Sheets (SIE-S800-31.1)*.

Preparing 50-m (1968.50 in) Encoder Cables

- Cable Lines

Length	Cable Line Model Numbers
30 m (1181.10 in)	JZSP-CMP19-30
40 m (1574.80 in)	JZSP-CMP19-40
50 m (1968.50 in)	JZSP-CMP19-50






When specifying the cable length, just specify the model number JZSP-CMP19-□. The □ in the model number designates the length of the cable (in meters).


◀EXAMPLE▶ For example, to order 35-m cable, specify JZSP-CMP19-35 as the model number.

- Connectors or Connector Kits

Type		Model
Servopack end	Encoder connector (CN2) socket	JZSP-CMP9-1
Servomotor end	Encoder connector socket for SGMAH and SGMPH Servomotors	JZSP-CMP9-2
	Encoder connector plug and cable plug for SGMGH, SGMSH and SGMDH Servomotors	Plug: L: MS3108B20-29S, Straight: MS3106B20-29S, Cable clamp: MS3057-12A

● Preparing Encoder Cables

• Encoder Connector at Servopack	• Cable Line	• Encoder Connector at Servomotor	
 (JZSP-CMP9-1)	 (JZSP-CMP19-□)		For SGMAH and SGMPH Servomotors
			For SGMGH, SGMSH and SGMDH Servomotors
			

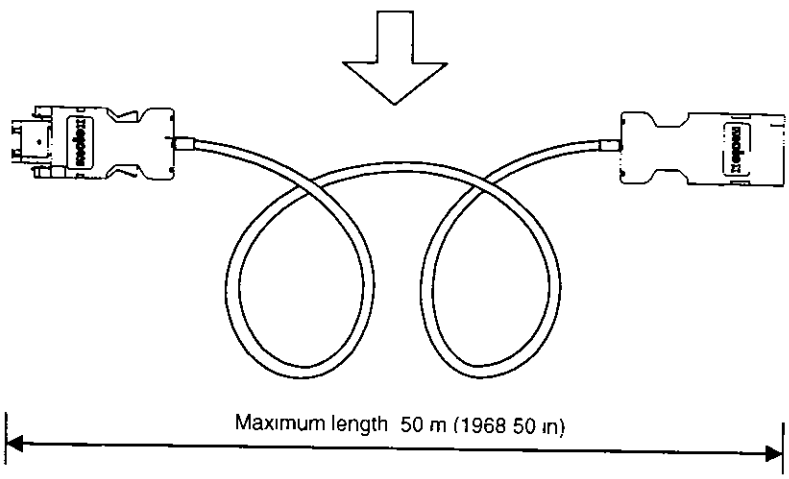

5.8.5 400-V Power Supply Voltage

⚠ CAUTION

- Do not connect the Servopack directly to a different voltage (400 V)
  The Servopack will be destroyed

There are three types of SGDM Servopacks, for the power supply voltages Single-phase 200 VAC, three-phase 400 VAC, and single-phase 400 VAC For the three-phase 400-VAC class (400 V, 440 V) prepare the following voltage conversion transformers (single-phase or three-phase)

Primary Voltage	Secondary Voltage
1 400 VAC or 440 V →	200 VAC
2 400 VAC or 440 V →	100 VAC

Refer to the capacities shown in the following table when selecting a voltage conversion transformer

Voltage	Servopack Model	Voltage capacity per Servopack* kVA
Single-phase 200 V	SGDM-A3AD -A3ADA	0 20
	SGDM-A5AD -A5ADA	0 25
	SGDM-01AD -01ADA	0 40
	SGDM-02AD -02ADA	0 75
	SGDM-04AD -04ADA	1 2
Three-phase 200 V	SGDM-05AD -05ADA	1 4
	SGDM-08AD -08ADA	1 9
	SGDM-10AD -10ADA	2 3
	SGDM-15AD -15ADA	3 2
	SGDM-20AD -20ADA	4 3
	SGDM-30AD -30ADA	5 9
	SGDM-50ADA	7 5
	SGDM-60ADA	12 5
	SGDM-75ADA	15 5
Single-phase 100 V	SGDM-A3BD -A3BDA	0 15
	SGDM-A5BD -A5BDA	0 25
	SGDM 01BD -01BDA	0 40
	SGDM-02BD -02BDA	0 60

* This is the net value at the rated load

When using a 400-V class power supply turn the power supply ON and OFF at the primary side of thee voltage conversion transformer

IMPORTANT Transformer inductance will cause a surge voltage if the power is turned ON and OFF at the secondary damaging the Servopack

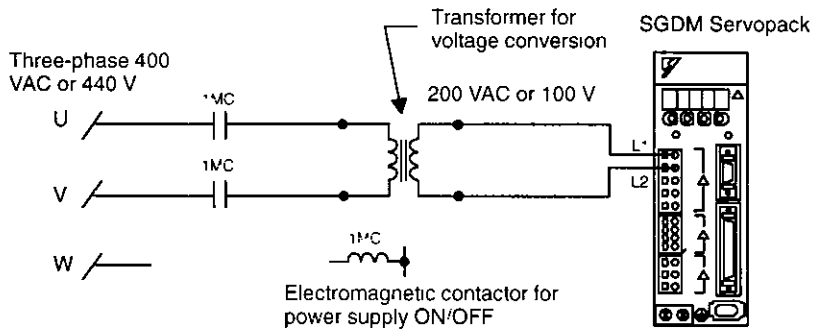



Figure 5.4 Single-phase Power Supply Connection Example

5.8.6 DC Reactor for Harmonic Suppression

SGDM Servopacks have DC reactor connection terminals for power supply harmonic suppression. Servopacks with capacities of 6 kW or more do not have these terminals.

■ Connecting a DC Reactor

The DC reactor is connected in series to the rectifier circuit's output side. Refer to *3.2 Servopack Internal Block Diagrams*.

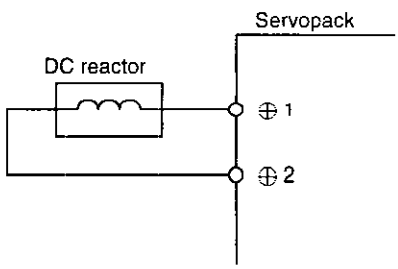

At the time of shipping, the DC reactor's (+)1 and (+)2 are short-circuited. Remove the lead wire between the two terminals and connect the DC reactor.

■ DC Reactor Specifications

The following table shows the specifications for the DC reactors provided by Yaskawa

Applicable Servopacks		Reactor Specifications		Reactor Model
		Inductance (mH)	Rated current (A)	
200 V	SGDM-A3AD -A3ADA	–	–	–
	SGDM-A5AD 05ADA	–	–	–
	SGDM-01AD -01ADA	22 0	1 0	X5064
	SGDM-02AD 02ADA	10 0	1 8	X5063
	SGDM-04AD -04ADA	4 7	3 5	X5063
	SGDM-05AD -05ADA	2 0	4 8	X5061
	SGDM-08AD -08ADA			
	SGDM-10AD -10ADA			
	SGDM-15AD -15ADA	1 5	8 8	X5060
	SGDM-20AD -20ADA			
	SGDM-30AD -30ADA	1 0	14 0	X5059
	SGDM-50ADA	0 47	26 8	X5068
100 V	SGDM-A3BD -A3BDA	–	–	–
	SGDM-A5BD -A5BDA	–	–	–
	SGDM-01BD -01BDA	10 0	1 8	X5063
	SGDM-02BD -02BDA	4 7	3 5	X5062

6

Servo Adjustment

This chapter describes the functions required for servo adjustment. Find the required information by selecting the section from the following table of contents.

6.1 Smooth Operation ... 6-2
- 6.1.1 Using the Soft Start Function 6-2
- 6.1.2 Smoothing 6-3
- 6.1.3 Adjusting Gain 6-4
- 6.1.4 Adjusting Offset 6-5
- 6.1.5 Setting the Torque Reference Filter Time Constant 6-5
- 6.1.6 Notch Filter 6-6

6.2 High-speed Positioning .. 6-7
- 6.2.1 Setting Servo Gain 6-7
- 6.2.2 Using Feed-forward Control 6-9
- 6.2.3 Using Proportional Control 6-9
- 6.2.4 Setting Speed Bias 6-10
- 6.2.5 Using Mode Switch 6-11
- 6.2.6 Speed Feedback Compensation 6-14
- 6.2.7 Gain Changing Function 6-16

6.3 Autotuning 6-17
- 6.3.1 Online Autotuning 6-17
- 6.3.2 Machine Rigidity Settings for Online Autotuning 6-20
- 6.3.3 Saving Results of Online Autotuning 6-22
- 6.3.4 User Constants Related to Online Autotuning 6-24

6.4 Servo Gain Adjustments 6-27
- 6.4.1 Servo Gain User Constants 6-27
- 6.4.2 Basic Rules of Gain Adjustment 6-27
- 6.4.3 Making Manual Adjustments 6-29
- 6.4.4 Gain Setting Reference Values 6-33

6.5 Analog Monitor . 6-35

6.1 Smooth Operation

This section provides technical information on the smooth operation of Servomotors

6.1.1 Using the Soft Start Function

The soft start function adjusts progressive speed reference input inside the Servopack so that acceleration and deceleration can be as constant as possible To use this function, set the following user constants


Pn305	**Soft Start Acceleration Time**	**Unit: ms**	**Setting Range: 0 to 10000**	**Factory Setting. 0**	**Speed Control**
Pn306	**Soft Start Deceleration Time**	**Unit ms**	**Setting Range 0 to 10000**	**Factory Setting. 0**	**Speed Control**

In the Servopack, a speed reference is multiplied by the acceleration or deceleration value set in Pn305 or Pn306 to provide speed control

The soft start function enables smooth speed control when inputting progressive speed references or when selecting internally-set speeds Set both Pn305 and Pn306 to "0" for normal speed control

Set these user constants as follows

- Pn305 The time interval from the time the motor starts until the maximum speed is reached
- Pn306 The time interval from the time the motor is operating at the maximum speed until it stops

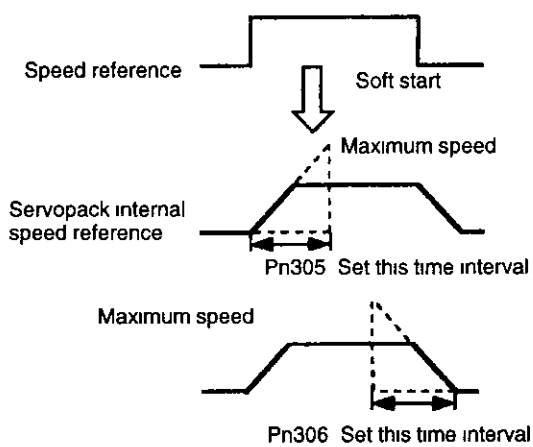

6.1.2 Smoothing

A filter can be applied in the Servopack to a constant-frequency reference pulse Use the following user constant to set the type of filter to be applied

Pn207 0	Position Reference Filter Selection	Factory Setting	Position Control
		0	

Either an acceleration/deceleration or average movement filter can be selected

Pn207 0 Setting	Meaning
0	Acceleration/deceleration filter
1	Average movement filter

The time constant and time for these filters are set in the following user constants

Time Constant for Acceleration/Deceleration Filter

Pn204	Position Reference Acceleration/ Deceleration Time Constant	Unit	Setting Range	Factory Setting	Position Control
		0 01ms	0 to 6400	0	

Averaging Time for Average Movement Filter

Pn208	Position Reference Movement Averaging Time	Unit	Setting Range	Factory Setting	Position Control
		0 01ms	0 to 6400	0	

After resetting the constant turn OFF the power once and turn ON it again


INFO

The functions described here for Pn207 0 and Pn208 are supported by the new version of SGDM Servopacks (SGDM-□DA) only For previous versions only Pn204 can be set, and the average movement filter cannot be used With the progressive speed reference input the reference becomes exponential for the acceleration/deceleration filter and becomes lamp-form (linear acceleration/deceleration) for the average movement filter

This function provides smooth motor operating in the following cases

- When the host device which outputs references cannot perform acceleration/deceleration processing
- When the reference pulse frequency is too low
- When the reference electronic gear ratio is too high (i e , 10 × or more)

This function does not affect the travel distance (i e , the number of pulses)

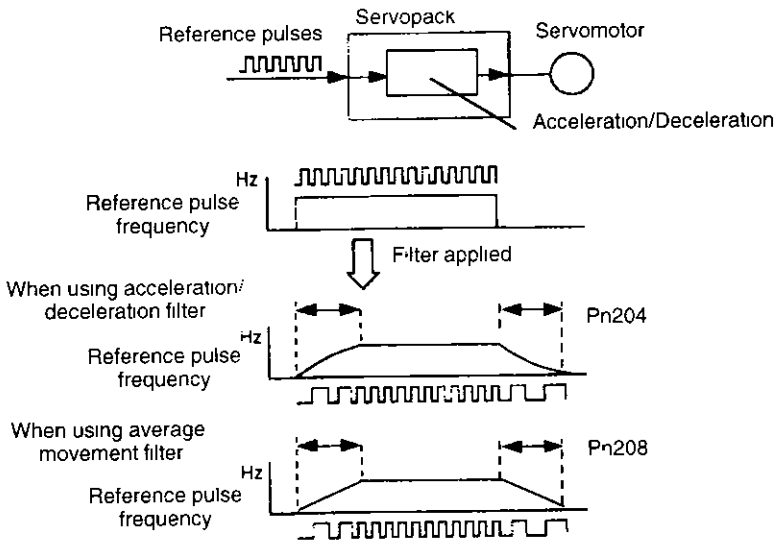

6.1.3 Adjusting Gain


If speed loop gain or position loop gain exceeds the allowable limit for the servo system including the machine to be controlled the system will tend to vibrate or become too sensitive Smooth operation is not possible under such conditions, so reduce each loop gain value to an appropriate value

Refer to *6 2 1 Setting Servo Gain* for details regarding servo gain adjustment

6.1.4 Adjusting Offset

The servo system does not operate smoothly if reference voltage from the host controller or external equipment has a reference offset value in close proximity to 0 V In that case, adjust the reference offset value to 0 V

■ Reference Voltage Offset from Host Controller or External Circuitry

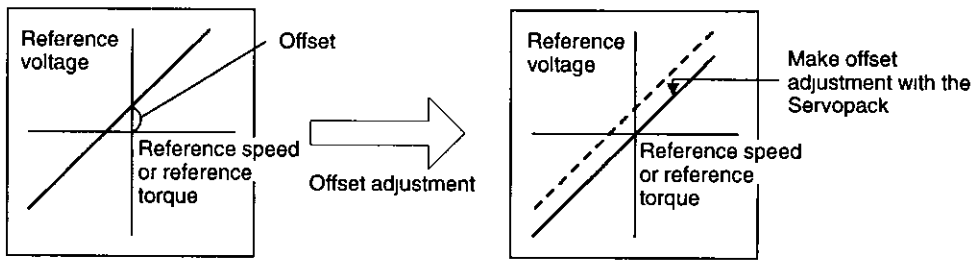

■ Reference Offset Adjustment

The following two methods are available to set the reference offset value to 0 V

Reference offset automatic adjustment	The reference offset value is automatically set to 0 V
Reference offset manual adjustment	The reference offset value can be adjusted manually

IMPORTANT

If a position loop is formed in the host controller, be sure to make manual offset adjustment and do not make automatic reference offset adjustment

Refer to the following sections in *Chapter 7 Using the Digital Operator* for reference offset adjustment in detail

Reference Offset Automatic Adjustment	*7 2 3 Automatic Adjustment of the Speed and Torque Reference Offset*
Reference Offset Manual Adjustment	*7 2 4 Manual Adjustment of the Speed and Torque Reference Offset*

6.1.5 Setting the Torque Reference Filter Time Constant

If there is machine vibration which may be caused by the servodrive, try adjusting the filter time constant in Pn401 This may stop the vibration

Pn401	Torque Reference Filter Time Constant	Unit	Setting Range:	Factory Setting:	Speed/Torque Control, Position Control
		0 01ms	0 to 65535	100	

The above constant is the filter time constant of the torque reference to be set in the Servopack The smaller the value, the faster the speed control response will be There is, however, a certain limit depending on machine conditions

6.1.6 Notch Filter



The notch filter function described in this section is supported by the new version of SGDM Servopacks (SGDM-□DA) only

Vibration in the machine can sometimes be eliminated by using a notch filter for the frequency at which the vibration is occurring

Pn408.0	Notch Filter Selection	Factory Setting*	Speed/Torque Control, Position Control
		0	

This user constant can be set to enable the notch filter

Pn408.0 Setting	Contents
0	None
1	Notch filter used for torque reference

The frequency at which the machine is vibrating is set in the following user constant

Pn409	Notch Filter Frequency	Unit.	Setting Range	Factory Setting*	Speed/Torque Control, Position Control
		Hz	50 to 2000	2000	

6.2 High-speed Positioning

This section provides technical information on high-speed positioning

6.2.1 Setting Servo Gain

Use the servo gain setting function in the following cases

- To check each servo gain value that is automatically set after auto-tuning
- To directly set each of the above servo gain values in another Servopack
- To further refine responsiveness after autotuning (either to increase responsiveness or to reduce it)


■ Setting Speed Loop Gain

Set the following speed-loop-related user constants as required

Pn100	Speed Loop Gain (Kv)	Unit: Hz	Setting Range: 1 to 2000	Factory Setting: 40	Speed/Torque Control, Position Control
Pn101	Speed Loop Integral Time Constant (Ti)	Unit: 0 01ms	Setting Range. 15 to 51200	Factory Setting 2000	Speed Control, Position Control

The above constants are the Servopack's speed loop gain and integral time constant respectively

The higher the speed loop gain, or the smaller the speed loop integral time constant value, the faster the speed control response will be There is, however, a certain limit depending on machine characteristics

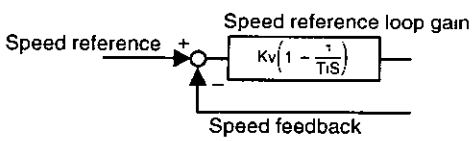

Speed loop gain Kv is adjusted in 1-Hz increments provided that the following user constant is set correctly

Pn103	Inertia Ratio	Unit: %	Setting Range: 0 to 10000	Factory Setting 100	Speed/Torque Control, Position Control

$$\text{Inertia ratio} = \frac{\text{Motor axis conversion load inertia } (J_L)}{\text{Servomotor rotor inertia } (J_M)} \times 100(\%)$$

The load inertia of the Servopack converted on the basis of the motor shaft is factory-set to the rotor inertia of the Servomotor Therefore, obtain the inertia ratio from the above formula and set user constant Pn103 properly

The above user constants are automatically set by the autotuning operation


■ Setting Position Loop Gain

Set the following position loop-related user constant as required

Pn102	Position Loop Gain (Kp)	Unit	Setting Range:	Factory Setting	Speed Control, Position Control
		1/s	1 to 2000	40	

The above constant is the position loop gain for the Servopack

The higher the position loop gain, the smaller the position control error will be There is, however, a certain limit depending on machine characteristics

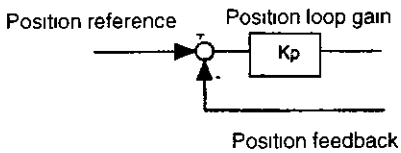


This gain setting is also valid for zero clamp operation

The above user constant is automatically set by the autotuning operation

Pn505	Overflow level	Unit·	Setting Range·	Factory Setting	Position Control
		256 reference units	1 to 32767	1024	

Set in this user constant the error pulse level at which a position error pulse overflow alarm (A d0) is detected

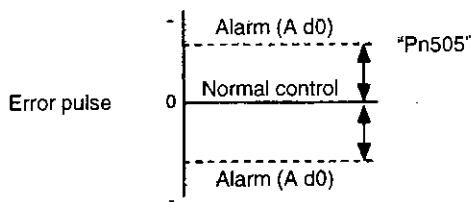


If the machine permits only a small position loop gain value to be set in Pn102, an overflow alarm may arise during high-speed operation In this case, increase the value set in this user constant to suppress alarm detection

6.2.2 Using Feed-forward Control

The time required for positioning can be shortened with feed-forward control by setting the following user constant

Pn109	Feed-forward	Unit: %	Setting Range 0 to 100	Factory Setting: 0	Speed Control Position Control

This user constant is set to apply feed-forward frequency compensation to position control inside the Servopack Use this user constant to shorten positioning time Too high a value may cause the machine to vibrate For ordinary machines, set 80% or less in this constant

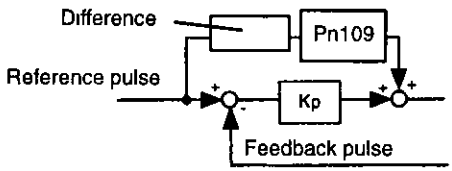

6.2.3 Using Proportional Control

If user constant Pn000 1 is set to 0 or 1 as shown below, input signal /P-CON serves as a PI/P control changeover switch

- PI control Proportional/integral control
- P control Proportional control

Pn000.1	Control Method Selection	Factory Setting· 0	Speed Control Position Control

Pn000 1 setting	Control Mode		
0	Speed Control	Usual speed control or position control is selected Input signal /P-CON (CN1-41) is used to select PI control or P control	P or PI control selection /P-CON Servopack CN1-41
1	Position Control	CN1-41 is open: PI control CN1-41 is 0 V: P control	



◆ Feed-forward control

Feed-forward control is a type of control in which necessary control connections are made in advance before the control system is affected by external disturbance Feed-forward control increases the effective servo gain, thus making it possible to improve the response performance of the system

■ Methods for Using Proportional Control

Proportional control can be used in the following two ways

- When operation is performed by sending speed references from the host controller to the Servopack, the host controller can selectively use P control mode for particular conditions only This method can suppress overshooting and shorten setting time Refer to *6 2 5 Using Mode Switch* for particular conditions
- If PI control mode is used when the speed reference has a reference offset, the motor may rotate at a very slow speed and fail to stop even if 0 is specified as a speed reference In this case, use P control mode to stop the motor


6.2.4 Setting Speed Bias

The settling time for positioning can be reduced by assigning bias to the speed reference block in the Servopack To assign bias, use the following constants

Pn107	**Bias**	**Unit:** **r/min**	**Setting Range:** **0 to 450**	**Factory Setting:** **0**	**Position Control**
Pn108	**Bias Addition Width**	**Unit** **Reference units**	**Setting Range** **0 to 250**	**Factory Setting:** **7**	**Position Control**

Set the constants to shorten the time required for positioning according to the application


The bias increment width (Pn108) is expressed by a error pulse width that determine the timing of giving bias input (Pn107) The bias input is ON if the error pulse width exceeds the value set in Pn108

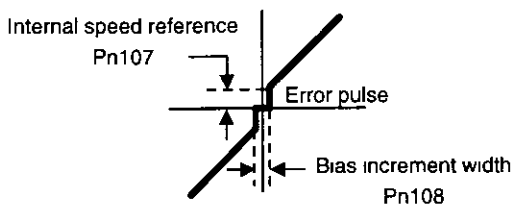

6.2.5 Using Mode Switch

Use the mode switch function for the following purposes

- To suppress overshooting during acceleration or deceleration (for speed control)
- To suppress undershooting during positioning and to shorten the setting time (for position control)

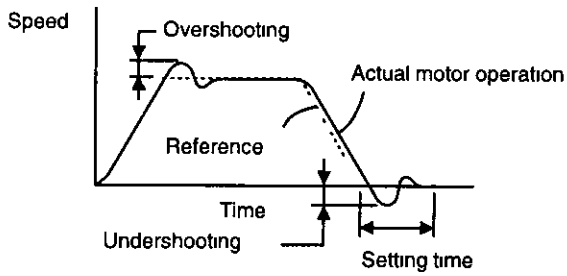

The mode switch function makes it possible to automatically switch over the Servopack's internal speed control mode from PI to P control mode and vice versa when specified conditions are satisfied

IMPORTANT

1. The mode switch is used to fully utilize performance of a servodrive to achieve very high-speed positioning The speed response waveform must be observed to adjust the mode switch
2. For normal use, the speed loop gain and position loop gain set by autotuning provide sufficient speed/position control Even if overshooting or undershooting occur, they can be suppressed by setting the acceleration/deceleration time constant for the host device, the soft start time constants (Pn305, Pn306), or position reference acceleration/deceleration constant (Pn204) for the Servopack

■ Selecting Mode Switch Setting

The Servopack incorporates four mode switch settings (0 to 3) Select a mode switch with the following user constant (Pn10B 0)

TERMS

◆ From PI control to P control


PI control means proportional/integral control and P control means proportional control In short, switching 'from PI control to P control" reduces effective servo gain, making the servo system more stable

Setting	Selection	User Constant to Set Detective Point	Set Unit
0	Uses torque reference as the detection point (Standard setting)	Pn10C	Percentage of rated torque %
1	Uses speed reference input as the detection point	Pn10D	Motor speed r/min
2	Uses acceleration as the detection point	Pn10E	Motor acceleration 10 (r/min)/s
3	Uses error pulse input as the detection point	Pn10F	Reference unit
4	Mode switch function is not used	–	–

Torque Reference Input Used as Detection Point (Standard Setting)


With this setting, if the value of torque reference input exceeds the torque set in user constant Pn10C, the speed loop switches to P control

The Servopack is factory-set to this standard mode (Pn10C = 200)

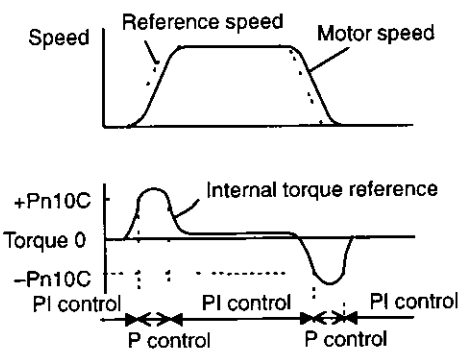


◀EXAMPLE▶ Operating Example

If the system is always in PI control without using the mode switch function, the speed of the motor may overshoot or undershoot due to torque saturation at the time of the acceleration or deceleration of the motor The mode switch function suppresses torque saturation and eliminates the overshooting or undershooting of the speed of the motor

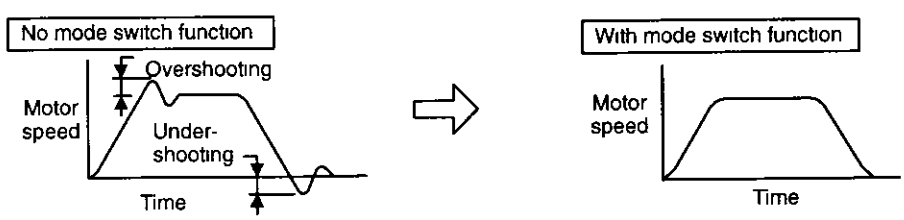


Speed Reference Used as Detection Point

With this setting, if a speed reference exceeds the value set in user constant Pn10D, the speed loop switches to P control

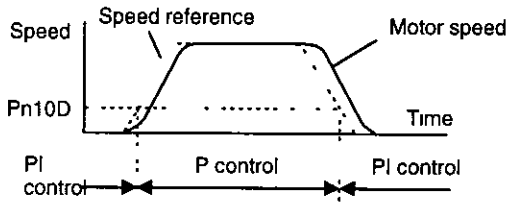


◀EXAMPLE▶ Operating Example

In this example, the mode switch is used to reduce setting time Generally, speed loop gain must be increased to reduce setting time Using the mode switch suppresses the occurrence of overshooting and undershooting when speed loop gain is increased

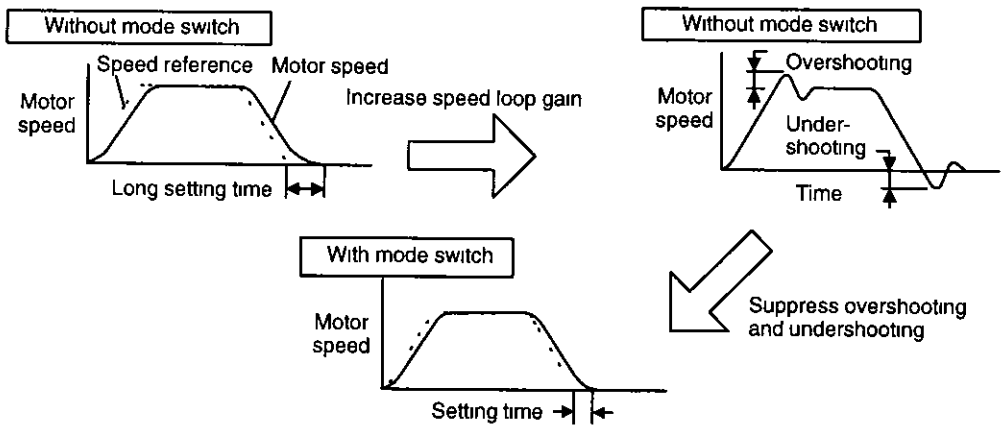


Acceleration Used as Detection Point

If motor acceleration exceeds the value set in user constant Pn10E, the speed loop switches to P control

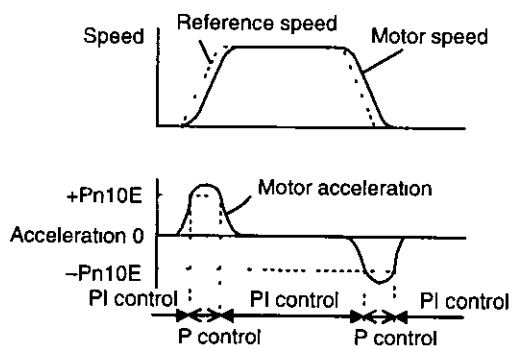

◀EXAMPLE▶ Operating Example


If the system is always in PI control without using the mode switch function, the speed of the motor may overshoot or undershoot due to torque saturation at the time of the acceleration or deceleration of the motor The mode switch function suppresses torque saturation and eliminates the overshooting or undershooting of the motor speed

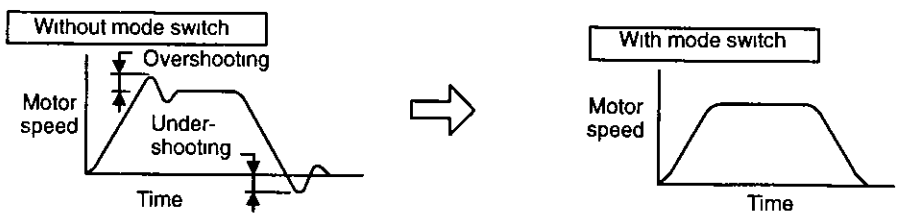

Error Pulse Used as Detection Point


This setting is enabled for position control operation only

If an error pulse exceeds the value set in user constant Pn10F, the speed loop switches to P control

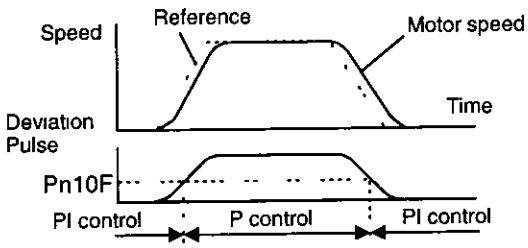


◀EXAMPLE▶ Operating Example

In this example, the mode switch is used to reduce setting time Generally, speed loop gain must be increased to reduce setting time Using the mode switch suppresses the occurrence of overshoot and undershoot when speed loop gain is increased

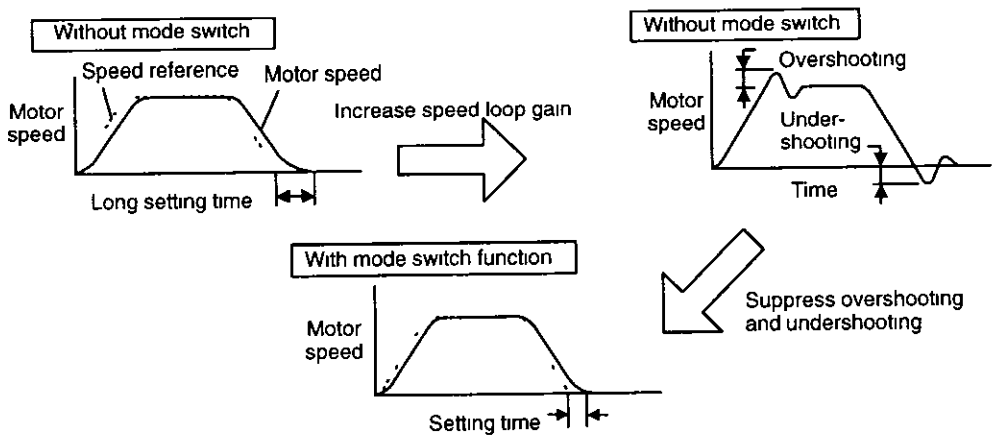

6.2.6 Speed Feedback Compensation

Use this function for shortening the setting time of the system in positioning operation

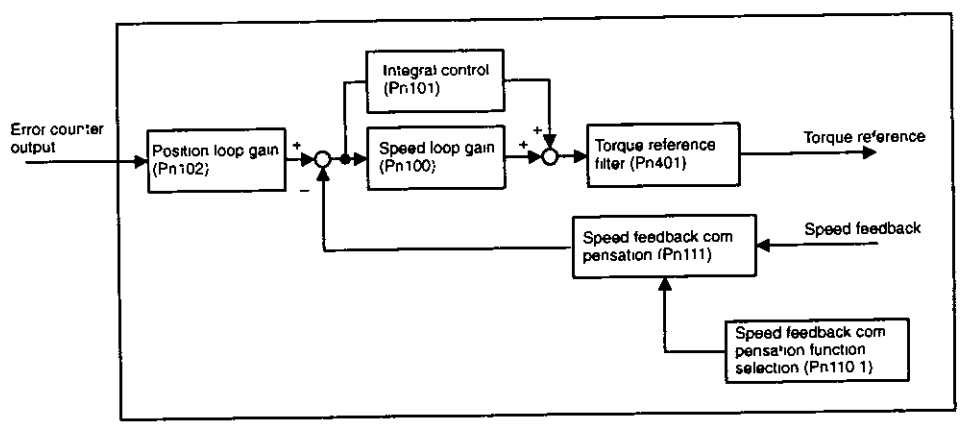

INFO

This function is available provided that the inertia ratio set in Pn103 is correct Therefore, perform online autotuning to obtain and save the results as the user constants Refer to *6 3 Autotuning* for details Alternatively, directly set the inertia ratio

■ Adjustment Procedure

When adding the value of speed feedback compensation, be sure to follow the procedure described below and make servo gain adjustments while watching the analog monitor to observe the position error and torque reference Refer to *6 5 Analog Monitor* for details

1. Set user constant Pn110 to "0002" so that the online autotuning function will be disabled Refer to *6 3 4 User Constants Related to Online Autotuning* and *Appendix B List of User Constants* for details regarding Pn110
2. First, make normal servo gain adjustments with no feedback compensation In this case, gradually increase the speed loop gain in Pn100 while reducing the speed loop integral time constant Pn101, and finally set the speed loop gain in Pn100 to the same value as that of the position loop gain in Pn102

The relationship between the speed loop gain and integral time constant is as follows

Take the value obtained from the following formula as a reference value for setting the speed loop integral time constant in Pn101

$$\text{Speed loop integral time constant} = \frac{4}{2\pi \times \text{Speed loop gain}} \text{ [sec]}$$

Unit of speed loop gain [Hz]

Check the unit when setting the speed loop integral time constant in Pn101 Pn101 can be set in 0 01 ms increments

The unit of speed loop gain (i e , Hz) and that of position loop gain (i e , 1/s) are different to each other Set these gains to the same value, however

3. Repeat step 2 to increase the speed loop gain while watching the position error of the analog monitor to observe the setting time and the torque reference of the analog monitor to observe any occurrence of vibration If there is any oscillating noise or noticeable vibration, gradually increase the time constant of the torque reference filter in Pn401
4. Gradually increase only the position loop gain When it has been increased about as far as possible, then decrease the speed feedback compensation in Pn111 from 100% to 90% Then repeat steps 2 and 3
5. Decrease the speed feedback compensation to a value lower than 90% Then repeat steps 2 through 4 to shorten the setting time If the speed feedback compensation is too low, however, the response waveform will vibrate
6. Find the condition in which the shortest setting time is obtainable within the range where the position error or torque reference waveform observed through the analog monitor is not vibrating or unstable
7. The servo gain adjustment is completed when no further shortening of the positioning time is possible

IMPORTANT

Speed feedback compensation usually makes it possible to increase the speed loop gain and position loop gain The machinery may vibrate excessively if the compensation value greatly changes or Pn110 1 is set to 1" (i e , no speed feedback compensation enabled) after increasing the speed loop gain or position loop gain

6.2.7 Gain Changing Function

The gain changing function is used to change the gain online

For example, to change the gain setting for running and stopping the motor, set different values to the first and second gains to change the gain by the external changing signal


To start the function, set 'Pn50A 0 to 1 This sets the sequence input signal assignment arbitrarily Assign Pn50D 2" (gain changing signal) to the input signal terminal

When the assigned signal terminal is at the high level, the first gain (Pn100, Pn101, Pn102) is selected, when it is at the low level the second gain (Pn104, Pn105, Pn106) is selected

Gain Changing Signal	High Level	Low Level
Speed Loop Gain	Pn100 setting value enable	Pn104 setting value enable
Integral Time Constant	Pn101 setting value enable	Pn105 setting value enable
Position Loop Gain	Pn102 setting value enable	Pn106 setting value enable

6.3 Autotuning

If positioning is taking a long time, the speed loop gain or position loop gain of the servo system may not be set properly If the gain settings are wrong, set them properly in accordance with the configuration and rigidity of the machinery

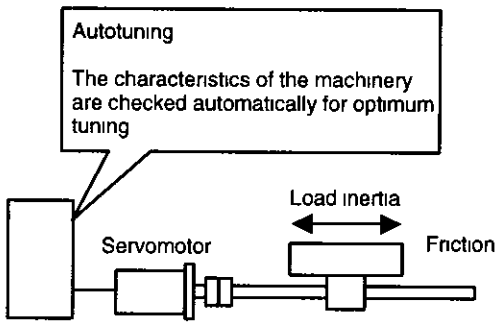

The Servopack incorporates an online autotuning function, which checks the characteristics of the machinery automatically and makes the necessary servo gain adjustments The function is easy to use and makes it possible for even beginners to perform servo gain tuning and set all servo gains as user constants

The following user constants can be set automatically by using the online autotuning function

User Constant	Content
Pn100	Speed loop gain
Pn101	Speed loop integral time constant
Pn102	Position loop gain
Pn401	Torque reference filter time constant

6.3.1 Online Autotuning

Online autotuning is a control function which enables the Servoamp to check changes in the load inertia during operation in order to maintain the target value for speed loop gain or position loop gain

Online autotuning may not work well in the following cases

- When the cycle for load inertia change is 200 ms or shorter (when the load changes rapidly)
- When the application has slow acceleration or deceleration using the soft start function, and the speed error of the Servomotor being driven is small
- When adjusting the Servomotor manually and operating at low gain (a machine rigidity of 1 or less)

Disable the online autotuning function if tuning is not possible (See 6 4 3)


IMPORTANT

Do not use online autotuning in the following cases

- When driving using Torque Control Mode
- When using IP control for the speed loop
- When using the torque feed-forward function
- When switching gain using /G-SEL

■ Setting User Constants for Online Autotuning

The following flowchart shows the procedure for setting the user constants for online autotuning

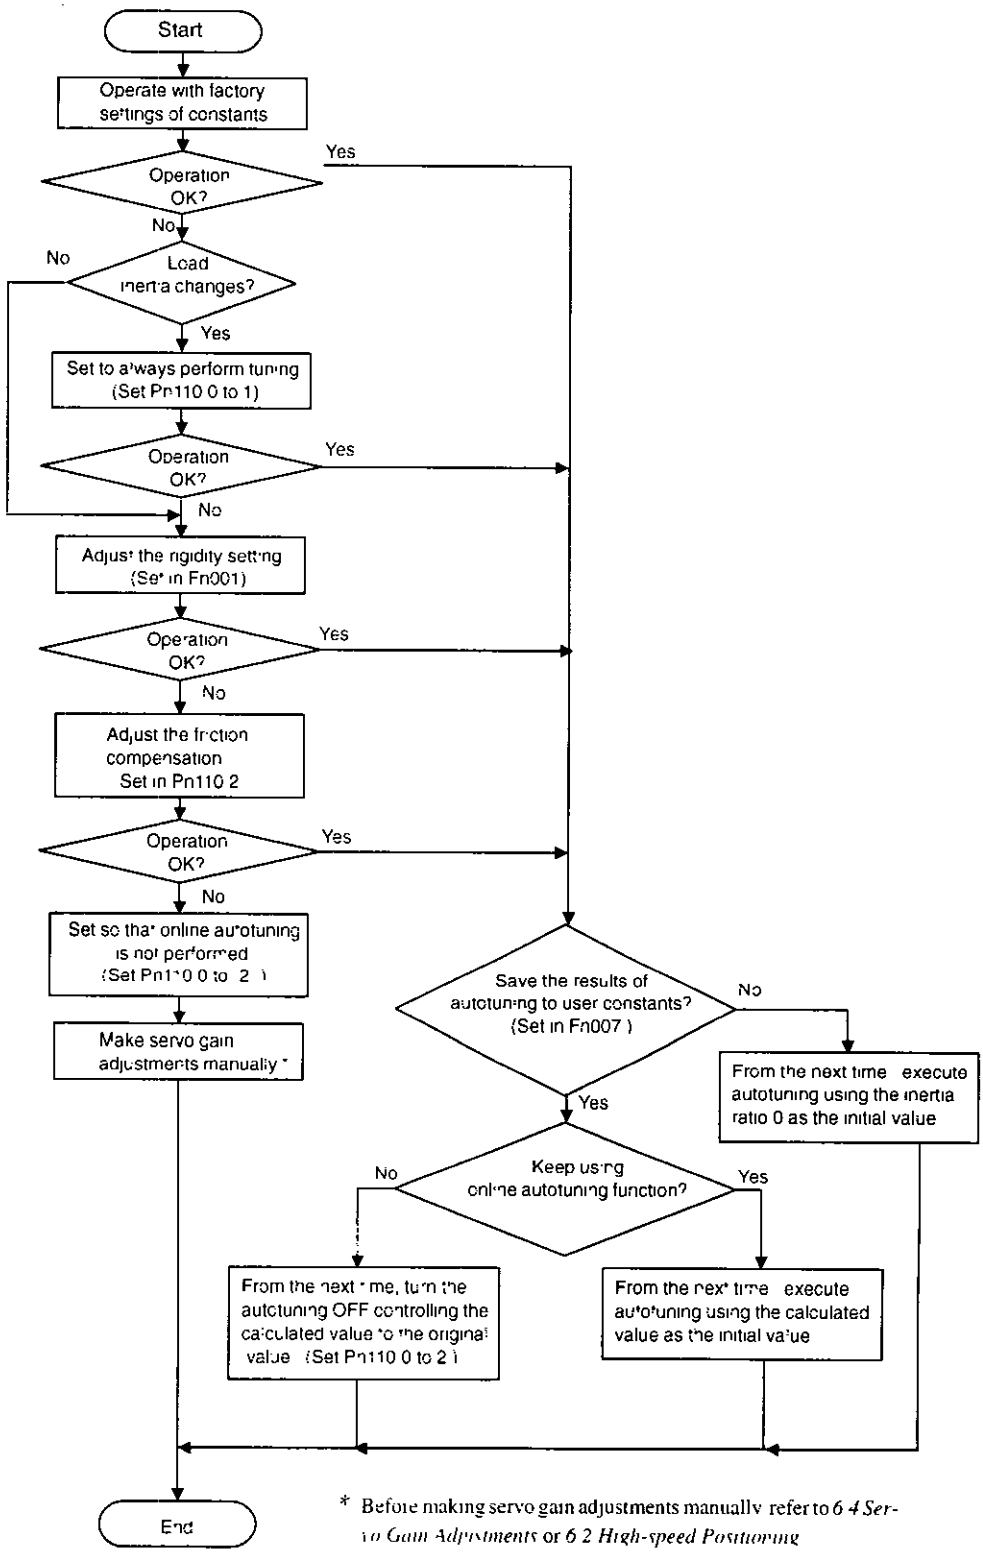

* Before making servo gain adjustments manually refer to *6 4 Servo Gain Adjustments* or *6 2 High-speed Positioning*

6.3.2 Machine Rigidity Settings for Online Autotuning

For the machine rigidity settings at the time of online autotuning, select the target values for speed loop gain and position loop gain of the servo system Any of the following ten levels of rigidity can be selected

Rigidity Setting Fn001	Position Loop Gain [S^{-1}] Pn102	Speed Loop Gain [Hz] Pn100	Speed Loop Integral Time Constant [0.01ms] Pn101	Torque Reference Filter Time Constant [0 01ms] Pn401
1	15	15	6000	250
2	20	20	4500	200
3	30	30	3000	130
4	40	40	2000	100
5	60	60	1500	70
6	85	85	1000	50
7	120	120	800	30
8	160	160	600	20
9	200	200	500	15
10	250	250	400	10

Note The Rigidity value is factory-set to 4

As the rigidity value is increased. the servo system loop gain increases and the time required for positioning is shortened If the rigidity is excessively high, however, it may cause the machinery to vibrate In that case. decrease the set value

The rigidity value setting automatically changes the user constants in the above table



If user constants Pn102 Pn100. Pn101. and Pn401 are set manually with the online autotuning function enabled, tuning is performed with the manually set values as target values

■ Changing the Rigidity Setting

Use user constant Fn001 in the auxiliary function mode to change the rigidity setting


The procedure for changing the setting is as follows

Using the Hand-held Digital Operator


1. Press the DSPL/SET Key and select Fn001 in the auxiliary function mode




2. Press the DATA/ENTER Key The following data will be displayed



3. Press the Up or Down Cursor Key to select the rigidity setting

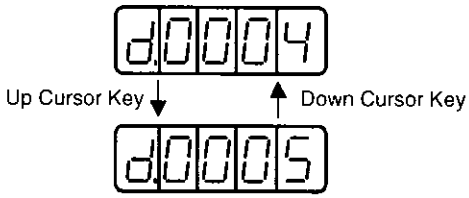

4. Press the DSPL/SET Key The following display will flash for 1 second and then the rigidity setting will be changed



5. Press the DATA/ENTER Key to return to the auxiliary function mode



This completes the procedure for changing the rigidity setting

The gain is adjusted automatically during normal operation

Using the Built-in Panel Operator


1. Press the MODE/SET Key to select Fn007 in the auxiliary function mode




2. Press the DATA/SHIFT Key for a minimum of 1 second The following data will be displayed



3. Press Up or Down Cursor Key to select the rigidity setting

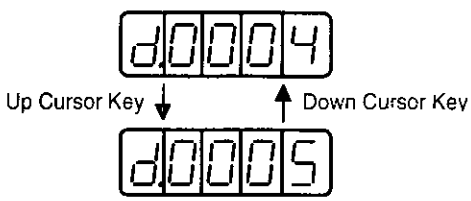

4 Press the MODE/SET Key The following display will flash for 1 second and then the rigidity setting will be changed



5. Press the DATA/SHIFT Key for a minimum of 1 second to return to the auxiliary function mode



This completes the procedure for changing the rigidity setting

The gain is adjusted automatically during normal operation

6.3.3 Saving Results of Online Autotuning

Online autotuning always processes the latest load inertia to renew data so that the speed loop gain will reach the target value that has been set When the Servopack is turned off. all the processed data is lost Therefore, when the Servopack is turned on again. online autotuning is performed by processing the factory-set values in the Servopack

To save the results of online autotuning and use them as the initial values set in the Servopack when the Servopack is turned on again. it is necessary to use constant Fn007 in the auxiliary function mode In this case, the inertia value set in user constant Pn103 can be changed

On the basis of the rotor inertia of the Servomotor, the inertia ratio is expressed in percentage terms by the load inertia The value set in Pn103 is used to calculate the load inertia at the time of online autotuning

Pn103	Inertia Ratio	Unit	Setting Range	Factory Setting	Speed/Torque Control, Position Control
		%	0 to 10000	0	

$$\text{Inertia ratio} = \frac{\text{Motor axis conversion load inertia } (J_L)}{\text{Servomotor moment of inertia } (J_M)} \times 100(\%)$$

The inertia ratio is factory-set to 0%

6

IMPORTANT

Before making servo gain adjustments manually. be sure to set the inertia ratio in Pn103 If the inertia ratio is incorrect. the speed loop gain (in 1-Hz increments) set in Pn100 will be wrong

For details on setting Pn103. refer to 7 1 6 *Operation in User Constant Setting Mode*

■ Procedure for Saving Results of Online Autotuning

The procedure for saving the results of online autotuning is as follows

Using the Hand-held Digital Operator


1. Press the DSPL/SET Key to select Fn007 in the auxiliary function mode



2 Press the DATA/ENTER Key If the inertia ratio is 200%, for example. the following data will be displayed



3. Press the DSPL/SET Key The following display will flash for 1 second and then the inertia ratio will be saved



4. Press the DATA/ENTER Key to return to the auxiliary function mode



This completes the procedure for saving the results of online autotuning When the Servopack is turned on again, the inertia ratio set in Pn103 will be used as the default value

Using the Built-in Panel Operator


1. Press the MODE/SET Key and select Fn007 in the auxiliary function mode



2. Press the DATA/SHIFT Key for a minimum of 1 second If the inertia ratio is 200%, for example, the following data will be displayed



3. Press the MODE/SET Key The following display will flash for 1 second and then the inertia ratio will be saved



4. Press the DATA/SHIFT Key for a minimum of 1 second to return to the auxiliary function mode



This completes the procedure for saving the results of online autotuning When the Servopack is turned on again, the inertia ratio set in Pn103 will be used as the default value

6.3.4 User Constants Related to Online Autotuning

This section provides information on a variety of user constants related to online autotuning

■ Online Autotuning Method

The following user constant is used for setting the autotuning conditions

Pn110.0	Online Autotuning Method	Factory Setting: 0	Speed Control, Position Control

Pn110.0 Setting	Description
0	Autotuning is performed only when the system runs for the first time after the power is turned ON After the load inertia is calculated, the calculated data is not refreshed
1	Autotuning is continuously performed (inertia value calculation)
2	The online autotuning function is not used

This user constant is factory-set to "0" If the load inertia change is minimal or if the application makes few changes, there is no need to continue calculating the inertia while the system is in operation Instead. continue to use the value that was calculated when the system was first started up

Set this user constant to "1" if the load inertia always fluctuates due to the load conditions Then the response characteristics can be kept stable by continuously refreshing the inertia calculation data is refreshed continuously and reflecting them in the servo gain

If the load inertia fluctuation results within 200 ms, the inertia calculation data may not be refreshed properly If that happens. set Pn110 0 to "0" or "2 "

Set Pn110 0 to "2" if autotuning is not available or if the online autotuning function is not used because the load inertia is already known and the Servopack is manually adjusted by setting the inertia ratio data in Pn103

■ Speed Feedback Compensation Selection

Use the following user constant to enable or disable speed feedback compensation Refer to *6 2 6 Speed Feedback Compensation*

This user constant can be left as it is if online autotuning is performed If this user constant is set manually, however. the setting is reflected to the operational setting made during online autotuning

Pn110 1	Speed Feedback Compensation Selection	Factory Setting: 1	Speed Control, Position Control

Pn110.1 Setting	Description
0	Enabled
1	Disabled

■ Friction Compensation Selection

Use the following user constant to enable or disable friction compensation to determine whether or not the friction of the servo system is to be taken into consideration for the calculation of load inertia

If this compensation function is enabled, select small or large friction compensation according to the extent of friction in order to ensure highly precise load inertia calculation

Pn110 2	Friction Compensation Selection	Factory Setting: 1	Speed Control, Position Control

Pn110 2 Setting	Description
0	Friction compensation Disabled
1	Friction compensation Small
2	Friction compensation Large

INFO

1. Do not set friction compensation for loads with low friction (10% rated torque/speed or less)
2. Autotuning will be perform as if the load inertia was 30 times the motor inertia

■ Differences from Conventional Autotuning

Online autotuning of the SGDM Servopack identifies the load inertia during normal operation without any special turning procedures, and runs the machine with the set gain

The SGDM Servopack has the load inertia ratio in the user constants separate from the speed loop gain

While autotuning changes the speed loop gain for a conventional SGDA Servopack, the load inertia ratio, not the speed loop gain, is changed for a SGDM Servopack (When the result of online autotuning has been saved.)

The following describes the relationship between the speed loop gain set value, the actual machine speed loop gain, and inertia

- SGDM Servopack

$$\text{Actual speed loop gain [Hz]} = \text{Pn100} \times \frac{(\text{Pn103} + 100)}{100} \times \frac{\text{JM}}{\text{JM} + \text{JL}}$$

JM Rotor inertia
JL Load inertia

When the Pn103 value coincides with the actual load inertia ratio

$$\text{Actual speed loop gain [Hz]} = \text{Pn100}$$

- SGDA Servopack

$$\text{Actual speed loop gain [Hz]} = \text{Cn-04} \times \frac{2 \times \text{JM}}{\text{JM} + \text{JL}}$$

JM Rotor inertia
JL Load inertia

Only when JM = JL

$$\text{Actual speed loop gain [Hz]} = \text{Cn-04}$$

6.4 Servo Gain Adjustments

This section describes information on the basic rules of gain adjustments in the Servopack, adjustment methods in a variety of cases, and reference set values

6.4.1 Servo Gain User Constants

The following user constants must be set properly for servo gain adjustments

- Pn100 Speed loop gain
- Pn101 Speed loop integral time constant
- Pn102 Position loop gain
- Pn401 Torque reference filter time constant

If the Servopack is used in the speed control mode with the analog voltage reference, the position loop is controlled by the host device Therefore, position loop gain is adjusted through the host device

If the host is not available for adjustments of position loop gain, set the speed reference input gain in user constant Pn300 If the set value is improper, the Servomotor may not run at top speed

6.4.2 Basic Rules of Gain Adjustment

The servo system consists of three feedback loops (i e . position loop, speed loop, and current loop) The innermost loop must have the highest response speed and the middle loop must have higher response speed than the outermost If this principle is not followed, it will result in vibration or poor responsiveness

The Servopack is designed to ensure that the current loop has good response performance The user need only adjust position loop and speed loop gain

The servo system block diagram consists of the position, speed, and current loops, as shown below

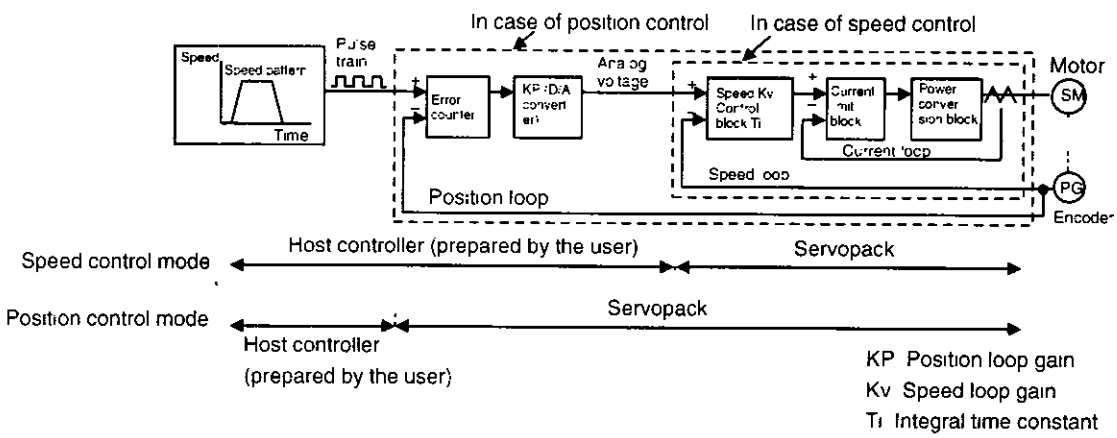


Figure 6 1 Servo System Block Diagram

- Generally speaking, the responsiveness of the position loop cannot be higher than that of the speed loop. Therefore, to increase the position loop gain, you must first increase the speed loop gain. If only the position loop gain is increased, oscillation will result in the speed reference and positioning time will increase, not decrease.

  Position loop gain can be increased only to the point where oscillation begins in the mechanical system.

- If the position loop response is faster than the speed loop response, speed reference output from the position loop cannot follow the position loop response due to the slow speed loop response. Therefore, smooth linear acceleration or deceleration will not be possible and the position loop will keep accumulating errors, thus increasing the amount of speed reference output.

  As a result, the motor speed will be excessive and the position loop will try decreasing the amount of speed reference output. The speed loop responsiveness will be poor, however, and the motor will not be able to catch up with the speed reference. As a result, the speed reference will oscillate as shown in the following graph. If this happens, reduce the position loop gain or increase the speed loop gain to prevent the speed reference from oscillating.

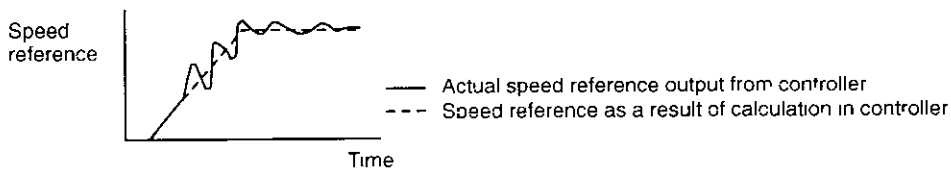


Figure 6 2 Speed Reference with Position Loop Gain and Speed Loop Responsiveness Not Well-balanced

- The position loop gain must not exceed the natural frequency of the mechanical system. For example, if the mechanical system is an articulated robot, the rigidity of the machinery mechanism is very low because the mechanism incorporates a wave reduction gear and the natural frequency of the mechanical system is 10 to 20 Hz. In this case, the position loop gain can be set to 10 to 20 (1/s).

  If the mechanical system is a chip mounting machine, IC bonding machine, or high-precision machining tool, the natural frequency of the system is 70 Hz or more. Therefore, the position loop gain can be set to 70 (1/s) or higher.

- When high responsiveness is required, it is not only important to ensure the responsiveness of the servo system that is employed (the controller, Servopack, motor, and encoder), but it is also necessary to ensure that the mechanical system have high rigidity.

6.4.3 Making Manual Adjustments

The autotuning function uses a gain adjustment algorithm with a comparatively large safety margin by considering a variety of mechanical systems to which the Servopack is applied Therefore, the Servopack may not satisfy the response characteristics of some applications The autotuning function is not available to machines with low rigidity or high fluctuation

In such cases, observe the mechanical systems and make manual adjustments of user constants

■ Speed Control

Required User Constants

The following user constants are used

- Speed Loop Gain (Pn100)

  This user constant is used for determining the response speed of the speed loop The response speed increases if the constant is set to a large value provided that the mechanical system does not vibrate The value of speed loop gain is the same as the set value of Pn100 if the inertia ratio set in Pn103 is correct

  Speed loop gain Kv = Set value of Pn100 (Hz)

  Set Pn103 to the following value

$$\text{Pn103 setvalue} = \frac{\text{Motor axis conversion load inertia } (J_L)}{\text{Servomotor rotor inertia } (J_M)} \times 100(\%)$$

INFO In the case of manual adjustments of user constants the user must set the value of user constant Pn103 The inertia ratio can be obtained if the servo gain constant is written with user constant Fn007 after autotuning has been performed For details regarding Fn007 refer to *6 3 Autotuning*

- Speed Loop Integral Time Constant (Pn101)

  The speed loop has an integral element so that the speed loop can respond to minute inputs This integral element delays the operation of the servo system, so a longer positioning setting time is required with slower response speed as the value of the time constant increases If the load inertia is large or the mechanical system is likely to vibrate, make sure that the speed loop integral time constant is large enough, otherwise the mechanical system will vibrate The following formula is the standard

$$T_I \geqq 2.3 \times \frac{1}{2\pi \times Kv}$$

  T_I Integral time constant [s]

  Kv Speed loop gain (calculated from the above) [Hz]

- Torque Reference Filter Time Constant (Pn401)

  If the mechanical system uses ball screws, torsion resonance may result, in which case the oscillation noise will be a high-pitched tone The oscillation may be stopped by increasing the time constant of the torque reference filter Like the integral time constant, this filter causes a delay in the operation of the servo system Therefore, this constant must not be set to an excessively large value

- Speed Reference Input Gain (Pn300)

  Changing the speed reference input gain set in Pn300 is equivalent to changing the position loop gain In other words, an increase in the speed reference input gain set in Pn300 is equivalent to a decrease in the position loop gain and vice versa Use this user constant in the following cases

  - When the host controller does not have a function for adjusting the position loop gain (The host incorporates a D/A converter to change the number of bits but cannot make fine adjustments of position loop gain)
  - When it is necessary to clamp the full range of the speed reference output of the host device to a specified rotation speed

  In normal operation the factory-set value can be used as it is

INFO If the Servopack is used for speed control the position loop gain set in Pn102 is enabled in zero-clamp mode only In normal control operation change the position loop gain through the host or change the speed reference input gain in Pn300 in the Servopack The position loop gain remains the same if the setting in Pn102 is changed

6

Adjustment Method

1. Set the position loop gain to a comparatively low value in the host device Then increase the speed loop gain set in Pn100 to within a range where there is no noise or oscillation resulting If the position loop gain cannot be changed through the host device, increase the speed reference input gain set in Pn300 to a larger value
2. Decrease the speed loop gain a little from the value set in step 1 Then increase the position loop gain through the host controller to within a range where there is no noise or oscillation resulting As in step 1 , decrease the set value of Pn300 if the position loop gain cannot be changed through the host device
3. Set the speed loop integral time constant in Pn101 while observing the positioning setting time and the vibration of the mechanical system If the constant is too large, positioning setting time will be long
4. Set the torque reference filter to a small value in Pn401 if the mechanical system has shaft torsion resonance If the mechanical system generates oscillation noise in a high-pitched tone, shaft torsion resonance may be occurring In that case, set Pn401 to a larger value
5. Finally, progressively make fine adjustments to user constants such as the position loop gain, speed loop gain, and integral time constant to find the optimal points

■ Position Control

User Constants

The following user constants are used

- Speed Loop Gain (Pn100)

  This user constant is used for determining the response speed of the speed loop The response speed increases if the constant is set to a large value provided that the mechanical system does not vibrate The value of speed loop gain is the same as the set value of Pn100 if the inertia ratio set in Pn103 is correct

  Speed loop gain Kv = Set value of Pn100 (Hz)

  Set Pn103 to the following value

$$\text{Pn103 set value} = \frac{\text{Motor axis conversion load inertia } (J_L)}{\text{Servomotor rotor inertia } (J_M)} \times 100(\%)$$

INFO

In the case of manual adjustments of user constants the user must set the value of user constant Pn103 The inertia ratio can be obtained if the servo gain constant is written with user constant Fn007 after autotuning has been performed For details regarding Fn007 refer to *6 3 Autotuning*

- Speed Loop Integral Time Constant (Pn101)

  The speed loop has an integral element so that the speed loop can respond to minute inputs This integral element delays the operation of the servo system, so a longer positioning setting time is required with slower response speed as the value of the time constant increases

  If the load inertia is large or the mechanical system is likely to vibrate, make sure that the speed loop integral time constant is large enough, otherwise the mechanical system will vibrate The following is a standard

$$T_I \geqq 2.3 \times \frac{1}{2\pi \times Kv}$$

  T_I Integral time constant [s]

  Kv Speed loop gain (calculated from the above) [Hz]

- Torque Reference Filter Time Constant (Pn401)

  If the mechanical system uses ball screws, torsion resonance may result, in which case the oscillation noise will be a high-pitched tone The oscillation may be stopped by increasing the time constant of the torque reference filter Like the integral time constant, this filter causes a delay in the operation of the servo system Therefore, this constant must not be set to an excessively large value

- Position Loop Gain (Pn102)

  The responsiveness of the servo system is determined by the position loop gain. The response speed increases if the position loop gain is set to a high value, so the time required for positioning will be shortened. In order to set the position loop gain to a high value, the rigidity and natural frequency of the mechanical system must be high.

  The responsiveness of the whole servo system may become unstable if only the position loop gain is increased, because the speed reference as output from the position loop is likely to become unstable. Increase the speed loop gain while observing the response.

Adjustment Method

1. Set the position loop gain to a comparatively low value. Then increase the speed loop gain set in Pn100 to within a range where there is no noise or oscillation resulting.
2. Decrease the speed loop gain a little from the value set in step 1. Then increase the position loop gain to within a range where there is no overshooting or oscillation resulting.
3. Set the speed loop integral time constant in Pn101 while observing the positioning setting time and the vibration of the mechanical system. If the constant is too large, the positioning setting time will be too long.
4. Set the torque reference filter to a small value in Pn401 if the mechanical system has shaft torsion resonance. If the mechanical system generates oscillation noise in a high-pitched tone, shaft torsion resonance may be resulting. In that case, set Pn401 to a larger value.
5. Finally progressively make fine adjustments to user constants such as the position loop gain, speed loop gain, and integral time constant to find the optimal points.

■ Function to Improve Response Characteristics

The mode switch, feed-forward, and bias functions can improve the response characteristics of the servo system only if they are used properly. If they are used improperly, they will worsen the response characteristics. Refer to the following instructions and make adjustments to these functions while observing the change in the actual response characteristics.

Mode Switch

Use the mode switch function in order to improve the saturation characteristics of the servo system if there is torque reference saturation at the time of acceleration or deceleration of the Servomotor. If an appropriate value is set with this function, the speed loop in PI (proportional and integral) control is switched over to P (proportional) control when the operation speed exceeds the set value.

Feed-forward Functions

The responsiveness is increased by using one of the feed-forward functions A feed-forward function is not so effective, however, if the position loop gain is set to a high enough value Adjust the feed-forward set value of Pn109 as described below

1. Adjust the speed loop and position loop according to the method described on page 6 -32
2. Gradually increase the set value of Pn109 so that the positioning completion signal (/COIN) will be output quickly


   Make sure that the positioning completion signal (/COIN) is not broken (i e , turned on and off repeatedly within a short period) and that speed overshooting does not result These are likely to occur if the feed-forward value is too high

   It is possible to add a primary delay filter (to be set in Pn10A) to the feed-forward function The primary delay filter may prevent the positioning completion signal from breaking and the system speed from overshooting

Bias Function

This function adds the bias set in Pn107 to the output (i e , speed reference) of the error counter if the number of accumulated pulses of the error counter exceeds the bias increment width set in Pn108 and stops adding the bias if the output is within the bias increment width As a result, the number of accumulated pulses of the error counter decreases and the time required for positioning can be shortened

If the bias set value of Pn107 is too large, the motor rotation will be unstable The optimum bias value varies with the load, gain, and bias increment width Make bias adjustments while observing the response When not using this function, set Pn107 to 0

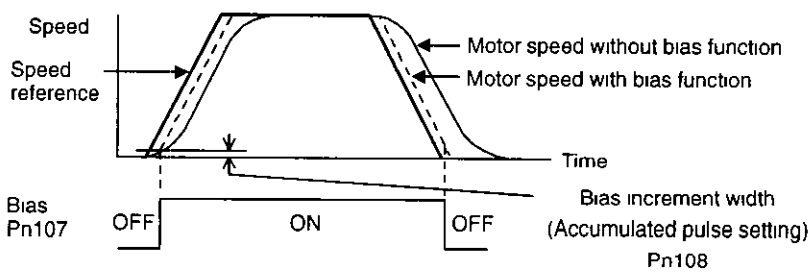

6.4.4 Gain Setting Reference Values

This section describes information on servo gain values as reference for making gain adjustments

Refer to the following for standards for gain adjustments according to the rigidity of the mechanical system Refer to these values and use the previously mentioned methods to make gain adjustments These values are for reference only and do not mean that the mechanical system has good response characteristics or is free from oscillation in the specified ranges

Observe the response by monitoring the response waveform and make the optimum gain adjustments If the rigidity of the machinery is high, further gain increments exceeding the described ranges are possible

■ Machines with High Rigidity

These machines are directly connected to ball screws

Example Chip mounting machine bonding machine, high-precision machine tool

Position Loop Gain (Pn102) [1/s]	Speed Loop Gain (Pn100) [Hz]	Speed Loop Integral Time Constant (Pn101) [ms]
50 to 70	50 to 70	5 to 20

■ Machines with Medium Rigidity

These machines are driven by ball screws through speed reducers or long-length machines directly driven by screws

Example General machining tool, transverse robot, and conveyor

Position Loop Gain (Pn102) [1/s]	Speed Loop Gain (Pn100) [Hz]	Speed Loop Integral Time Constant (Pn101) [ms]
30 to 50	30 to 50	10 to 40

■ Machines with Low Rigidity

These machines are driven by timing belts or chains or machines with wave reduction gears

Example Conveyor and articulated robot

Position Loop Gain (Pn102) [1/s]	Speed Loop Gain (Pn100) [Hz]	Speed Loop Integral Time Constant (Pn101) [ms]
10 to 20	10 to 20	50 to 120

IMPORTANT

If the inertia ratio is a little larger than 10 start gain adjustments with the position and speed loop gains slightly below the above corresponding ranges and the speed loop integral constant slightly exceeding the above corresponding range If the inertia ratio is much larger start the gain adjustments with the position and speed loop gains set to the smallest values and the speed loop integral constant to the largest value in the above corresponding ranges

In speed control operation, the position loop gain is set through the host device If that is not possible, adjust the position loop gain with the speed reference input gain in Pn300 in the Servopack In speed control operation, the position loop gain set in Pn102 is enabled in zero-clamp mode only Position loop gain Kp is obtainable from the following


$$Kp \geqq \frac{Vs}{\epsilon}$$

- Kp (1/S) Position Loop Gain
- Vs (PPS) Constant Speed Reference
- ε (Pulse) Constant error The number of accumulated pulses of the error counter at the above constant speed

6.5 Analog Monitor

The analog monitor can observe a variety of signals through analog voltages

Analog monitor signals must be observed through the CN5 connector using DE9404559 dedicated cable

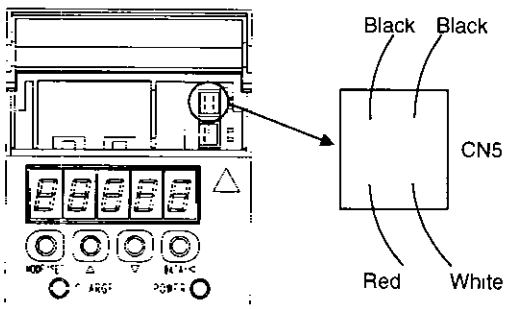

Cable Color	Signal Name	Description
White	Analog monitor 1	Torque reference 1 V/100% rated torque
Red	Analog monitor 2	Motor r/min 1 V/1000 r/min
Black (two wires)	GND(0 V)	–

Analog monitor signals can be selected with user constants Pn003 0 and Pn003 1

Pn003 0	**Analog Monitor 1**	**Factory Setting 2**	**Speed/Torque Control, Position Control**
Pn003 1	**Analog Monitor 2**	**Factory Setting. 0**	**Speed/Torque Control, Position Control**

The following monitor signals can be observed

Settings in Pn003 0 and Pn003 1	Description	
	Monitor signal	Observation gain
0	Motor r/min	1 V/1000 r/min
1	Speed reference	1 V/1000 r/min
2	Torque reference	1 V/100% rated torque
3	Position error	0 05 V/1 reference unit
4	Position error	0 05 V/100 reference unit
5	Reference pulse frequency (converted to r/min)	1 V/1000 r/min
6	Motor r/min	1 V/250 r/min
7	Motor r/min	1 V/125 r/min
8 to E	Reserved monitor signal	–

Note In the case of torque control or speed control the monitor signal of position error monitor signal is indefinite

INFO The output voltage of the analog monitor is ±8 V max The output voltage will be reversed if ±8 V is exceeded

7

Using the Digital Operator

This chapter describes the basic operation of the Digital Operator and the features it offers All constant settings and motor operations can be executed by simple, convenient operations Operate the Digital Operator as you read through this chapter

7.1 Basic Operation .... 7 - 2

7 1 1 Connecting the Digital Operator 7 - 2

7 1 2 Functions 7 - 3

7 1 3 Resetting Servo Alarms 7 - 4

7 1 4 Basic Mode Selection 7 - 5

7 1 5 Status Display Mode 7 - 5

7 1 6 Operation in User Constant Setting Mode 7 - 8

7 1 7 Operation in Monitor Mode 7 - 14

7 2 Applied Operation ... . 7 - 19

7 2 1 Operation in Alarm Traceback Mode 7 - 20

7 2 2 Controlling Operation Through the Digital Operator 7 - 21

7 2 3 Automatic Adjustment of the Speed and Torque Reference Offset 7 - 23

7 2 4 Manual Adjustment of the Speed and Torque Reference Offset 7 - 26

7 2 5 Clearing Alarm Traceback Data 7 - 30

7 2 6 Checking the Motor Model 7 - 32

7 2 7 Checking the Software Version 7 - 35

7 2 8 Origin Search Mode 7 - 36

7 2 9 Initializing User Constant Settings 7 - 38

7 2 10 Manual Zero Adjustment and Gain Adjustment of Analog Monitor Output 7 - 40

7 2 11 Adjusting the Motor Current Detection Offset 7 - 45

7 2 12 Password Setting (Write Prohibited Setting) 7 - 49


7.1 Basic Operation

This section provides information on the basic operation of the Digital Operator for setting operating conditions

7.1.1 Connecting the Digital Operator

There are two types of Digital Operator One is a built-in operator incorporating a panel indicator and switches located on the front panel of the Servopack This type of Digital Operator is also called a Panel Operator The other one is a Hand-held Operator (i e . the JUSP-OP02A-2 Digital Operator), which can be connected to the Servopack through connector CN3 of the Servopack

There is no need to turn OFF the Servopack to connect this Hand-held Operator to the Servopack Refer to the following illustrations to connect the Hand-held Digital Operator to the Servopack

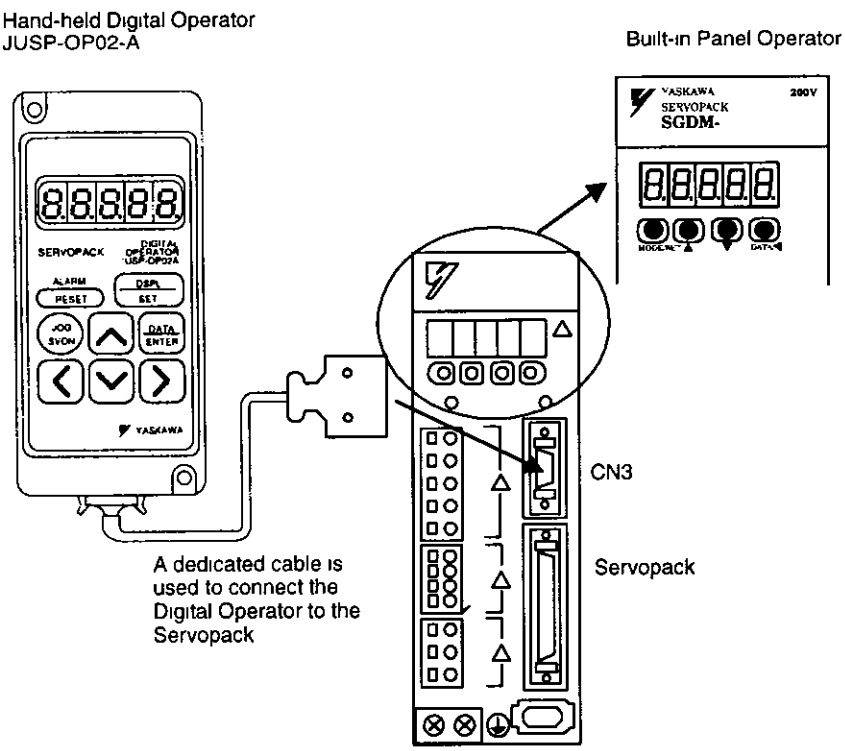

IMPORTANT


If the Hand-held Digital Operator is connected to the Servopack, the built-in Panel Operator does not display anything

7.1.2 Functions

The Digital Operator can be used user constant settings, operating references, and status displays

This section provides information on the keys and their functions available from the initial displays


Hand-held Digital Operator

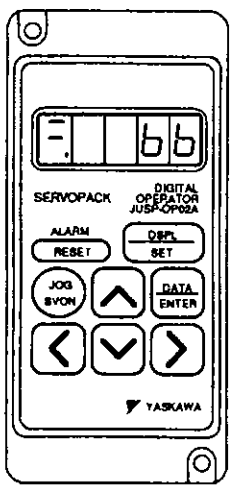


Key	Name		Function
ALARM RESET	RESET Key		Press this key to reset the servo alarm
DSPL SET	DSPL/SET Key		• Press this key to select the status display mode, auxiliary function mode user constant setting mode, or monitor mode • This key is used for data selection in user constant setting mode
DATA ENTER	DATA/ENTER Key		Press this key to set each user constant or display the set value of each user constant
^	Value Change/JOG Key	Up Cursor Key	Press this key to increase the set value This key is used as a forward start key in JOG operation
v		Down Cursor Key	Press this key to decrease the set value This key is used as a reverse start key in JOG operation
>	Digit Select Key	Right Cursor Key	• Press this key to select the digit to be changed The selected digit flashes • Press the Right Cursor Key to shift to the next digit on the right • Press the Left Cursor Key to shift to the next digit on the left
<		Left Cursor Key	
JOG SVON	SVON Key		Press this key to perform the JOG operation with the Digital Operator

■ Display Messages

The following messages appear when using the Digital Operator



When the function is executed




When the operation is failed



When the function is not executed

Built-in Panel Operator



Key	Name	Function
	Up Cursor Key	• Press this key to set user constants or display the set values of user constants • Press the Up Cursor Key to increase the set value • Press the Down Cursor Key to decrease the set value • Press the Up and Down Cursor Keys together to reset a servo alarm
	Down Cursor Key	
MODE/SET	MODE/SET Key	Press this key to select the status indicator mode, auxiliary function mode, user constant setting mode, or monitor mode
DATA/	DATA/SHIFT Key	• Press this key to set each user constant or display the set value of each user constant • This key is used for selecting the editing (flashing) digit or data setting

7.1.3 Resetting Servo Alarms

Servo alarms can be reset using the Digital Operator

■ Using the Hand-held Digital Operator

Press the RESET Key in status display mode

■ Using the Built-in Panel Operator

Press the Up and Down Cursor Keys together in status display mode

The alarm can be reset with CN1-44, or /ALM-RST signal input Refer to *5 5 1 Using Servo Alarm and Alarm Code Outputs*

The servo alarm need not be reset if the control power supply is turned OFF


IMPORTANT If an alarm is ON, reset the alarm after eliminating the cause of the alarm Refer to *9 2 Troubleshooting*

7.1.4 Basic Mode Selection

The basic mode selection of the Digital Operator is used for indicating the status of the Servopack in operation and setting a variety of user constants and operation references

The status display, auxiliary function, user constant setting, and monitor modes are the basic modes As shown below, the mode is selected in the following order by pressing the key

Hand-held Digital Operator	Panel Operator
Press the DSPL/SET Key The basic mode changes	Press the MODE/SET Key The basic mode changes

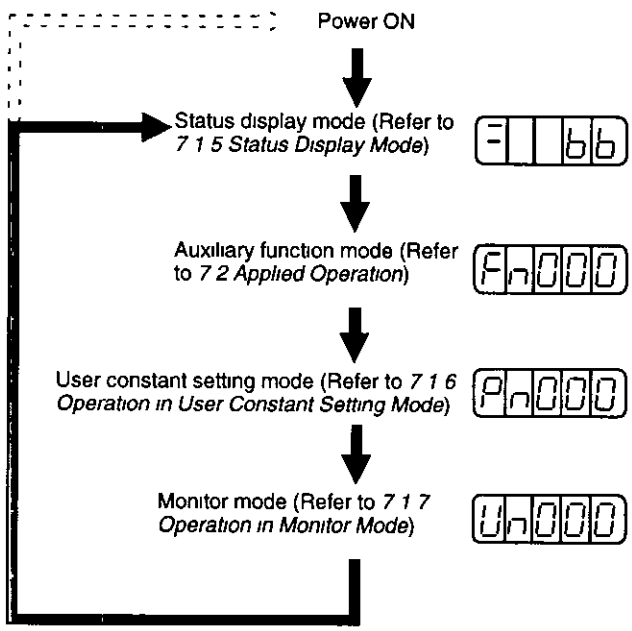

7.1.5 Status Display Mode

In status display mode, bit data and codes are displayed to indicate the status of the Servopack


■ Selecting Status Display Mode

The Digital Operator goes into status display mode when the Digital Operation is turned ON

■ Items Indicated in Status Display Mode

The displayed contents in the status display mode are different for the speed and torque control mode and the position control mode

Speed and Torque Control Mode

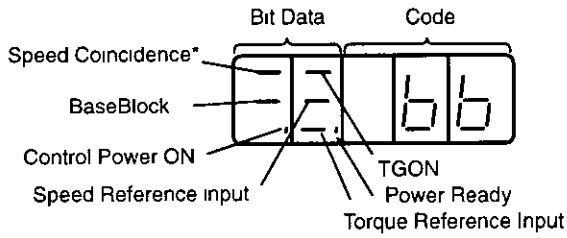

* This indicator is always lit when the Servopack is in torque control mode

The following tables list bit data items, codes, and their meanings


Table 7 1 Bit Data and Meanings in Speed and Torque Control Mode

Bit Data	Meaning
Control Power ON	Lit when Servopack control power is ON
Baseblock	Lit for baseblock Not lit when servo is ON
Speed Coincidence	Lit when the difference between the motor speed and reference speed is the same as or less than the value set in Pn503 The standard value set in Pn503 is 10 r/min
/TGON	Lit if motor speed exceeds preset value Not lit if motor speed is below preset value Preset value Set in Pn502 (20 r/min is factory setting)
Speed Reference Input	Lit if input speed reference exceeds preset value Not lit if input speed reference is below preset value Specified value Set in Pn502 (20 r/min is factory setting)
Torque Reference Input	Lit if input torque reference exceeds preset value Not lit if input torque reference is below preset value Preset value 10% rated torque is standard setting
Power Ready	Lit when main power supply circuit is normal Not lit when power is OFF

Table 7 2 Codes and Meanings in Speed and Torque Control Mode

Code	Meaning
bb	**Baseblock** Servo OFF (motor power OFF)
Run	**Run** Servo ON (motor power ON)
Pot	**Forward Run Prohibited** CN1-42 (P-OT) is OFF Refer to *5 1 2 Setting the Overtravel Limit Setting*
not	**Reverse Run Prohibited** CN1-43 (N-OT) is OFF Refer to *5 1 2 Setting the Overtravel Limit Setting*
A02 A03	**Alarm Status** Displays the alarm number Refer to *9 2 Troubleshooting*

Position Control Mode

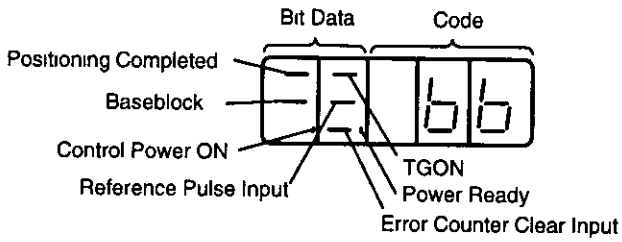

The following tables list bit data items, codes, and their meanings

Table 7.3 Bit Data and Meanings in Position Control Mode

Bit Data	Meaning
Control Power ON	Lit when Servopack control power ON
Baseblock	Lit for baseblock Not lit at servo ON
Positioning Completed	Lit if error between position reference and actual motor position is below preset value Not lit if error between position reference and actual motor position exceeds preset value Preset value Set in PN500 (7 pulses are standard setting)
/TGON	Lit if motor speed exceeds preset value Not lit if motor speed is below preset value Preset value Set in Pn502 (20 r/min is standard setting)
Reference Pulse Input	Lit if reference pulse is input Not lit if no reference pulse is input
Error Counter Clear Input	Lit when error counter clear signal is input Not lit when error counter clear signal is not input
Power Ready	Lit when main power supply circuit is normal Not lit when power is OFF

Table 7 4 Codes and Meanings in Position Control Mode

Code	Meaning
bb	**Baseblock** Servo OFF (motor power OFF)
Run	**Run** Servo ON (motor power ON)
PoT	**Forward Run Prohibited** CN1-42 (P-OT) is OFF Refer to *5 1 2 Setting the Overtravel Limit Setting*
noT	**Reverse Run Prohibited** CN1-43 (N-OT) is OFF Refer to *5 1 2 Setting the Overtravel Limit Setting*
A02	**Alarm Status** Displays the alarm number Refer to *9 2 Troubleshooting*
A03	

7.1.6 Operation in User Constant Setting Mode

Functions can be selected or adjusted by setting user constants There are two types of user constants One type requires value setting and the other requires function selection These two types use different setting methods

With value setting, a user constant is set to a value within the specified range of the user constant With function selection, the functions allocated to each digit of the seven-segment LED panel indicator (five digits) can be selected Refer to *Appendix B List of User Constants*


■ Changing Constant Settings

The constant settings can be used for changing constant data Check the permitted range of the constants in *Appendix B List of User Constants*, before changing the data The example below shows how to change user constant Pn507 from 100 to 85



Using the Hand-held Digital Operator

1 Press DSPL/SET Key to select the user constant setting mode




2. Select the user constant number to set (Pn507 is selected in this example)

   Press the Left or Right Cursor Key to select the digit The selected digit will flash

   Press the Up or Down Cursor Key to change the value

3. Press the DATA/ENTER Key to display the current data for the user constant selected at step 2




4. Change to the required data

   Press the Left or Right Cursor Key to select the digit The selected digit will flash

   Press the Up or Down Cursor Key to change the value Continue pressing the key until "00085" is displayed


5. Press the DATA/ENTER Key to store the data The display will flash



6. Press the DATA/ENTER Key again to return to the user constant number display



This procedure has changed the setting of the user constant Pn507 from 100 to 85 Repeat steps 2 to 6 as often as required



Using the Panel Operator

1. Press the MODE/SET Key to select the user constant setting mode




2. Press the Up or Down Cursor Key to select the user constant number to set (Pn507 is selected in this example)
3. Press the DATA/SHIFT Key for a minimum of one second to display the current data for the user constant selected in step 2



4. Press the Up or Down Cursor Key to change to the desired value of "00085"

   As you keep pressing the Up or Down Cursor Key, and the display changes faster
5. Press the DATA/SHIFT Key for a minimum of one second to save the data The display will flash



6. Press the DATA/SHIFT Key once more for a minimum of one second to display the user constant number again



   This has changed the setting of the user constant Pn507 from 100 to 85

   Repeat steps 2 to 6 as often as required

IMPORTANT Press the DATA/SHIFT Key for a maximum of one second to shift to a higher (left) digit

INFO User constant numbers that are not defined are skipped during Operator operations

■ Function Selection User Constants

Types of Function Selection User Constants

The following table shows user the constants used for selecting Servopack functions

Category	User Constant No.	Name	Factory Setting	Remarks
Function Selection Constants	Pn000	Function Selection Basic Switches	0000	(See 1)
	Pn001	Function Selection Application Switches 1	0000	(See 1)
	Pn002	Function Selection Application Switches 2	0000	(See 1)
	Pn003	Function Selection Application switches 3	0002	
Gain-related Constants	Pn10B	Gain-related Application Switches	0000	(See 2)
	Pn110	Online Autotuning Switches	0010	(See 2)
Position Control-related Constant	Pn200	Position Control Reference Selection Switches	0000	(See 1)
Sequence-related Constants	Pn50A	Input Signal Selections 1	2100	(See 1)
	Pn50B	Input Signal Selections 2	6543	(See 1)
	Pn50C	Input Signal Selections 3	8888	(See 1)
	Pn50D	Input Signal Selections 4	8888	(See 1)
	Pn50E	Output Signal Selections 1	3211	(See 1)
	Pn50F	Output Signal Selections 2	0000	(See 1)
	Pn510	Output Signal Selections 3	0000	(See 1)

IMPORTANT

1. After changing these user constants, turn OFF the main circuit and control power supplies and then turn them ON again to enable the new settings
2. Pn10B 1 and Pn110 0 require the power to be reset as mentioned above

User constant settings are displayed in two patterns as shown below

User constants for function selection		Hexadecimal display for each digit
User constants for constant settings		Decimal display in five digits

Since each digit in the function selection user constants has a significant meaning, the value can only be changed for each individual digit Each digit displays a value within its own setting range


Definition of Display for Function Selection User Constants

Each digit of the function selection user constants has a unique meaning

For example, the rightmost digit of user constant Pn000 is expressed as "Pn000 0"

IMPORTANT


Each digit of the function selection user constants is defined as shown below The user constant display example shows how user constants are displayed in digits for set values

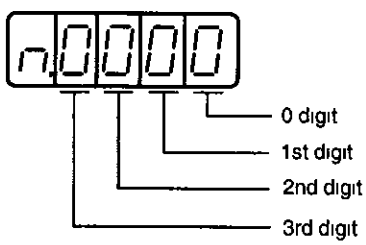

How to Display User Contents

Pn000 0	Indicates the value for the 0 digit of user constant Pn000
Pn000 1	Indicates the value for the 1st digit of user constant Pn000
Pn000 2	Indicates the value for the 2nd digit of user constant Pn000
Pn000 3	Indicates the value for the 3rd digit of user constant Pn000

■ Changing Function Selection User Constant Settings



Using the Hand-held Digital Operator


1. Press the DSPL/SET Key to select the constant setting mode




2. Select the user constant number to be set

   Press the Left or Right Cursor Key to select the digit The selected digit will flash
   Press the Up or Down Cursor Key to change the value (Pn000 is selected in this example)


3. Press the DATA/ENTER Key to display the current data of the user constant selected in the above step 2



4. Press the Left or Right Cursor Key to select the digit




5. Press the Up or Down Cursor Key to select the value defined as a function setting for the selected digit



   Repeat the above steps 4 and 5 for changing the data as required

6. Press the DATA/ENTER Key to save the data The display will flash



7. Press the DATA/ENTER Key once more to return to the user constant number display



   This has changed the 1st digit of user constant Pn000 to "1"




Using the Panel Operator


1. Press the MODE/SET Key to select the constant setting mode




2. Press the Up or Down Cursor Key to select the user constant number to be set (Pn000 is selected in this example)
3. Press the DATA/SHIFT Key for a minimum of one second to display the current data for the selected user constant



4. Press the DATA/SHIFT Key to select the digit to be set




5. Press the Up or Down Cursor Key to select the value defined as a function setting for the selected digit



Repeat the above steps 4 and 5 for changing the data as required

6. Press the DATA/SHIFT Key for a minimum of one second to save the data The display will flash



7. Press the DATA/SHIFT Key once more for a minimum of one second to return to the user constant number display



This has changed the 1st digit of user constant Pn000 to "1"

7.1.7 Operation in Monitor Mode

The monitor mode can be used for monitoring the reference values, I/O signal status, and Servopack internal status
The monitor mode can be set during motor operation

■ Using the Monitor Mode

The example below shows how to display 1500, the contents of monitor number Un000 when the Servomotor rotates at 1500 r/min




With the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the monitor mode




2. Press the Up or Down Cursor Key to select the monitor number to be displayed
3. Press the DATA/ENTER Key to display the monitor number selected in the above step 2



4. Press the DATA/ENTER Key once more to return to the monitor number display



This is how to display 1500, the contents of monitor number Un000




With the Panel Operator

1. Press the MODE/SET Key to select the monitor mode



2. Press the Up or Down Cursor Key to select the monitor number to be displayed
3. Press the DATA/SHIFT Key for a minimum of one second to display the monitor number selected in the above step 2



4. Press the DATA/SHIFT Key once more for a minimum of one second to return to the monitor number display



This completes the example procedure for displaying 1500, the contents of monitor number Un000

■ Contents of Monitor Mode Display

The following table shows contents of the monitor mode display

Monitor Number	Monitor Display	Unit	Remarks
Un000	Actual motor speed	r/min	
Un001	Input speed reference	r/min	*3
Un002	Internal torque reference	%	Value for rated torque
Un003	Rotation angle 1	pulses	Number of pulses from the origin
Un004	Rotation angle 2	deg	Angle (electrical angle) from the origin
Un005	Input signal monitor	–	*1
Un006	Output signal monitor	–	*1
Un007	Input reference pulse speed	r/min	*4
Un008	Error counter value	reference unit	Positional error*4
Un009	Accumulated load rate	%	Value for the rated torque as 100% Displays effective torque in 10 cycle
Un00A	Regenerative load rate	%	Value for the processable regenerative power as 100% Displays regenerative consumption power in 10 cycle
Un00B	Power consumed by DB resistance	%	Value for the processable power when dynamic brake is applied as 100% Displays DB power consumption in 10-s cycle
Un00C	Input reference pulse counter	–	In hexadecimal*2, *4
Un00D	Feedback pulse counter	–	In hexadecimal

* 1 Refer to *Sequence I/O Signal Monitor* on the next page

* 2 Refer to *Reference Pulse/Feedback Pulse Counter Monitor Display*

* 3 Displayed only in speed control mode

* 4 Displayed only in position control mode

■ Sequence I/O Signal Monitor Display

The following section describes the monitor display for sequence I/O signals

Input Signal Monitor Display




LED Number	Input Terminal Name	Factory Setting
1	SI0 (CN1-40)	/S-ON
2	SI1 (CN1-41)	/P-CON
3	SI2 (CN1-42)	P-OT
4	SI3 (CN1-43)	N-OT
5	SI4 (CN1-44)	/ALM-RST
6	SI5 (CN1-45)	/P-CL
7	SI6 (CN1-46)	/N-CL
8	(CN1-4)	SEN

Note Refer to *5 3 3 Input Circuit Signal Allocation* for details on input terminals


Input signals are allocated as shown above and displayed on the panel display of the Servopack or the Digital Operator They are indicated by ON/OFF display of seven-segment LEDs in top and bottom rows These segments turn ON depending on the input signals (ON for "L" level and OFF for "H" level)

◀EXAMPLE▶


- When /S-ON signal is ON (Servo ON at "L" signal)



- When /S-ON signal is OFF



- When P-OT signal operates (Operates at "H" signal)

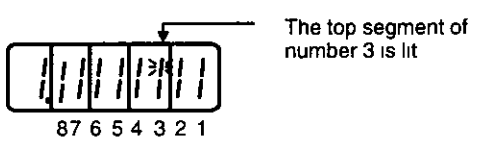

Output Signal Monitor Display




LED Number	Output Terminal Name	Factory Setting
1	(CN1-31, -32)	ALM
2	SO1 (CN1-25, -26)	/COIN or /V-CMP
3	SO2 (CN1-27, -28)	/TGON
4	SO3 (CN1-29, -30)	/S-RDY
5	(CN1-37)	AL01
6	(CN1-38)	AL02
7	(CN1-39)	AL03

Note Refer to *5 3 4 Output Circuit Signal Allocation* for details on output terminals

Output signals are allocated as shown above and displayed on the panel display of the Servopack or the Digital Operator They are indicated by ON/OFF display of seven-segment LEDs in top and bottom rows These segments turn ON depending on the output signals (ON for "L" level and OFF for "H" level)

◀EXAMPLE▶

- When ALM signal operates (alarm at "H")



■ Reference Pulse/Feedback Pulse Counter Monitor Display

The monitor display of reference pulse counter and feedback pulse counter is expressed in 32-bit hexadecimal

The display procedure is as follows




Using the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the monitor mode
2. Press the Up or Down Cursor Key to select "Un00C" or "Un00D"
3. Presss the DATA/ENTER Key to display the data for the monitor number selected in the above step



4. Press the Up or Down Cursor Key to alternately display the leftmost 16-bit data and rightmost 16-bit data



5. Press both the Up and Down Cursor Keys simultaneously to clear the 32-bit counter data
6. Press the DATA/ENTER Key once more to return to the monitor number display




Using the Panel Operator

1. Press the MODE/SET Key to select the monitor mode
2. Press the Up or Down Cursor Key to select "Un00C" or "Un00D"
3. Press the DATA/SHIFT Key for a minimum of one second to display the data for the monitor number selected in the above step



4. Press the Up or Down Cursor Key to alternately display the leftmost 16-bit data and rightmost 16-bit data



5. Press both the Up and Down Cursor Keys simultaneously to clear the 32-bit counter data
6. Press the DATA/SHIFT Key once more for a minimum of one second to return to the monitor number display

7.2 Applied Operation


This section describes how to apply the basic operations using the Digital Operator to run and adjust the motor Read the basic operations described in *section 7 1* before proceeding to this section

User constants for applied operation can be set in the auxiliary function mode The following table shows the user constants in the auxiliary function mode

User Constant Number	Function	Remarks
Fn000	Alarm traceback data display	
Fn001	Rigidity setting during online autotuning	(See note)
Fn002	JOG mode operation	
Fn003	Zero-point search mode	
Fn004	(Reserved constant)	
Fn005	User constant settings initialization	(See note)
Fn006	Alarm traceback data clear	(See note)
Fn007	Writing inertia ratio data obtained from online autotuning to EEPROM	(See note)
Fn008	Absolute encoder multi-turn reset and encoder alarm reset	(See note)
Fn009	Automatic tuning of analog (speed, torque) reference offset	(See note)
Fn00A	Manual adjustment of speed reference offset	(See note)
Fn00B	Manual adjustment of torque reference offset	(See note)
Fn00C	Manual zero-adjustment of analog monitor output	(See note)
Fn00D	Manual gain-adjustment of analog monitor output	(See note)
Fn00E	Automatic offset-adjustment of motor current detection signal	(See note)
Fn00F	Manual offset-adjustment of motor current detection signal	(See note)
Fn010	Password setting (protects from user constant changes)	–
Fn011	Motor models display	–
Fn012	Software version display	–
Fn013*	Multiturn limit value setting change when a Multiturn Limit Disagreement alarm occurs	(See note)

* User constant Fn013 is supported by the new version of SGDM Servopacks (SGDM-□□DA) only

Note These user constants and those indicated as Pn□□□ are displayed as shown below if their passwords are set (Fn010) These user constants cannot be changed




Flashing for one second

7.2.1 Operation in Alarm Traceback Mode

The alarm traceback mode can display up to ten alarms that have occurred, thus making it possible to check what kind of alarms have been generated

The alarm traceback data is not cleared on alarm reset or when the Servopack power is turned OFF This does not adversely affect operation

The data can be cleared using the special "clear alarm traceback mode " Refer to *Section* 7.2.5 *Clearing Alarm Traceback Data* for details

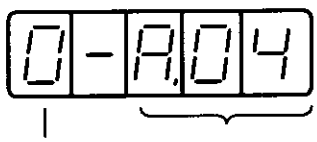

Alarm Sequence Number
The higher the number, the older the alarm data

Alarm Code
See the table of alarms

■ Checking Alarms

Follow the procedure below to determine which alarms have been generated



Using the Hand-held Digital Operator


1. Press the DSPL/SET Key to select the "Displaying alarm traceback data (Fn000)" in the auxiliary function mode



Alarm Traceback Display

2. Press the DATA/ENTER Key, and the alarm traceback data will be displayed
3. Press the Up Cursor Key or Down Cursor Key to scroll the alarm sequence numbers up or down and display information on previous alarms

The higher the left-hand digit (alarm sequence number), the older the alarm data



Using the Panel Operator

1. Press the MODE/SET Key to select the "Displaying alarm traceback data (Fn000)" in the auxiliary function mode



Alarm Traceback Display

2. Press the DATA/SHIFT for a minimum of one second to display the alarm traceback data
3. Press the Up Cursor Key or Down Cursor Key to scroll the alarm sequence numbers up or down and display information on previous alarms

The higher the left-hand digit (alarm sequence number), the older the alarm data

For descriptions of each alarm code, refer to *Section 9.2 Troubleshooting*

The following are Operator-related alarms which are not recorded in the traceback data

CPF00	Digital Operator transmission error 1
CPF01	Digital Operator transmission error 2

The display will be as shown below while no alarm is detected

0-A--

INFO Alarm traceback data will not be updated when the same alarm occurs repetitively


7.2.2 Controlling Operation Through the Digital Operator

⚠ CAUTION

- Forward run prohibited (P-OT) and reverse run prohibited (N-OT) signals are not effective during jog operations using user constant Fn002

Controlling operation through the Digital Operator allows the Servopack to run the motor This allows rapid checking of motor's rotation direction and speed setting during machine set-up and testing, without the trouble of connecting a host controller


For motor speed setting procedure, refer to *7 1 6 Operation in User Constant Setting Mode* and *5 3 2 Setting JOG Speed*

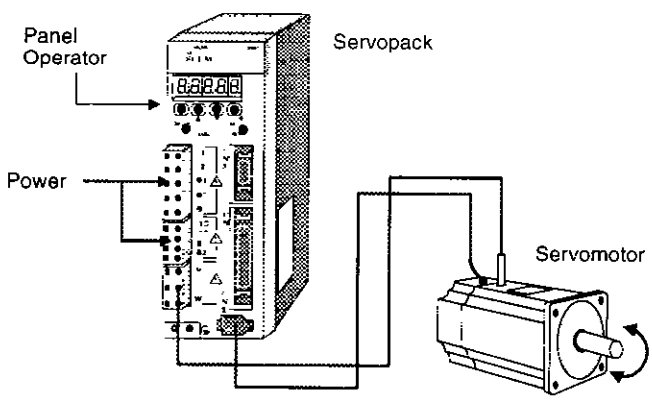

INFO The following conditions must be satisfied to perform JOG mode operation

- If the Servo-ON input signal (/S-ON) is ON, turn it OFF
- Release the Servo-ON signal mask with the setting Pn50A 1≠7 if user constant Pn50A 1 is set to 7 (if the Servo has been set to always be ON)

Operation procedure using the Digital Operator is described on the following pages



Using the Hand-held Digital Operator

1. Press the DSPL/SET Key to select Fn002 in the auxiliary function mode




2. Press the DATA/ENTER Key to select the Digital Operator operation mode Operation is now possible using the Digital Operator



3. Press the SVON key to set to the servo ON state (with motor power turned ON)



4. Press the Up Cursor Key or Down Cursor Key to operate the motor The motor keeps operating while the key is pressed



5. Press the DSPL/SET Key, and the display will revert to Fn002 This sets to the servo OFF state (with motor power turned OFF) Alternatively, press the SVON Key to set to the servo OFF state



This disables operation under Digital Operator control



Using the Panel Operator

1. Press the MODE/SET Key to select Fn002 in the auxiliary function mode




2. Press the DATA/SHIFT Key for a minimum of one second to select the Panel Operator operation mode Operation is now possible using the Panel Operator



3. Press the MODE/SET Key to set to the servo ON (with motor power turned ON)



4. Press the Up Cursor Key or Down Cursor Key to operate the motor The motor keeps operating while the key is pressed



5. Press the MODE/SET Key to set to the servo OFF state (with motor power turned OFF) Alternatively, press the DATA/SHIFT Key for a minimum of one second to set to the servo OFF state
6. Press the DATA/SHIFT Key for a minimum of one second, and the display will revert to Fn002 in the auxiliary function mode



This ends operation under Panel Operator control

The motor speed for operation under Digital Operator control can be changed with a user constant

User constant Pn304, Unit r/min Standard setting 500

INFO


The rotation direction of the Servomotor depends on the setting of user constant Pn000 0 "Rotation Direction " The above example shows a case where Pn000 0 is set to "0" as a factory setting

7.2.3 Automatic Adjustment of the Speed and Torque Reference Offset

When speed and torque control are used, the motor may rotate slowly even when 0 V is specified as the analog reference voltage This occurs when the host controller or external circuit has a small offset (measured in mV) in the reference voltage

The reference offset automatic adjustment mode automatically measures the offset and adjusts the reference voltage It adjusts both the speed and torque references

The following diagram illustrates automatic adjustment of an offset in the reference voltage by the Servopack

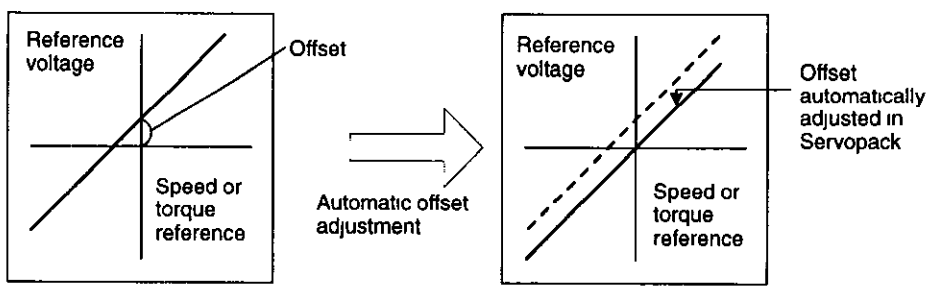

After completion of offset automatic adjustment, the amount of offset is stored in the Servopack


The amount of offset can be checked in the speed reference offset manual adjustment mode Refer to *Section 7 2 4 Manual Adjustment of the Speed and Torque Reference Offset* for details

The reference offset automatic adjustment mode cannot be used for setting the error pulses to zero for a stopped Servopack when a position loop is formed with a host controller In such cases, use the reference offset manual adjustment mode Refer to *Section 7 2 4 Manual Adjustment of the Speed and Torque Reference Offset* for details

The zero-clamp speed control function is available to force the motor to stop while the zero speed reference is given Refer to *Section 5 4 3 Using the Zero Clamp Function*


IMPORTANT Automatic adjustment of the speed/torque reference offset must be performed under the servo OFF state

Follow the procedure below to automatically adjust the speed/torque reference offset



Using the Hand-held Digital Operator

1. Input the (intended) 0 V reference voltage from the host controller or external circuit

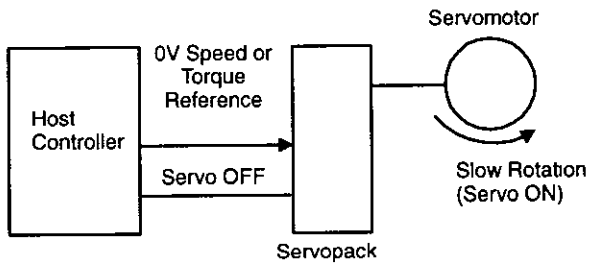

2. Press the DSPL/SET Key to select the auxiliary function mode



3. Select the user constant Fn009




Press the Left or Right Cursor Key to select the digit

Press the Up or Down Key to change the value

4. Press the DATA/ENTER Key, and the display will be as shown below




5. Press the DSPL/SET Key, and the following display will flash for one second The reference offset will be automatically adjusted



6. Press the DATA/ENTER Key to return to the auxiliary function mode display




This completes the speed/torque reference offset automatic adjustment



Using the Panel Operator

1. Input the (intended) 0V reference voltage from the host controller or external circuit

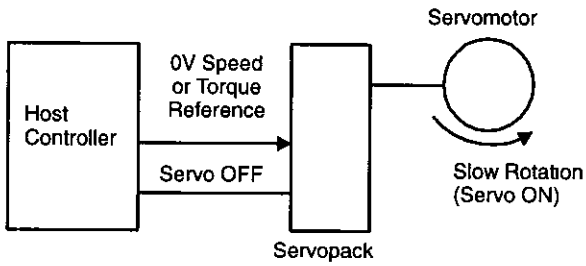

2. Press the MODE/SET Key to select the auxiliary function mode




3. Press the Up or Down Cursor Key to select the user constant Fn009



4. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below



5. Press the MODE/SET Key, and the following display will flash for one second The reference offset will be automatically adjusted



6. Press the DATA/SHIFT Key for a minimum of one second to return to the auxiliary function mode display



This completes the speed/torque reference offset automatic adjustment

7.2.4 Manual Adjustment of the Speed and Torque Reference Offset


Speed/torque reference offset manual adjustment is very convenient in the following situations

- If a loop is formed with the host controller and the error is zeroed when servo lock is stopped
- To deliberately set the offset to some value

This mode can also be used to check the data set in the reference offset automatic adjustment mode

In principle, this mode operates in the same way as the reference offset automatic adjustment mode, except that the amount of offset is directly input during the adjustment The offset amount can be set in the speed reference or torque reference

The offset setting range and setting units are as follows

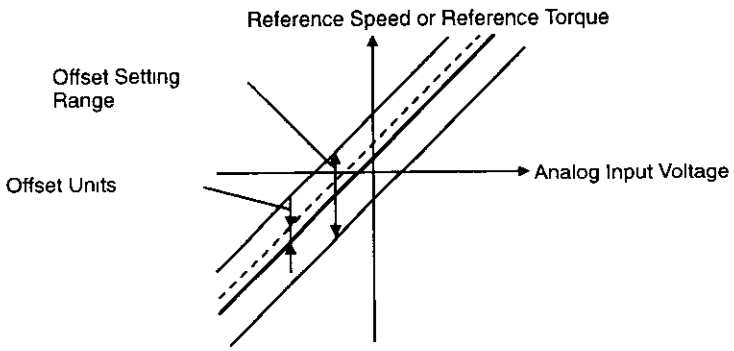

Offset Setting Range	Offset Setting Range
Speed Reference −1023 to +1023 (−9999 to +9999)*	Speed Reference 0 46 mV/LSB (0 058 mV/LSB)*
Torque Reference −128 to +127	Torque Reference 14 7 mV/LSB

* Values in parentheses are for the SGDM-□DA, and SGDM-□D (Version 0006 or later)

■ Speed Reference Offset Manual Adjustment

Follow the procedure below to manually adjust the speed reference offset



Using the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the auxiliary function mode



2. Select the user constant Fn00A

   Press the Left or Right Cursor Key to select the digit

   Press the Up or Down Cursor Key to change the value



3. Press the DATA/ENTER Key, and the display will be as shown below The manual adjustment mode for the speed reference offset will be entered



4. Turn ON the Servo ON (/S-ON) signal The display will be as shown below




5. Press the Left or Right Cursor Key, to display the speed reference offset amount



6. Press the Up or Down Cursor Key to adjust the amount of offset (adjustment of the speed reference offset)
7. Press the Right Cursor Key to return to the display shown in the above step 4
8. Press the DATA/ENTER Key to return to the auxiliary function mode display



This completes the speed reference offset manual adjustment



Using the Panel Operator

1. Press the MODE/SET Key to select the auxiliary function mode



2. Press the Up or Down Cursor Key to select the user constant Fn00A



3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below The manual adjustment mode for the speed reference offset will be entered



4. Turn ON the Servo ON (/S-ON) signal The display will be as shown below



5. Press the DATA/SHIFT Key for less than one second to display the speed reference offset amount



6. Press the Up or Down Cursor Key to adjust the amount of offset (adjustment of the speed reference offset)
7. Press the DATA/SHIFT Key for less than one second to return to the display shown in the above step 4

8. Press the DATA/SHIFT Key to return to the auxiliary function mode display



This completes the speed reference offset manual adjustment

■ Torque Reference Offset Manual Adjustment

Follow the procedure below to manually adjust the torque reference offset



Using the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the auxiliary function mode




2. Select the user constant Fn00B

   Press the Left or Right Cursor Key to select the digit


   Press the Up or Down Cursor Key to change the value



3. Press the DATA/ENTER Key, and the display will be as shown below The manual adjustment mode for the torque reference offset will be entered



4. Turn ON the Servo ON (/S-ON) signal The display will be as shown below




5. Press the Left or Right Cursor Key to display the torque reference offset amount



6. Press the Up or Down Cursor Key to adjust the offset amount (adjustment of torque reference offset)
7. Press the Left or Right Cursor Key. and the display will be as shown in the above step 4
8. Press the DATA/ENTER Key to return to the auxiliary function mode display



This completes the torque reference offset manual adjustment



Using the Panel Operator


1. Press the MODE/SET Key to select the auxiliary function mode



2. Press the Up or Down Cursor Key to select the user constant Fn00B



3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below The manual adjustment mode for the torque reference offset will be entered



4. Turn ON the Servo ON (/S-ON) signal The display will be as shown below



5. Press the DATA/SHIFT Key for less than one second, to display the torque reference offset amount



6. Press the Up or Down Cursor Key to adjust the offset amount (Adjustment of torque reference offset)
7. Press the DATA/SHIFT Key for less than one second, and the display will be as shown in the above step 4
8. Press the DATA/SHIFT Key to return to the auxiliary function mode



This completes the torque reference offset manual adjustment

7.2.5 Clearing Alarm Traceback Data

This procedure clears the alarm history, which stores the alarms generated in the Servopack Each alarm in the alarm history is set to A – –, which is not an alarm code Refer to *Section 7 2 1 Operation in Alarm Traceback Mode* for details

Follow the procedure below to clear the alarm traceback data



Using the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the auxiliary function mode



2. Select the user constant Fn006

   Press the Left or Right Cursor Key to select the digit

   Press the Up or Down Cursor Key to change the value



3. Press the DATA/ENTER Key, and the display will be as shown below




4. Press the DSPL/SET Key to clear the alarm traceback data The following display will flash for one second, and, after the alarm traceback data is cleared, the display will return to the one in the above step 3



5. Presss the DATA/ENTER Key to return to the user constant code display



This completes the alarm traceback data clearing procedure



Using the Panel Operator

1. Press the MODE/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn006



3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below



4. Press the MODE/SET Key to clear the alarm traceback data The following display will flash for one second, and, after the alarm traceback data is cleared, the display will return to the one in the above step 3



5. Press the DATA/SHIFT Key for a minimum of one second to return to the user constant code display




This completes the alarm traceback data clearing procedure

7.2.6 Checking the Motor Model

Set the user constant Fn011 to select the motor model check mode This mode is used for motor maintenance, and can also be used to check the specification codes of Servopacks made with special specifications

Follow the procedure below to check the motor model



Using the Hand-held Digital Operator


1. Press the DSPL/SET Key to select the auxiliary function mode



2. Select the user constant Fn011
   Press the Left or Right Cursor Key to select the digit
   Press the Up or Down Key to change the value



3. Press the DATA/ENTER Key to display the Servomotor model and voltage code



Voltage

Code	Voltage
00	100 VAC or 140 VDC
01	200 VAC or 280 VDC
02	Reserved

Servomotor Model

Code	Servomotor Model
00	SGMAH
01	SGMPH
02	SGMSH
03	SGMGH-□A (1500 r/min)
04	SGMGH-□B (1000 r/min)
05	Reserved

4. Press the DSPL/SET Key to display the Servomotor capacity



Capacity Displayed value × 10 (W)
In this example, the capacity is 100 W

5. Press the DSPL/SET Key to display the encoder type and resolution code



Encoder Type — Encoder Resolution

Encoder Type

Code	Type
00	Incremental encoder
01	Absolute encoder

Encoder Resolution

Code	Resolution
13	13 bits
16	16 bits
17	17 bits
20	Reserved

6. Press the DSPL/SET Key to display the Servopack's special specification code (Y-specification code)




This example shows specification code "Y10" (Indicated in decimal)

7. Press the DATA/ENTER Key to return to the auxiliary function mode display Pressing the DATA/ENTER Key after the above display 3 to 5 will also return to the auxiliary function mode display



This ends checking motor type procedure




Using the Panel Operator


1. Press the MODE/SET Key to select the auxiliary function mode



2. Press the Up or Down Cursor Key to select the user constant Fn011



3. Press the DATA/SHIFT Key for a minimum of one second to display the Servomotor model and voltage code

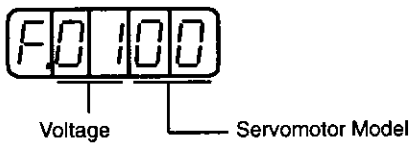


Voltage

Code	Voltage
00	100 VAC or 140 VDC
01	200 VAC or 280 VDC
02	Reserved

Servomotor Model


Code	Servomotor Model
00	SGMAH
01	SGMPH
02	SGMSH
03	SGMGH-□A (1500 r/min)
04	SGMGH-□B (1000 r/min)
05	Reserved

4. Press the MODE/SET Key to display the Servomotor capacity



Capacity unit Displayed value × 10 [W]
This example shows 100 W

5. Press the MODE/SET Key. and the encoder type and resolution code will be displayed

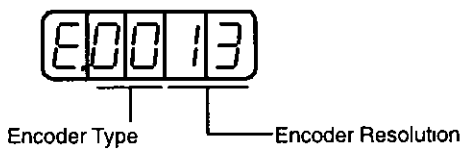

Encoder Type

Code	Type
00	Incremental encoder
01	Absolute encoder

Encoder Resolution


Code	Resolution
13	13 bits
16	16 bits
17	17 bits
20	Reserved

6. Press the MODE/SET Key to display the Servopack's modification index (Modification No)



This example shows modification index "Y10"
(Indicated in decimal)

7. Press the DATA/SHIFT Key to return to the auxiliary function mode display Pressing the DATA/SHIFT Key after the above display 3 to 5 will also return to the auxiliary function mode display



This completes the motor type checking procedure

7.2.7 Checking the Software Version

Set Fn012 to select the software-version check mode
This mode is used for the motor maintenance


Follow the procedure below to check the software version



Using the Hand-held Operator


1. Select the user constant Fn012
2. Press the DATA/ENTER Key, and the Servopack software version will be displayed

Software Version Display

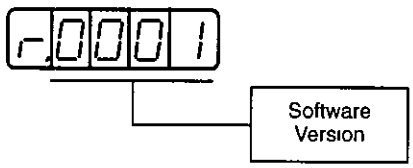

3. Press the DSPL/SET Key, and the software version of the encoder mounted on the motor will be displayed

Software Version Display



4. Press the DATA/ENTER Key to return to the user constant code display



This completes the checking software version procedure



Using the Panel Operator

1. Select the user constant Fn012
2. Press the DATA/SHIFT Key for a minimum of one second to display the Servopack software version
3. Press the MODE/SET Key to display the encoder software version
4. Press the DATA/SHIFT Key for a minimum of one second to return to the user constant code display


7.2.8 Origin Search Mode

⚠ CAUTION

- Forward run prohibited (P-OT) and reverse run prohibited (N-OT) signals are not effective during origin search mode operations using user constant Fn003

The origin search mode is designed to position the origin pulse position of the encoder and to clamp at the position This mode is used when the motor shaft needs to be aligned to the machine Execute the origin search without connecting the couplings

The speed for executing the origin search is 60 r/min

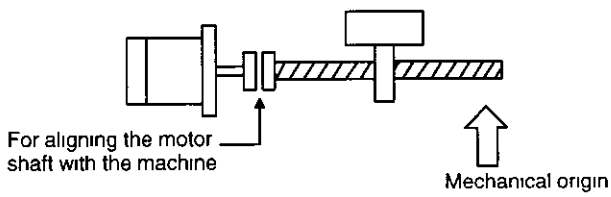

INFO

The following conditions must be met to perform the origin search operation

- If the Servo-ON input signal (/S-ON) is ON, turn it OFF
- Set user constant Pn50A 1 to 7 and release the Servo-ON signal mask if the Servo has been set to always be ON

Follow the procedure below to execute the origin search



Using the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the auxiliary function mode



2. Select the user constant Fn003
   Press the Left or Right Cursor Key to select the digit
   Press the Up or Down Cursor Key to change the value



3. Press the DATA/ENTER Key, and the display will be as shown below




4. Press the SVON Key, and the display will be as shown below Now it is ready for executing the origin search



5. Hold down the Up or Down Cursor Key to execute the origin search

   When the user constant is set to Pn000 0 = 0 (default), pressing the Up Cursor Key will rotate the motor in the forward direction Pressing the Down Cursor Key will rotate the motor in the reverse direction When the user constant is set to Pn000 0 = 1, the rotation of the motor is reversed



6. Press the DATA/ENTER Key to return to the auxiliary function mode display



This completes the origin search execution



Using the Panel Operator


1. Press the MODE/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn003



3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below




4. Press the MODE/SET Key, and the display will change as shown below Now it is ready for executing the origin search mode



5. Hold down the Up or Down Cursor Key to execute the origin search

   When the user constant is set to Pn000 0 = 0 (default), pressing the Up Cursor Key will rotate the motor in the forward direction Pressing the Down Cursor Key will rotate the motor in the reverse direction When the user constant is set to Pn000 0 = 1, the rotation of the motor is reversed



6. Press the DATA/SHIFT Key for a minimum of one second to return to the auxiliary function mode display



This completes the origin search execution

7.2.9 Initializing User Constant Settings

This function is used when returning to the standard settings (factory settings) after changing user constant settings

IMPORTANT Initialize the user constant settings with the servo OFF

Follow the procedure below to initialize user constant settings



Using the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the auxiliary function mode




2. Select the user constant Fn005
   Press the Left or Right Cursor Key to select the digit
   Press the Up or Down Cursor Key to change the value



3. Press the DATA/ENTER Key. and the display will be as shown below




4. Press the DSPL/SET Key. and the display will be as shown below The user constants will be initialized

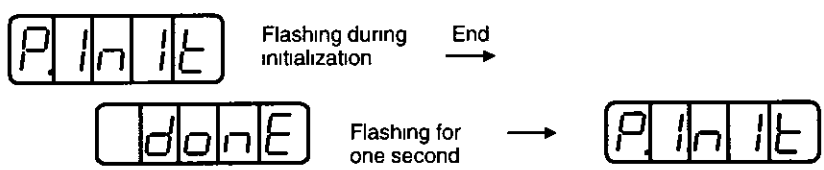

5. Press the DATA/ENTER Key to return to the auxiliary function mode display



This completes the initialization of user constant settings



Using the Panel Operator


1. Press the MODE/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn005




3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below




4. Press the MODE/SET Key, and the display will be as shown below The user constants will be initialized



Flashing during initialization → End



Flashing for one second →



5. Press the DATA/SHIFT Key for a minimum of one second to return to the auxiliary function mode display



This completes the initialization of user constant settings




User constants will not be initialized by pressing the DSPL/SET or MODE/SET Key with the servo ON Turn the power OFF and then back ON after initialization

7.2.10 Manual Zero Adjustment and Gain Adjustment of Analog Monitor Output

Motor speed, torque reference, and position error can be monitored through the analog monitor output Refer to *Section 6 5 Analog Monitor*

Use the manual zero adjustment function to compensate for the output voltage drift or the zero point drift caused by noise entering the monitor system The gain adjustment function can be changed to match the sensitivity of the measuring system

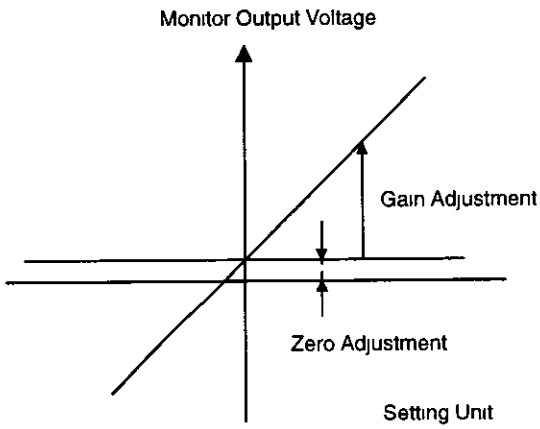

Setting Unit

Zero Setting Range ±2V → 17 mV/LSB

Gain Setting Range 50 to 150% → 0 4 %/LSB

INFO The output voltage of the analog monitor is ±8 V The output voltage will be reversed if ±8 V is exceeded

■ Manual Zero Adjustment of Analog Monitor Output

Follow the procedure below to execute the manual zero adjustment of analog monitor output



Using the Hand-held Digital Operator


1 Press the DSPL/SET Key to select the auxiliary function mode




2. Select the user constant Fn00C
   Press the Left or Right Cursor Key to select the digit
   Press the Up or Down Cursor Key to change the value




3. Press the DATA/ENTER Key, and the display will be as shown below




4. Press the DSPL/SET Key, and the monitor output for the two channels will be displayed alternately as shown below

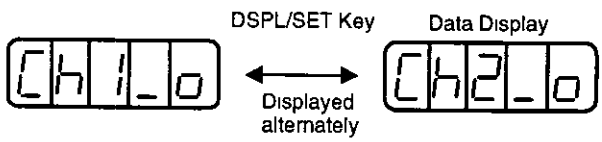

5 Press the Left or Right Cursor Key to display the analog monitor output data Pressing the Left or Right Cursor Key again will return to the display shown in the above step 3 or 4

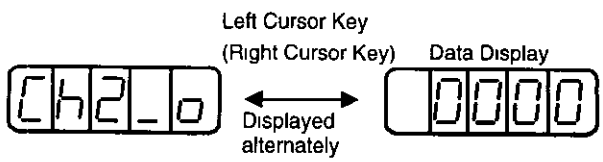


6. Press the Up or Down Cursor Key to perform zero adjustment of the analog monitor output



7. When zero adjustment has been completed for the two channels, press the DATA/ENTER Key to return to the auxiliary function mode display



This completes the manual zero adjustment of the analog monitor output



Using the Panel Operator

1. Press the MODE/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn00C



3. Press the DATA/SHIFT Key for a minimum of one second. and the display will be as shown below




4. Press the MODE/SET Key, and the monitor output for the two channels will be displayed alternately as shown below

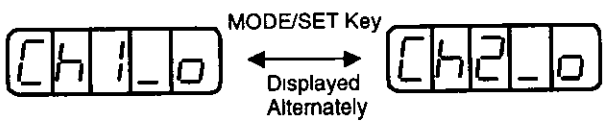

5. Press the DATA/SHIFT Key for less than one second, and the analog monitor gain constant will be displayed Pressing the DATA/SHIFT Key again for less than one second will return to the display shown in the above step 3 or 4



6. Press the Up or Down Cursor Key to perform zero adjustment of the analog monitor output



7. When zero adjustment has been completed for the two channels, press the DATA/SHIFT Key for a minimum of one second to return to the auxiliary function mode display



This completes the manual zero adjustment of the analog monitor output

■ Manual Gain Adjustment of Analog Monitor Output

Follow the procedure below to execute the manual gain adjustment of analog monitor output



Using the Hand-held Digital Operator


1. Press the DSPL/SET Key to select the auxiliary function mode




2. Select the user constant Fn00D
   Press the Left or Right Cursor Key to select the digit
   Press the Up or Down Cursor Key to change the value




3. Press the DATA/ENTER Key, and the display will be as shown below




4. Press the DSPL/SET Key, and the monitor output for the two channels will be displayed alternately as shown below

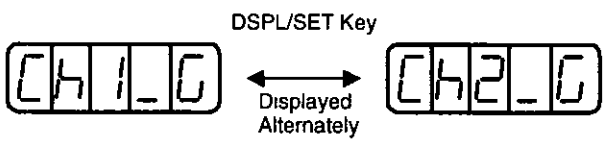

5. Press the Left or Right Cursor Key to display the analog monitor gain constant Pressing the Left or Right Cursor Key again will return to the display shown in the above step 3 or 4

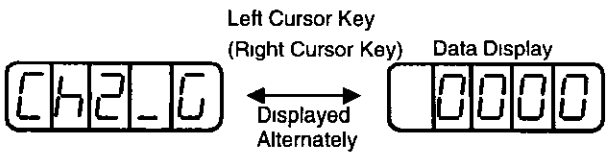

6. Press the Up or Down Cursor Key to adjust the gain for the analog monitor output



7. When the gain adjustment has been completed for the two channels, press the DATA/ENTER Key to return to the auxiliary function mode display



This completes the manual gain adjustment of the analog monitor output



Using the Panel Operator

1. Press the MODE/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn00D



3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below




4. Press the MODE/SET Key, and the monitor output for the two channels will be displayed alternately as shown below

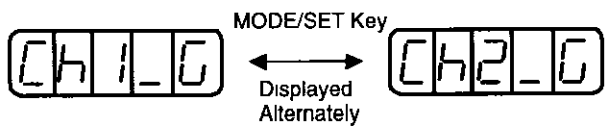

5. Press the DATA/SHIFT Key for less than one second The gain constant for the analog monitor will be displayed Pressing the DATA/SHIFT Key again for less than one second will return to the display shown in the above step 3 or 4



6. Press the Up or Down Cursor Key to adjust the gain for the analog monitor output



7. When the gain adjustment has been completed for the two channels, press the DATA/SHIFT Key for a minimum of one second to return to the auxiliary function mode display



This completes the manual gain adjustment of the analog monitor output

7.2.11 Adjusting the Motor Current Detection Offset

Motor current detection offset adjustment is performed at Yaskawa before shipping Basically, the user need not perform this adjustment Perform this adjustment only if highly accurate adjustment is required for reducing torque ripple caused by current offset

The following sections describe automatic and manual adjustment of the current detection offset

IMPORTANT If this function, particularly manual adjustment, is executed carelessly, it may worsen the characteristics

■ Automatic Adjustment of the Motor Current Detection Offset

Follow the procedure below to perform automatic adjustment of the current detection offset

INFO Automatic adjustment is possible only with power supplied to the main circuits and with the servo OFF



Using the Hand-held Digital Operator


1. Press the DSPL/SET Key to select the auxiliary function mode




2. Select the user constant Fn00E
   Press the Left or Right Cursor Key to select the digit
   Press the Left or Right Cursor Key to change the value



3. Press the DATA/ENTER Key, and the display will be as shown below



4. Press the DSPL/SET Key The display will change as shown below and offset will be automatically adjusted



5. Press the DATA/ENTER Key to return to the auxiliary function mode display



This completes the automatic adjustment of the motor current detection offset



Using the Panel Operator


1. Press the MODE/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn00E



3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below



4. Press the MODE/SET Key The display will change as shown below and the offset will be automatically adjusted



5 Press the DATA/SHIFT Key for a minimum of one second to return to the auxiliary function mode display




This completes the automatic adjustment of the motor current detection offset

■ Manually Adjusting the Motor Current Detection Offset

Follow the procedure below to manually adjust the current detection offset

IMPORTANT

When making manual adjustments, run the motor at a speed of approximately 100 r/min, and adjust the Operator until the torque monitor ripple is minimized (Refer to *Section 6 5 Analog Monitor*) Adjust the U-phase and V-phase offsets alternately several times until these offsets are well balanced



Hand-held Digital Operator

1. Press the DSPL/SET Key to select the auxiliary function mode




2. Select the user constant Fn00F
   Press the Left or Right Cursor Key to select the digit
   Press the Up or Down Cursor Key to change the value




3. Press the DATA/ENTER Key, and the display will be as shown below




4. Press the DSPL/SET Key to switch between the U-phase (Cu1_0) and V-phase (Cu2_0) current detection offset adjustment mode

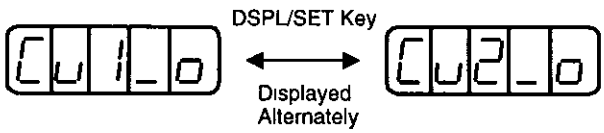

5. Press the Left or Right Cursor Key to display the current detection data Pressing the Left or Right Cursor Key again will return to the display shown in the above step 3 or 4

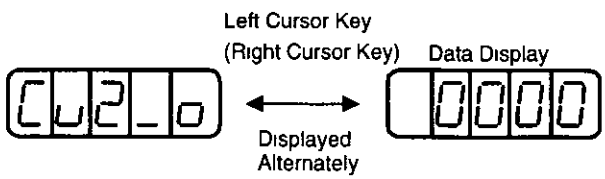


6. Press the Up or Down Cursor Key to adjust the offset Carefully adjust the offset while monitoring the torque reference monitor signal



7. When the current offset adjustment has been completed for the U-phase (Cu1_0) and V-phase (Cu2_0), press the DATA/ENTER Key to return to the auxiliary function mode display




This completes the manual adjustment of the motor current detection offset



Using the Panel Operator


1. Press the MODE/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn00F



3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below




4. Press the MODE/SET Key to switch between U-phase (Cu1_0) and V-phase (Cu2_0) current detection offset adjustment mode



5. Press the DATA/SHIFT Key for less than one second to display the current detection data Press the DATA/SHIFT Key again for less than one second, and the display will return to one shown in the above step 3 or 4



6. Press the Up or Down Cursor Key to adjust the offset Carefully adjust the offset while monitoring the torque reference monitor signal



7. When the current offset adjustment has been completed for the U-phase (Cu1_0) and V-phase (Cu2_0), press the DATA/SHIFT Key to return to the auxiliary function mode display



This completes the manual adjustment of the motor current detection offset


7.2.12 Password Setting (Write Prohibited Setting)

The password setting is used for preventing careless changes of the user constant User constants Pn□□□ and some of Fn□□□ become write prohibited by setting the password

Password setting values are as follows

- "0000" Write enabled (Releases write prohibited mode)
- "0001" Write prohibited (User constants become write enabled from the next power ON)

Follow the procedure below to set the password



Using the Hand-held Digital Operator

1. Press the DSPL/SET Key to select the auxiliary function mode




2. Select the user constant Fn010
   Press the Left or Right Cursor Key to select the digit
   Press the Up or Down Cursor Key to change the value




3. Press the DATA/ENTER Key, and the display will be as shown below




4. Input the password (0001) and press the DSPL/SET Key The display will change as shown below and the password will be registered



5. Press the DATA/ENTER Key to return to the auxiliary function mode display



This completes the password setting The newly set password will become valid from the next time the power is turned ON



Using the Panel Operator

1. Press the MODE/SET Key to select the auxiliary function mode




2. Press the Up or Down Cursor Key to select the user constant Fn010




3. Press the DATA/SHIFT Key for a minimum of one second, and the display will be as shown below



4. Input the password (0001) and press the MODE/SET Key The display will change to one shown below and the password will be registered



5 Press the DATA/SHIFT Key for a minimum of one second to return to the auxiliary function mode display



This completes the procedure for setting the password The newly set password will become valid from the next power ON

8

Ratings and Characteristics

This chapter provides the ratings, torque-speed characteristics diagrams, and dimensional drawings of the Σ-II Series Servo Drives

8 1 Servomotors . . . 8 - 2

8 1 1 Ratings, Specifications, and Dimensional Drawings 8 - 2

8 2 Servopacks . . 8 - 24

8 2 1 Combined Specifications 8 - 24

8 2 2 Ratings and Specifications 8 - 29

8 2 3 Dimensional Drawings 8 - 36

8.1 Servomotors

This section describes ratings, specifications, and dimensional drawings of the Servomotors. Refer to this section for selecting an appropriate Servo Drivers.

8.1.1 Ratings, Specifications, and Dimensional Drawings

The following sections provide the ratings specifications, and dimensional drawings of the Servomotors by model.

■ SGMAH Servomotors

Ratings and Specifications for Standard Servomotors

- Time Rating: Continuous
- Vibration Class: 15 μm or below
- Insulation Resistance: 500 VDC, 10 MΩ min
- Ambient Temperature: 0 to 40°C
- Excitation: Permanent magnet
- Mounting: Flange method
- Insulation Class: Class B
- Withstand Voltage: 1500 VAC for one minute
- Enclosure: Totally enclosed, self-cooled, IP55 (except for through sections of the shaft)
- Ambient Humidity: 20% to 80% (with no condensation)
- Drive Method: Direct drive

Table 8.1 SGMAH Standard Servomotor Ratings and Specifications

Voltage		200 V						100 V			
Servomotor Model SGMAH-		A3A	A5A	01A	02A	04A	08A	A3B	A5B	01B	02B
Rated Output *1	kW	0.03	0.05	0.1	0.2	0.4	0.75	0.03	0.05	0.1	0.2
Rated Torque *1,*2	N·m	0.0955	0.159	0.318	0.637	1.27	2.39	0.0955	0.159	0.318	0.637
	oz·in	13.52	22.5	45.1	90.2	180	338	13.52	22.5	45.1	90.2
Instantaneous Peak Torque *1	N·m	0.286	0.477	0.955	1.91	3.82	7.16	0.286	0.477	0.955	1.91
	oz·in	40.6	67.6	135.2	270	541	1010	40.6	67.6	135.2	270
Rated Current *1	A (rms)	0.44	0.64	0.91	2.1	2.8	4.4	0.66	0.95	2.4	3.0
Instantaneous Max. Current *1	A (rms)	1.3	2.0	2.8	6.5	8.5	13.4	2.0	2.9	7.2	9.0
Rated Speed *1	r/min	3000									
Max. Speed *1	r/min	5000									
Torque Constant	N·m/A (rms)	0.238	0.268	0.378	0.327	0.498	0.590	0.157	0.182	0.146	0.234
	oz·in/A (rms)	33.7	38.0	53.6	46.2	70.6	83.6	22.2	25.8	20.7	33.2
Moment of Inertia	kg·m²x10⁻⁴	0.0166	0.0220	0.0364	0.106	0.173	0.672	0.0166	0.0220	0.0364	0.106
	oz·in·s²x10⁻³	0.235	0.312	0.515	1.501	2.45	9.52	0.235	0.312	0.515	1.501
Rated Power Rate *1	kW/s	5.49	11.5	27.8	38.2	93.7	84.8	5.49	11.5	27.8	38.2

Voltage		200 V						100 V			
Servomotor Model SGMAH-		A3A	A5A	01A	02A	04A	08A	A3B	A5B	01B	02B
Rated Angular Acceleration *1	rad/s^2	57500	72300	87400	60100	73600	35500	57500	72300	87400	60100
Inertia Time Constant	ms	1 4	0 88	0 53	0 39	0 25	0 26	1 4	0 85	0 61	0 41
Inductive Time Constant	ms	1 0	1 1	1 2	4 6	5 4	8 7	1 0	1 1	1 1	4 4

* 1 These items and torque-motor speed characteristics quoted in combination with an SGDM Servopack are at an armature winding temperature of 100°C Other values quoted at 20°C All values are typical


* 2 Rated torques are continuous allowable torque values at 40°C with a 250 × 250 × 6 (mm) (10 × 10 × 0 25 (in)) heat sink attached

SGMAH Servomotor Torque–Motor Speed Characteristics


The torque–motor speed characteristics are shown below for the SGMAH Servomotors

- **200-V Servomotors**


SGMAH-A3A

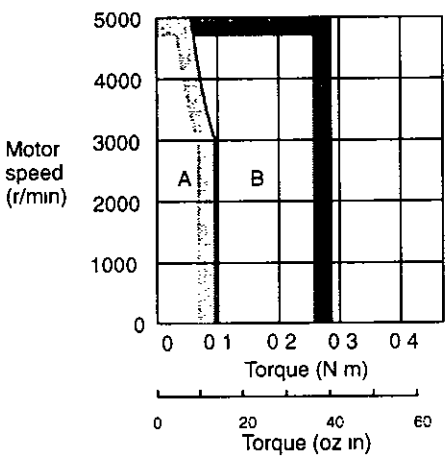


SGMAH-A5A

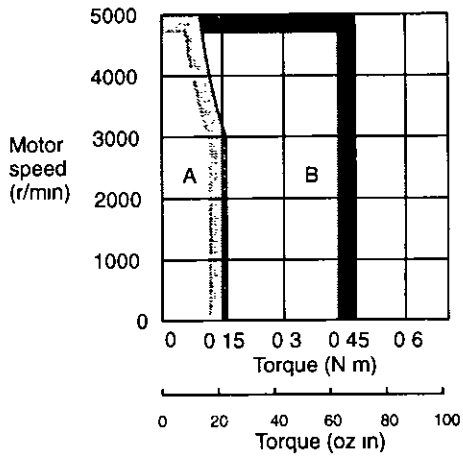


SGMAH-01A

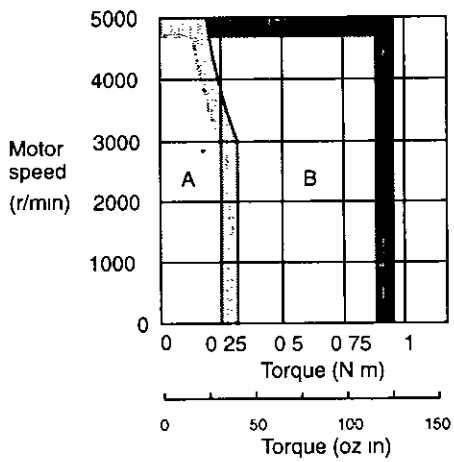


SGMAH-02A

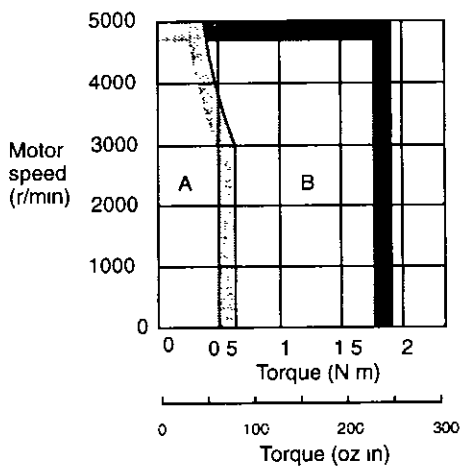

SGMAH-04A

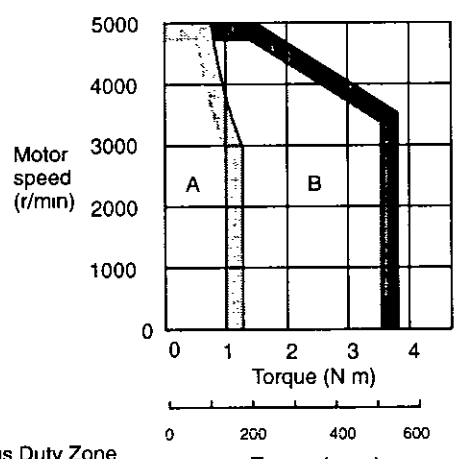


SGMAH-08A

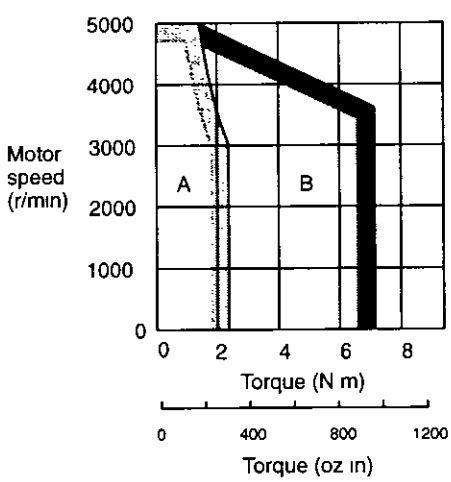


A Continuous Duty Zone
B Intermittent Duty Zone

• 100-V Servomotors


SGMAH-A3B

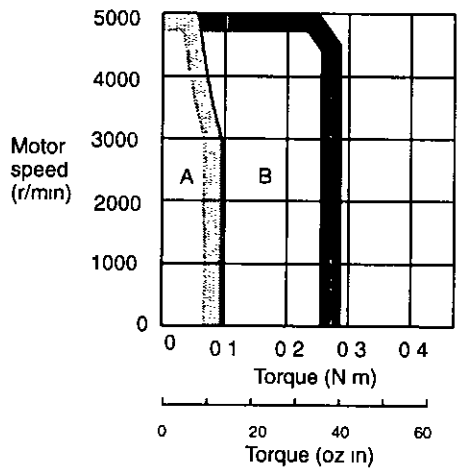


SGMAH-A5B

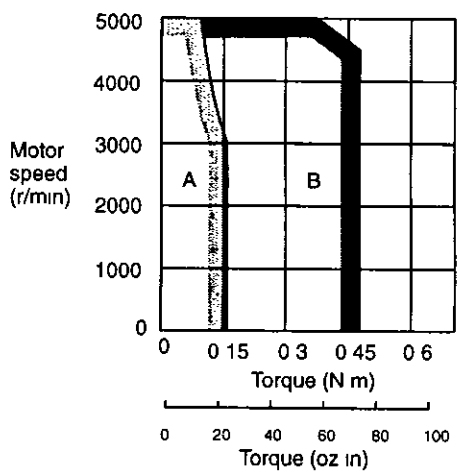

SGMAH-01B

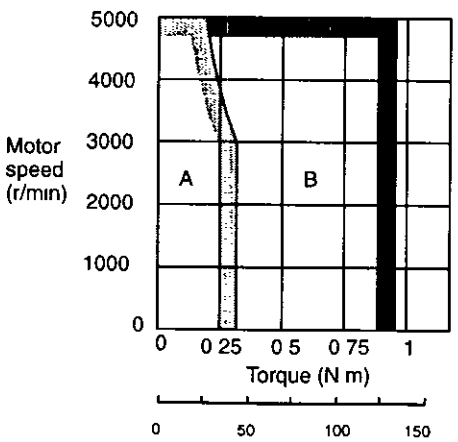


SGMAH-02B

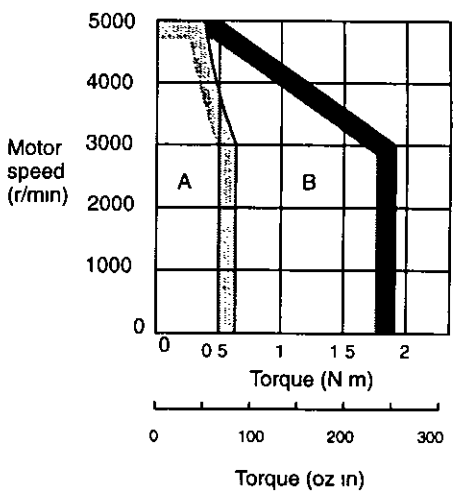

A *Continuous* Duty Zone
B Intermittent Duty Zone

Dimensional Drawings

Dimensional drawings of the SGMAH Servomotors are shown below

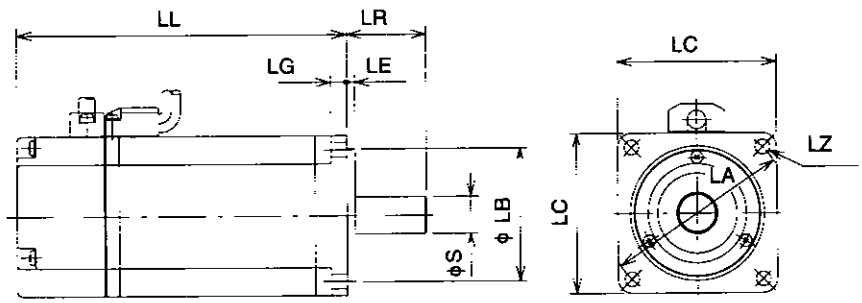

Unit mm (in)

Model	LL	LC	LA	LZ	LG	LB	LE	S	LR	Mass kg (lb)
SGMAH-A3A (B)	69 5 (2 74)	40 (1 57)	46 (1 81)	4 3 (0 17)	5 (0 20)	$30^{0}_{-0.021}$ $\left(1.19^{0}_{-0.0008}\right)$	2 5 (0 098)	$6^{0}_{-0.008}$ $\left(0.24^{0}_{-0.0003}\right)$	25 (0 98)	0 3 (0 661)
SGMAH-A5A (B)	77 0 (3 03)									0 4 (0 882)
SGMAH-01A (B)	94 5 (3 72)							$8^{0}_{-0.009}$ $\left(0.32^{0}_{-0.0004}\right)$		0 5 (1 10)
SGMAH-02A (B)	96 5 (3 80)	60 (2 36)	70 (2 76)	5 5 (0 22)	6 (0 24)	$50^{0}_{-0.025}$ $\left(1.98^{0}_{-0.0010}\right)$	3 (0 12)	$14^{0}_{-0.011}$ $\left(0.56^{0}_{-0.0004}\right)$	30 (1 18)	1 1 (2 43)
SGMAH-04A	124 5 (4 90)									1 7 (3 75)
SGMAH-08A	145 (5 71)	80 (3 15)	90 (3 54)	7 (0 28)	8 (0 31)	$70^{0}_{-0.030}$ $\left(2.78^{0}_{-0.0012}\right)$		$16^{0}_{-0.011}$ $\left(0.64^{0}_{-0.0004}\right)$	40 (1 57)	3 4 (7 50)

■ SGMPH Servomotors

Ratings and Specifications for Standard Servomotors

- Time Rating Continuous
- Vibration Class 15 μm or below
- Insulation Resistance 500 VDC, 10 MΩ min
- Ambient Temperature 0 to 40°C
- Excitation Permanent magnet
- Mounting Flange method
- Insulation Class Class B
- Withstand Voltage 1500 VAC for one minute
- Enclosure Totally enclosed, self-cooled, IP55 (except for through sections of the shaft)
- Ambient Humidity 20% to 80% (with no condensation)
- Drive Method Direct drive

Table 8.2 SGMPH Standard Servomotor Ratings and Specifications

Voltage		200 V					100 V	
Servomotor Model SGMPH-		01A	02A	04A	08A	15A	01B	02B
Rated Output *1	kW	0 1	0 2	0 4	0 75	1 5	0 1	0 2
Rated Torque *1,*2	N m	0 318	0 637	1 27	2 39	4 77	0 318	0 637
	oz-in	45 1	90 2	180	338	676	45 1	90 2
Instantaneous Peak Torque *1	N m	0 955	1 91	3 82	7 16	14 3	0 955	1 91
	oz in	135	270	541	1010	2030	135 2	270
Rated Current *1	A (rms)	0 89	2 0	2 6	4 1	7 5	2 2	2 7
Instantaneous Max. Current *1	A (rms)	2 8	6 0	8 0	13 9	23 0	7 1	8 4
Rated Speed *1	r/min	3000						
Max. Speed *1	r/min	5000						
Torque Constant	N m/A (rms)	0 392	0 349	0 535	0 641	0 687	0 160	0 258
	oz-in /A (rms)	55 6	49 4	75 8	91 0	97 4	22 8	36 5
Moment of Inertia	kg·m^{2}x10^{-4}	0 0491	0 193	0 331	2 10	4 02	0 0491	0 193
	oz in s^{2}x10^{-3}	0 695	2 73	4 69	29 7	56 9	0 695	2 73
Rated Power Rate *1	kW/s	20 6	21 0	49 0	27 1	56 7	20 6	21 0
Rated Angular Acceleration *1	rad/s^2	64800	33000	38500	11400	11900	64800	33000
Inertia Time Constant	ms	0 53	0 54	0 36	0 66	0 46	0 56	0 64
Inductive Time Constant	ms	3 7	7 4	8 6	18	22	3 6	6 3

* 1 These items and torque-motor speed characteristics quoted in combination with an SGDM Servopack are at an armature winding temperature of 100°C Other values quoted at 20°C All values typical


* 2 Rated torques are continuous allowable torque values at 40°C with a heat sink attached
Heat sink dimensions
250 × 250 × 6 (mm) (10 × 10 × 0 25 (in)) 0 1 kW to 0 4 kW
300 × 300 × 12 (mm) (12 × 12 × 0 5 (in)) 0 75 kW to 1 5 kW

SGMPH Servomotor Torque–Motor Speed Characteristics


The torque–motor speed characteristics are shown below for the SGMPH Servomotors

- **200-V Servomotors**


SGMPH-01A

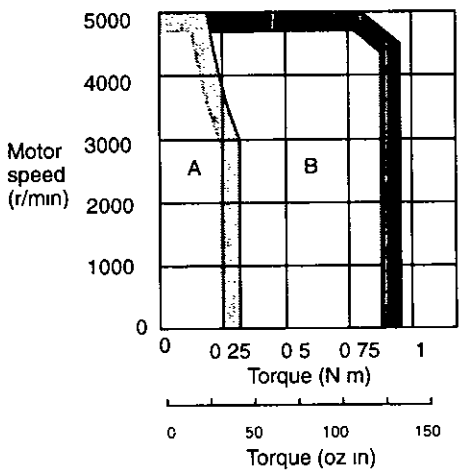


SGMPH-02A

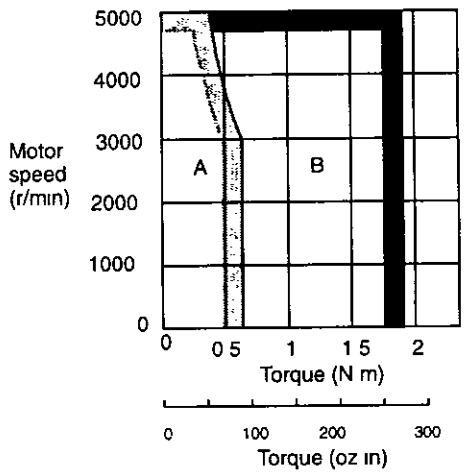


SGMPH-04A

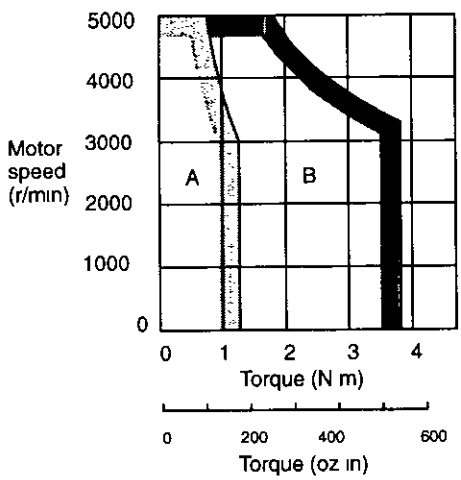

SGMPH-08A

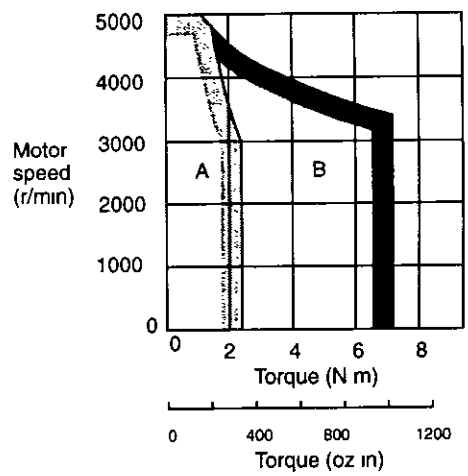


SGMPH-15A

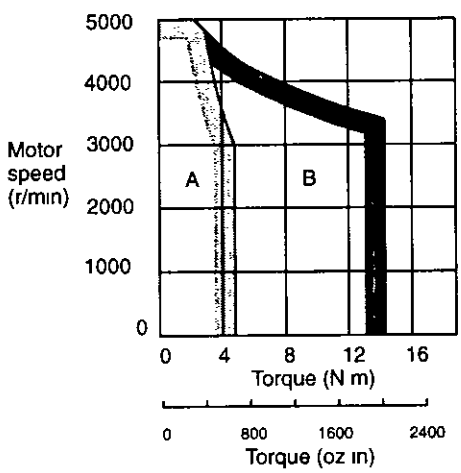


A Continuous Duty Zone
B Intermittent Duty Zone

- **100-V Servomotors**

SGMPH-01B

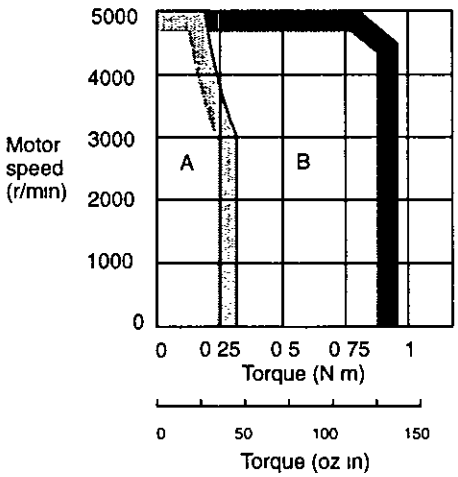


SGMPH-02B

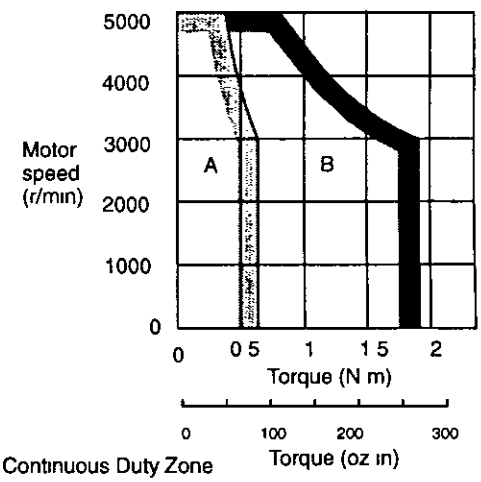


A Continuous Duty Zone
B Intermittent Duty Zone

Dimensional Drawings

Dimensional drawings of the SGMPH Servomotors are shown below

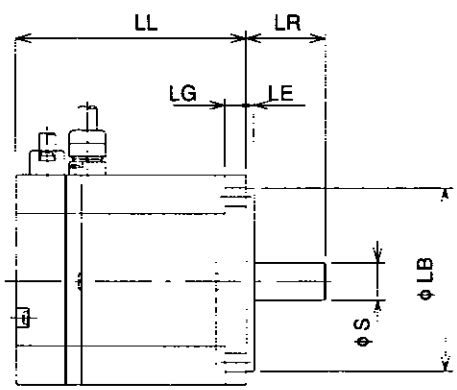

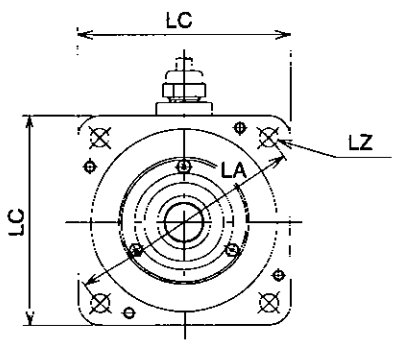

Unit mm (in)

Model	LL	LC	LA	LZ	LG	LB	LE	S	LR	Mass kg (lb)
SGMPH-01A (B)	62 (2 44)	60 (2 36)	70 (2 76)	5 5 (0 22)	6 (0 24)	$50^{\ 0}_{-0.025}$ $\left(1.98^{\ 0}_{-0.0010}\right)$	3 (0 12)	$8^{\ 0}_{-0.009}$ $\left(0.32^{\ 0}_{-0.0004}\right)$	25 (0 98)	0 7 (1 54)
SGMPH-02A (B)	67 (2 64)	80 (3 15)	90 (3 54)	7 (0 28)	8 (0 31)	$70^{\ 0}_{-0.030}$ $\left(2.78^{\ 0}_{-0.0012}\right)$		$14^{\ 0}_{-0.011}$ $\left(0.56^{\ 0}_{-0.0004}\right)$	30 (1 18)	1 4 (3 09)
SGMPH-04A	87 (3 43)									2 1 (4 63)
SGMPH-08A	86 5 (3 41)	120 (4 72)	145 (5 71)	10 (0 39)	10 (0 39)	$110^{\ 0}_{-0.035}$ $\left(4.37^{\ 0}_{-0.0014}\right)$	3 5 (0 14)	$16^{\ 0}_{-0.011}$ $\left(0.64^{\ 0}_{-0.0004}\right)$	40 (1 57)	4 2 (9 26)
SGMPH-15A	114 5 (4 51)							$19^{\ 0}_{-0.013}$ $\left(0.75^{\ 0}_{-0.0005}\right)$		6 6 (14 6)

■ SGMGH Servomotors for 1500 r/min

Rating and Specifications for Standard Servomotors

- Time Rating Continuous
- Vibration Class 15 μm or below
- Insulation Resistance 500 VDC, 10 MΩ min
- Ambient Temperature 0 to 40°C
- Excitation Permanent magnet
- Mounting Flange method
- Insulation Class Class F
- Withstand Voltage 1500 VAC for one minute
- Enclosure Totally enclosed, IP67 self cooled (except for through sections of the shaft)
- Ambient Humidity 20% to 80% (with no condensation)
- Drive Method Direct drive

Table 8 3 SGMGH Standard Servomotor Ratings and Specifications

Servomotor Model SGMGH-		05A□A	09A□A	13A□A	20A□A	30A□A	44A□A	55A□A	75A□A
Rated Output *	kW	0 45	0 85	1 3	1 8	2 9	4 4	5 5	7 5
Rated Torque *	N·m	2 84	5 39	8 34	11 5	18 6	28 4	35 0	48 0
	lb in	25	48	74	102	165	252	310	425
Instantaneous Peak Torque *	N m	8 92	13 8	23 3	28 7	45 1	71 1	87 6	119
	lb in	79	122	207	254	400	629	775	1053
Rated Current *	A (rms)	3 8	7 1	10 7	16 7	23 8	32 8	42 1	54 7
Instantaneous Max Current *	A (rms)	11	17	28	42	56	84	110	130
Rated Speed *	r/min	1500							
Max Speed *	r/min	3000							
Torque Constant	N m/A (rms)	0 82	0 83	0 84	0 73	0 83	0 91	0 88	0 93
	lb in/A (rms)	7 26	7 35	7 43	6 46	7 35	8 05	7 79	8 23
Moment of Inertia	kg $m^2 \times 10^{-4}$	7 24	13 9	20 5	31 7	46 0	67 5	89 0	125
	lb in $s^2 \times 10^{-3}$	6 42	12 3	18 2	28 0	40 7	59 8	78 8	111
Rated Power Rate *	kW/s	11 2	20 9	33 8	41 5	75 3	120	137	184
Rated Angular Acceleration *	rad/s^2	3930	3880	4060	3620	4050	4210	3930	3850
Inertia Time Constant	ms	5 0	3 1	2 8	2 2	1 9	1 3	1 3	1 1
Inductive Time Constant	ms	5 1	5 3	6 3	12 8	12 5	15 7	16 4	18 4


* These items and torque-motor speed characteristics quoted in combination with an SGDM Servopack are at an armature winding temperature of 20°C

Note These characteristics are values with the following heat sinks attached for cooling
400 × 400 × 20 (mm) (15 75 × 15 75 × 0 79 (in)) 05A□A to 13A□A Servomotors
550 × 550 × 30 (mm) (21 65 × 21 65 × 1 18 (in)) 20A□A to 75A□A Servomotors


SGMGH Servomotor Torque–Motor Speed Characteristics

The following sections provide the torque–motor speed characteristics of the SGMGH Servomotors at 1500 r/min


SGMGH-05A□A

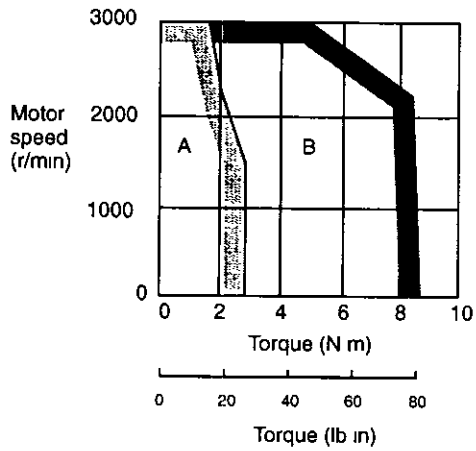


SGMGH-09A□A

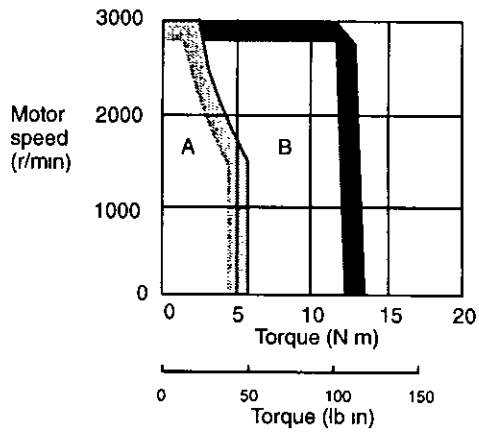


SGMGH-13A□A

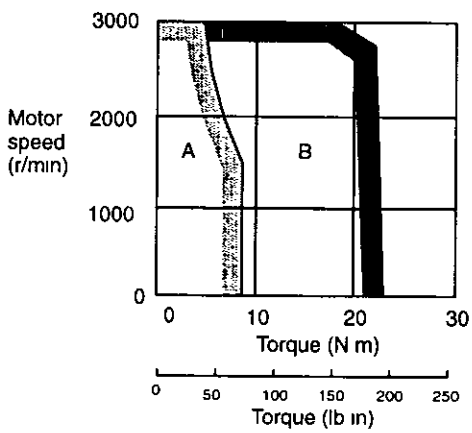


SGMGH-20A□A

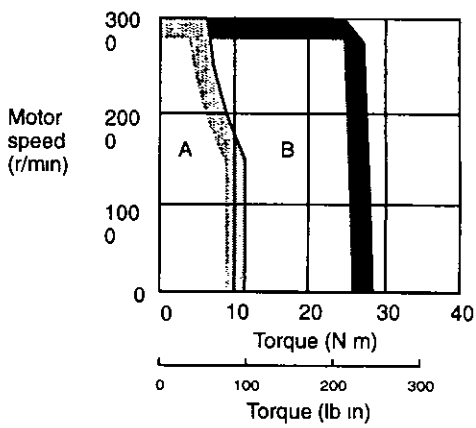

SGMGH-30A□A

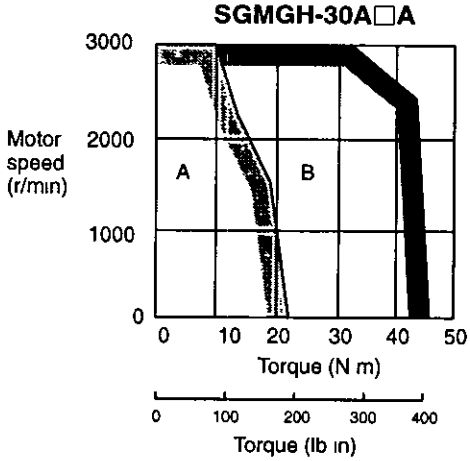


SGMGH-44A□A

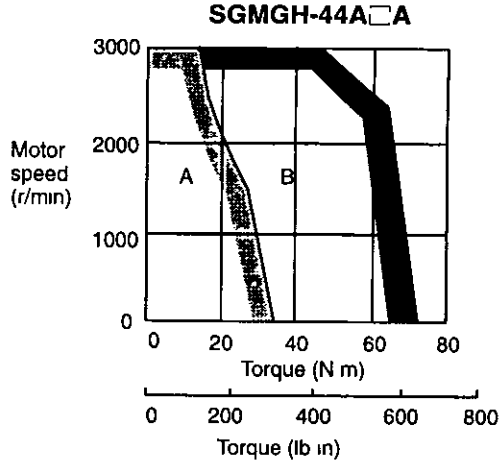


A Continuous Duty Zone
B Intermittent Duty Zone

SGMGH-55A□A

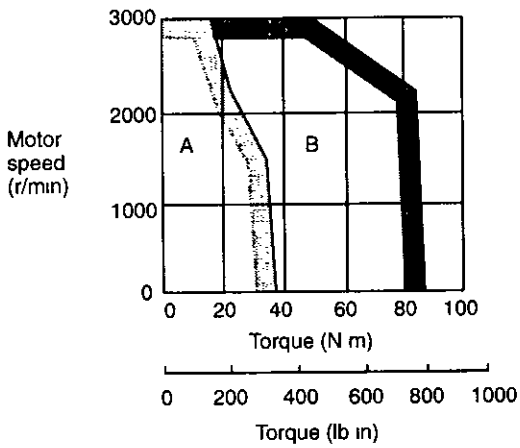


SGMGH-75A□A

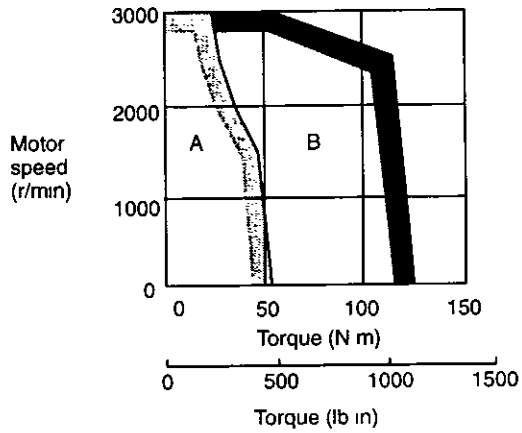


A Continuous Duty Zone
B Intermittent Duty Zone

Dimensional Drawings

Dimensional drawings of the SGMGH Servomotors (1500 r/min) are shown below

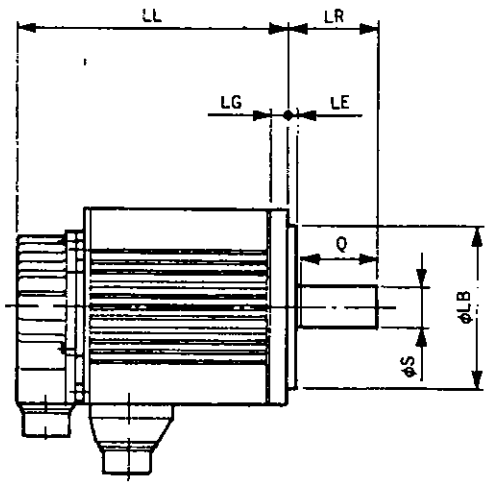

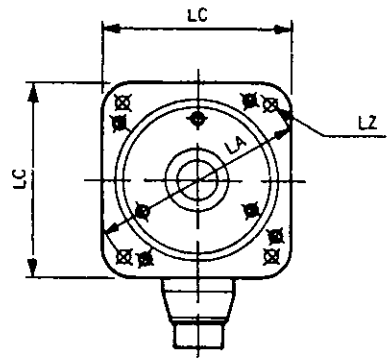

Unit mm (in)

Model	LL	LC	LA	LZ	LG	LB	LE	Q	S	LR	Mass kg (lb)
SGMGH-05A□A	138 (5 43)	130 (5 12)	145 (5 71)	9 (0 35)	12 (0 47)	$^{0}_{110\ -0.035}$ ($^{0}_{4.33\ -0.0014}$)	6 (0 24)	40 (1 57)	$^{0}_{19\ -0.013}$ ($^{0}_{0.75\ -0.0005}$)	58 (2 28)	5 5 (12 1)
SGMGH-09A□A	161 (6 34)										7 6 (16 8)
SGMGH-13A□A	185 (7 28)								$^{0}_{22\ -0.013}$ ($^{0}_{0.87\ -0.0005}$)		9 6 (21 2)
SGMGH-20A□A	166 (6 54)	180 (7 09)	200 (7 87)	13 5 (0 53)	18 (0 71)	$^{0}_{114.3\ -0.025}$ ($^{0}_{4.50\ -0.0010}$)	3 2 (0 13)	76 (2 99)	$^{+0.01}_{35\ \ 0}$ ($^{-0.0004}_{1.38\ \ 0}$)	79 (3 11)	14 (30 9)
SGMGH-30A□A	192 (7 56)										18 (39 7)
SGMGH-44A□A	226 (8 9)										23 (50 7)
SGMGH-55A□A	260 (10 2)							110 (4 33)	$^{0}_{42\ -0.016}$ ($^{0}_{1.65\ -0.001}$)	113 (4 45)	30 (66 1)
SGMGH-75A□A	334 (13 1)										40 (88 2)

■ SGMGH Servomotors for 1000 r/min

Rating and Specifications for Standard Servomotors

- Time Rating Continuous
- Vibration Class 15 μm or below
- Insulation Resistance 500 VDC, 10 MΩ min
- Ambient Temperature 0 to 40°C
- Excitation Permanent magnet
- Mounting Flange method
- Insulation Class Class F
- Withstand Voltage 1500 VAC for one minute
- Enclosure Totally enclosed, IP67 self cooled (except for through sections of the shaft)
- Ambient Humidity 20% to 80% (with no condensation)
- Drive Method Direct drive

Table 8 4 SGMGH Standard Servomotor Ratings and Specifications

Servomotor Model SGMGH-		03A□B	06A□B	09A□B	12A□B	20A□B	30A□B	44A□B	60A□B
Rated Output *	kW	0 3	0 6	0 9	1 2	2 0	3 0	4 4	6 0
Rated Torque *	N m	2 84	5 68	8 62	11 5	19 1	28 4	41 9	57 2
	lb in	25	50	76	102	169	251	371	506
Instantaneous Peak Torque *	N m	7 17	14 1	19 3	28 0	44 0	63 7	107	136 9
	lb in	63	125	171	248	389	564	947	1212
Rated Current *	A (rms)	3 0	5 7	7 6	11 6	18 5	24 8	32 9	46 9
Instantaneous Max Current *	A (rms)	7 3	13 9	16 6	28	42	56	84	110
Rated Speed *	r/min	1000							
Max Speed *	r/min	2000							
Torque Constant	N m/A (rms)	1 03	1 06	1 21	1 03	1 07	1 19	1 34	1 26
	lb in/A (rms)	9 12	9 38	10 7	9 12	9 47	10 5	11 9	11 2
Moment of Inertia	kg m^2x10^{-4}	7 24	13 9	20 5	31 7	46 0	67 5	89 0	125
	lb in s^2x10^{-3}	6 41	12 3	18 1	28 1	40 7	59 7	78 8	111
Rated Power Rate *	kW/s	11 2	23 2	36 3	41 5	79 4	120	198	262
Rated Angular Acceleration *	rad/s^2	3930	4080	4210	3620	4150	4210	4710	4590
Inertia Time Constant	ms	5 1	3 8	2 8	2 4	1 7	1 4	1 3	1 1
Inductive Time Constant	ms	5 1	4 7	5 7	12 5	13 9	15 5	14 6	16 5


* These items and torque-motor speed characteristics quoted in combination with an SGDM Servopack are at an armature winding temperature of 20°C

Note These characteristics are values with the following heat sinks attached for cooling
400 × 400 × 20 (mm) (15 75 × 15 75 × 0 79 (in)) 03A□B to 09A□B Servomotors
550 × 550 × 30 (mm) (21 65 × 21 65 × 1 18 (in)) 12A□B to 60A□B Servomotors


SGMGH Servomotor Torque–Motor Speed Characteristics

The following sections provide the torque–motor speed characteristics of the SGMGH Servomotors at 1000 r/min


SGMGH-03A□B

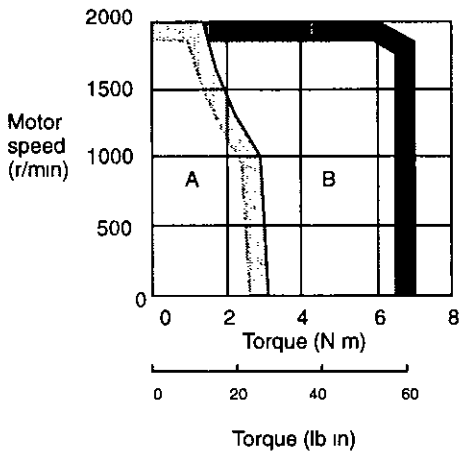


SGMGH-06A□B

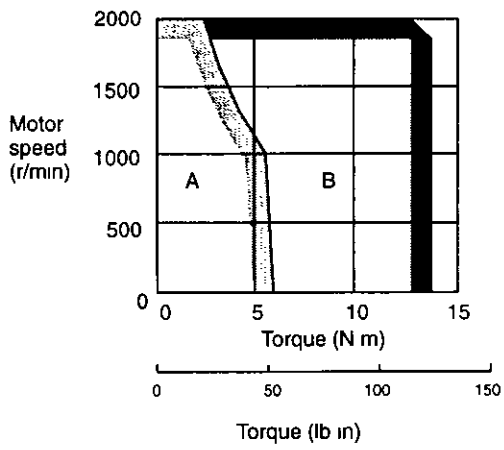


SGMGH-09A□B

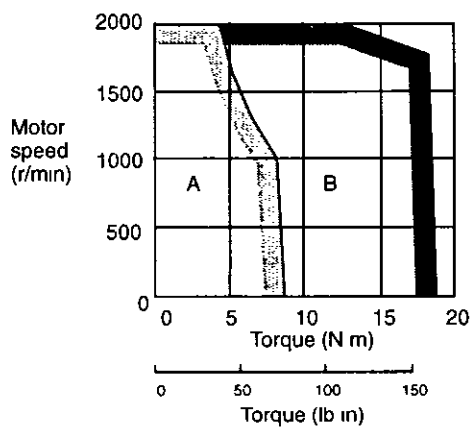


SGMGH-12A□B

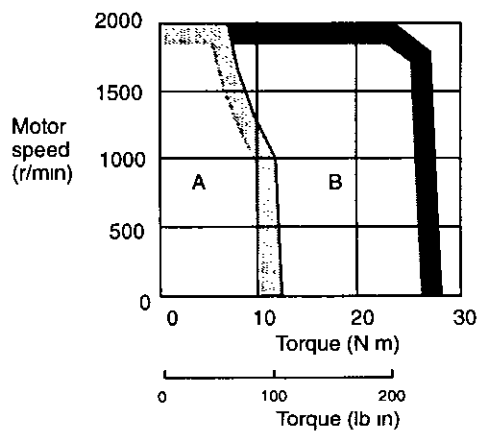

SGMGH-20A□B

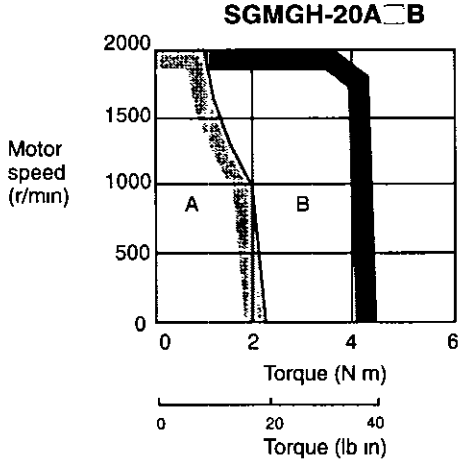


SGMGH-30A□B

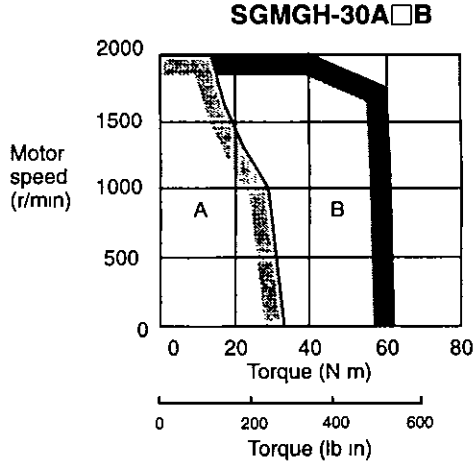


A Continuous Duty Zone
B Intermittent Duty Zone

SGMGH-44A□B

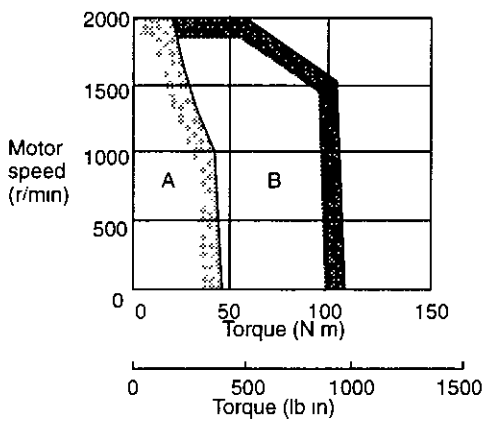

SGMGH-60A□B

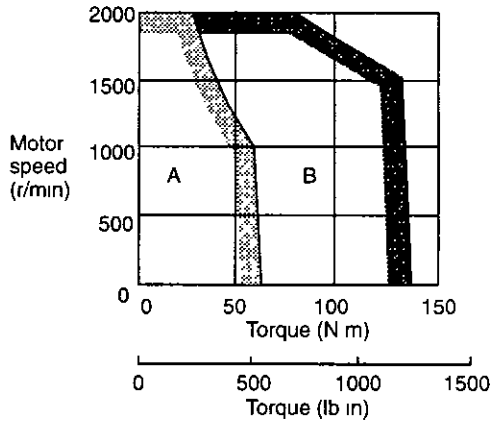


A Continuous Duty Zone

B Intermittent Duty Zone

Dimensional Drawings

Dimensional drawings of the SGMGH Servomotors (1000 r/min) are shown below

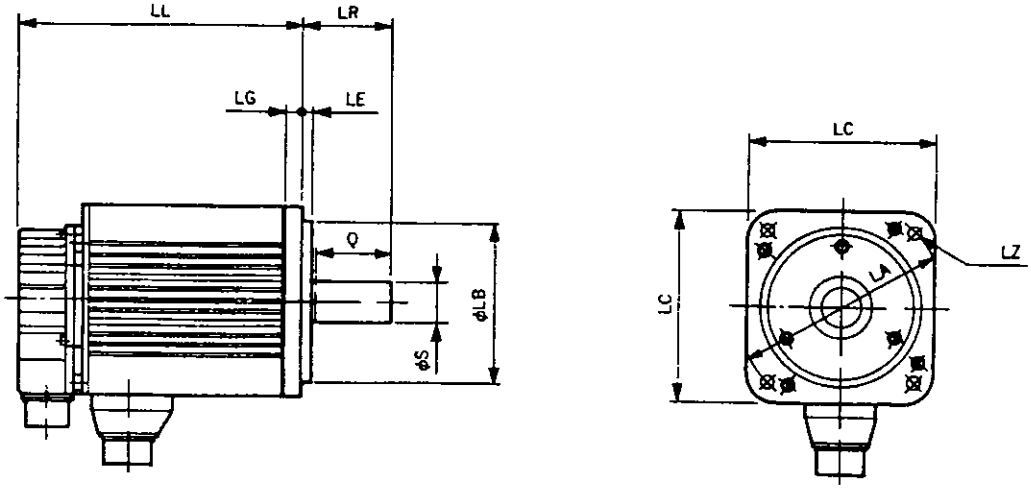

Unit mm (in)

Model	LL	LC	LA	LZ	LG	LB	LE	Q	S	LR	Mass kg (lb)
SGMGH-03A□B	138 (5 43)	130 (5 12)	145 (5 71)	9 (0 35)	12 (0 47)	$^{0}_{110\ -0.035}$ $\left(^{0}_{4.33\ -0.0014}\right)$	6 (0 24)	40 (1 57)	$^{0}_{19\ -0.013}$ $\left(^{0}_{0.75\ -0.0005}\right)$	58 (2 28)	5 5 (12 1)
SGMGH-06A□B	161 (6 34)										7 6 (16 8)
SGMGH-09A□B	185 (7 28)								$^{0}_{22\ -0.013}$ $\left(^{0}_{0.87\ -0.0005}\right)$		9 6 (21 2)
SGMGH-12A□B	166 (6 54)	180 (7 09)	200 (7 87)	13 5 (0 53)	18 (0 71)	$^{0}_{114.3\ -0.025}$ $\left(^{0}_{4.50\ -0.0010}\right)$	3 2 (0 13)	76 (2 99)	$^{+0.01}_{35\ \ 0}$ $\left(^{-0.0004}_{1.38\ \ 0}\right)$	79 (3 11)	14 (30 9)
SGMGH-20A□B	192 (7 56)										18 (39 7)
SGMGH-30A□B	226 (8 90)										23 (50 7)
SGMGH-44A□B	260 (10 2)							110 (4 33)	$^{0}_{42\ -0.016}$ $\left(^{0}_{1.65\ -0.001}\right)$	113 (4 45)	30 (66 1)
SGMGH-60A□B	334 (13 1)										40 (88 2)

■ SGMSH Servomotors

Rating and Specifications for Standard Servomotors

- Time Rating Continuous
- Vibration Class 15 μm or below
- Insulation Resistance 500 VDC, 10 MΩ min
- Ambient Temperature 0 to 40°C
- Excitation Permanent magnet
- Mounting Flange method
- Insulation Class Class F
- Withstand Voltage 1500 VAC for one minute
- Enclosure Totally enclosed, IP67 self cooled (except for through sections of the shaft)
- Ambient Humidity 20% to 80% (with no condensation)
- Drive Method Direct drive

Table 8 5 SGMSH Standard Servomotor Ratings and Specifications

Servomotor Model SGMSH-		10A□A	15A□A	20A□A	30A□A	40A□A	50A□A
Rated Output *	kW	1 0	1 5	2 0	3 0	4 0	5 0
Rated Torque *	N m	3 18	4 9	6 36	9 8	12 6	15 8
	lb in	28 1	43 4	56 4	86 8	112	140
Instantaneous Peak Torque *	N m	9 54	14 7	19 1	29 4	37 8	47 6
	lb in	84 4	130	169	260	336	422
Rated Current *	A (rms)	5 7	9 7	12 7	18 8	25 4	28 6
Instantaneous Max Current *	A (rms)	17	28	42	56	77	84
Rated Speed *	r/min	3000					
Max Speed *	r/min	5000					
Torque Constant	N m/A (rms)	0 636	0 561	0 554	0 573	0 53	0 60
	lb in/A (rms)	5 63	4 97	4 81	5 07	4 69	5 31
Moment of Inertia	kg $m^2 x10^{-4}$	1 74	2 47	3 19	7 00	9 60	12 3
	lb in $s^2 x10^{-3}$	1 54	2 19	2 83	6 20	8 50	10 9
Rated Power Rate *	kW/s	57 9	97 2	127	137	166	202
Rated Angular Acceleration *	rad/s^2	18250	19840	19970	14000	13160	12780
Inertia Time Constant	ms	0 87	0 74	0 62	0 74	0 65	0 59
Inductive Time Constant	ms	7 1	7 7	8 3	13 0	14 1	14 7


* These items and torque-motor speed characteristics quoted in combination with an SGDM Servopack are at an armature winding temperature of 20°C

Note These characteristics are values with the following heat sinks attached for cooling
300 × 300 × 12 (mm) (12 × 12 × 0 5 (in)) 10A□A to 20A□A Servomotors
400 × 400 × 20 (mm) (18 × 18 × 0 8 (in)) 50A□A Servomotors


SGMSH Servomotor Torque–Motor Speed Characteristics

The following sections provide the torque–motor speed characteristics of the SGMSH Servomotors


SGMSH-10A□A

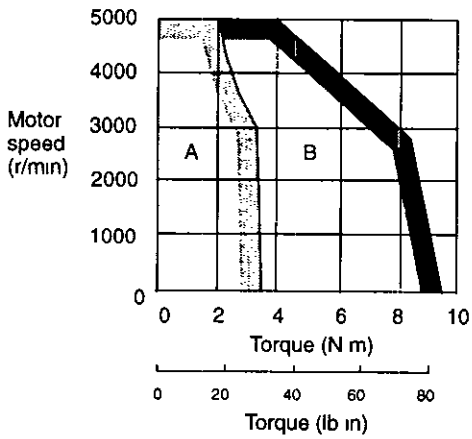


SGMSH-15A□A

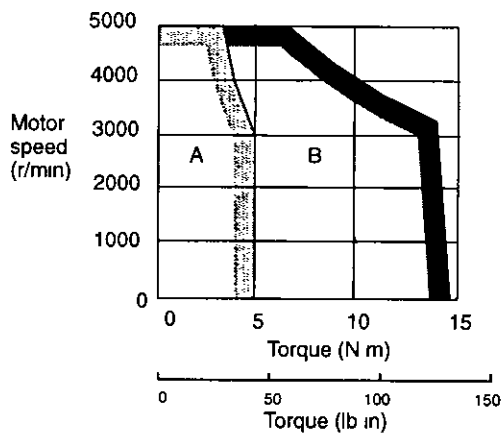


SGMSH-20A□A

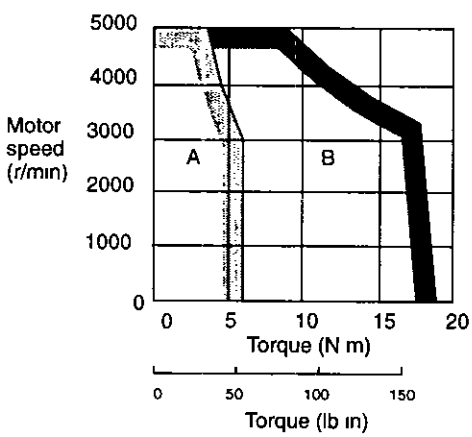


SGMSH-30A□A

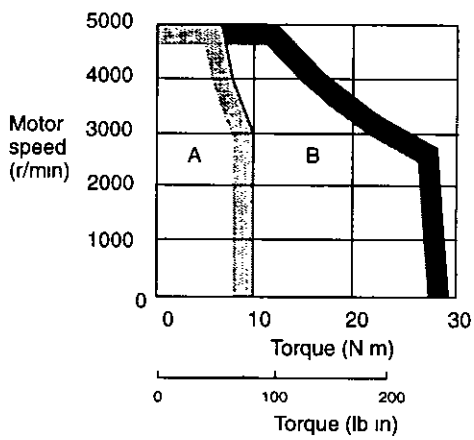

SGMSH-40A□A

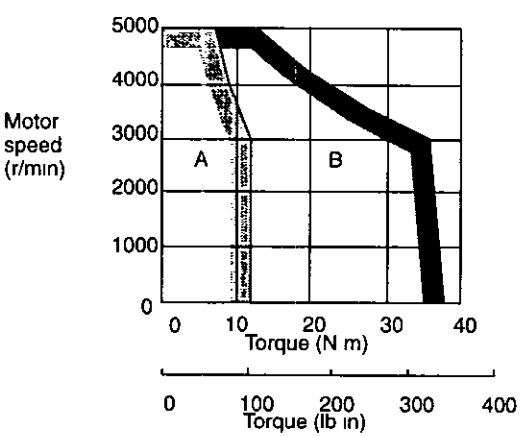


SGMSH-50A□A

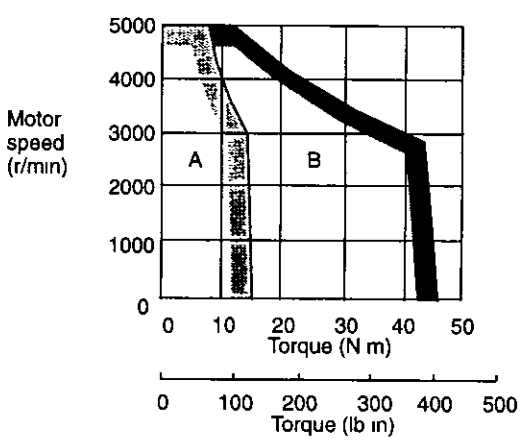

A Continuous Duty Zone
B Intermittent Duty Zone

Dimensional Drawings

Dimensional drawings of the SGMSH Servomotors are shown below

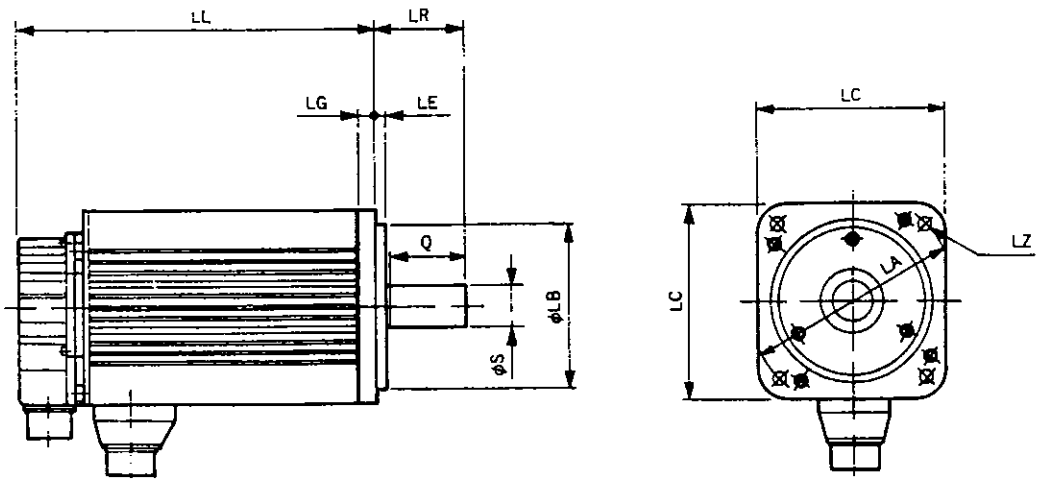

Unit mm (in)

Model	LL	LC	LA	LZ	LG	LB	LE	Q	S	LR	Mass kg (lb)
SGMSH-10A□A	149 (5 87)	100 (3 94)	115 (4 53)	7 (0 28)	10 (0 39)	$^{0}_{95\ -0.035}$ $\left(^{0}_{3.74\ -0.0014}\right)$	3 (0 12)	40 (1 57)	$^{0}_{24\ -0.013}$ $\left(^{0}_{0.94\ -0.0005}\right)$	45 (1 77)	4 6 (10 1)
SGMSH-15A□A	175 (6 89)										5 8 (12 8)
SGMSH-20A□A	198 (7 80)										7 0 (15 4)
SGMSH-30A□A	199 (7 83)	130 (5 12)	145 (5 71)	9 (0 35)	12 (0 47)	$^{0}_{110\ -0.035}$ $\left(^{0}_{4.33\ -0.0014}\right)$	6 (0 24)	55 (2 17)	$^{0}_{28\ -0.013}$ $\left(^{0}_{1.10\ -0.0005}\right)$	63 (2 48)	11 (24 3)
SGMSH-40A□A	236 (9 29)										14 (30 9)
SGMSH-50A□A	276 (10 9)										17 (37 5)

■ SGMDH Servomotors

Ratings and Specifications for Standard Motors (with Holding Brakes)

- Time Rating Continuous
- Vibration Class 15 μm or below
- Insulation Resistance 500 VDC, 10 MΩ min
- Ambient Temperature 0 to 40°C
- Excitation Permanent magnet
- Mounting Flange method
- Insulation Class Class F
- Withstand Voltage 1500 VAC for one minute
- Enclosure Totally enclosed, IP67 self cooled (except for through sections of the shaft)
- Ambient Humidity 20% to 80% (with no condensation)
- Drive Method Direct drive
- Holding Brake 90 VDC, static friction torque 29 4 N m

Table 8.6 Ratings and Specifications for Standard SGMDH Servomotors (with Holding Brakes)

Servomotor Model SGMSH-		22A□A□B	32A□A□B	40A□A□B
Rated Output *	kW	2 2	3 2	4 0
Rated Torque *	N·m	10 5	15 3	19 1
	lb in	92 9	135	169
Instantaneous Peak Torque *	N·m	36 7	53 5	66 9
	lb in	325	474	592
Rated Current *	A (rms)	15 7	20 9	23 2
Instantaneous Max. Current *	A (rms)	54	73	77
Rated Speed *	r/min	2000		
Max. Speed *	r/min	3000		
Torque Constant	N m/A (rms)	0 72	0 78	0 92
	lb in/A (rms)	6 4	6 9	8 1
Moment of Inertia	kg $m^2 \times 10^{-4}$	56 6	74 2	91 8
	lb in $s^2 \times 10^{-3}$	50 1	65 7	81 3
Rated Power Rate *	kW/s	19 5	31 5	39 7
Rated Angular Acceleration *	rad/s^2	1850	2060	2080
Inertia Time Constant	ms	3 7	2 4	2 2
Inductive Time Constant	ms	16 2	18 2	17 8


* These items and torque-motor speed characteristics quoted in combination with an SGDM Servopack are at an armature winding temperature of 20°C

Note These characteristics are values with the following heat sinks attached for cooling
650 × 650 × 35 (mm) (26 × 26 × 1 4 (in)) 22A□A□B to 40A□A□B Servomotors


SGMDH Servomotor Torque–Motor Speed Characteristics

The following sections provide the torque–motor speed characteristics of the SGMDH Servomotors


SGMDH-22A□A□B

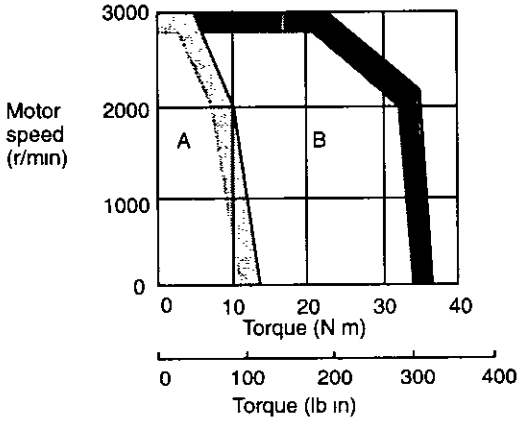

SGMDH-32A□A□B

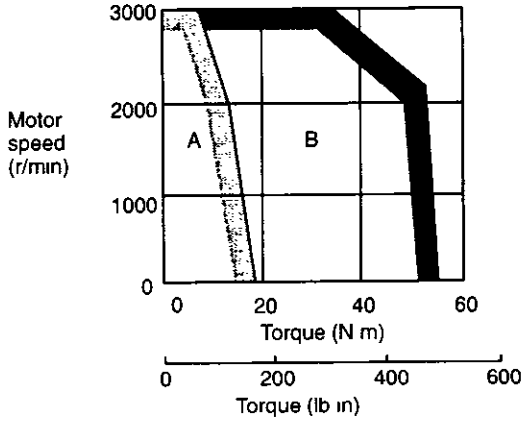


SGMDH-40A□A□B

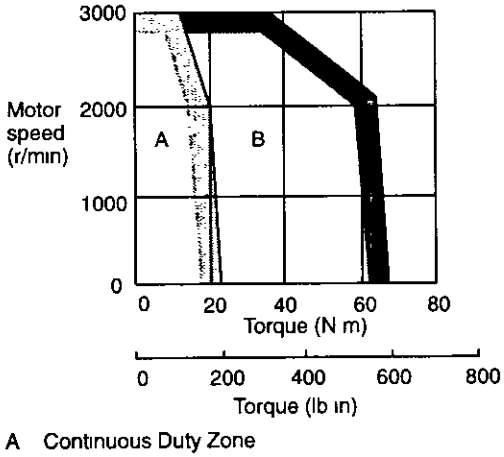


A Continuous Duty Zone
B Intermittent Duty Zone

Dimensional Drawings

Dimensional drawings of the SGMDH Servomotors are shown below

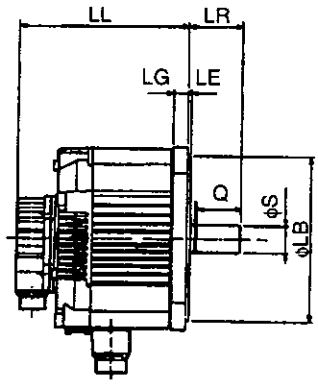

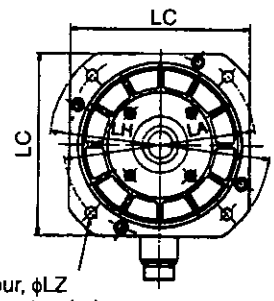

Unit mm (in)

Model	LL	LC	LA	LZ	LG	LB	LE	Q	S	LR	Mass kg (lb)	
											W/o Brake	W/ Brake
SGMDH-22A□A	187 (7 36)	220 (8 66)	235 (9 25)	13 5 (0 53)	18 (0 71)	$200^{\ 0}_{-0\ 046}$ $\left(7\ 87^{\ 0}_{-0\ 0018}\right)$	4 (0 16)	50 (1 97)	$28^{\ 0}_{-0\ 013}$ $\left(1\ 10^{\ 0}_{-0\ 0005}\right)$	55 (2 17)	15 5 (34 2)	20 5 (45 2)
SGMDH-32A□A	199 (7 83)										18 5 (40 8)	23 5 (51 8)
SGMDH-40A□A	209 (8 23)							60 (2 36)	$32^{\ 0}_{-0\ 016}$ $\left(1\ 26^{\ 0}_{-0\ 0006}\right)$	65 (2 56)	21 0 (46 3)	26 0 (57 3)

8.2 Servopacks

This section presents tables of SGDM Servopack ratings and specifications

8.2.1 Combined Specifications

The following table provides specifications of the SGDM Servopacks and SGMAH, SGMPH, SGMGH. SGMSH and SGMDH Servomotor combinations

Table 8 7 Servopack and SGMAH/SGMPH Servomotor Combination Specifications at 200 V

Voltage			Single-phase 200 V					Three-phase 200 V					
Servopack Model SGDM-			A3AD	A5AD	01AD	02AD	04AD	05AD	08AD	10AD	15AD	20AD	30AD
			A3ADA	A5ADA	01ADA	02ADA	04ADA	05ADA	08ADA	10ADA	15ADA	20ADA	30ADA
SGMAH Series	Applicable Servomotor	Model SGMAH-	A3A	A5A	01A	02A	04A	–	08A	–	–	–	–
		Capacity (kW)	0 03	0 05	0 1	0 2	0 4	–	0 75	–	–	–	–
		Motor Speed (r/min)	Rated 3000/maximum 5000										
	Applicable Encoder		Standard 13-bit incremental encoder										
	Continuous Output Current A (rms)		0 44	0 64	0 91	2 1	2 8	–	4 4	–	–	–	–
	Max. Output Current A (rms)		1 3	2 0	2 8	6 5	8 5	–	13 4	–	–	–	–
	Allowable Regenerative Energy*1 (Joules)		18 5		37 1			–					
	Allowable Regenerative Frequency *2 (times/min)		–					–	89	–			

Voltage			Single-phase 200 V					Three-phase 200 V					
Servopack Model SGDM-			A3AD	A5AD	01AD	02AD	04AD	05AD	08AD	10AD	15AD	20AD	30AD
			A3ADA	A5ADA	01ADA	02ADA	04ADA	05ADA	08ADA	10ADA	15ADA	20ADA	30ADA
SGMPH Series	Applicable Servomotor	Model SGMPH-	–	–	01A	02A	04A	–	08A	–	15A	–	–
		Capacity (kW)	–	–	0 1	0 2	0 4	–	0 75	–	1 5	–	–
		Motor Speed (r/min)	Rated 3000/maximum 5000										
	Applicable Encoder		Standard 13-bit incremental encoder										
	Continuous Output Current A (rms)		–	–	0 89	2 0	2 6	–	4 1	–	7 5	–	–
	Max. Output Current A (rms)		–	–	2 8	6 0	8 0	–	13 9	–	23 0	–	–
	Allowable Regenerative Energy*1 (Joules)		–			37 1		–					
	Allowable Regenerative Frequency *2 (times/min)		–					–	29	–	17	–	

* 1 Allowable regenerative energy is the value with an AC input power supply voltage of 200 Vrms The allowable regenerative energy may vary with power supply fluctuations

* 2 Allowable regenerative frequency is the allowable frequency in the Servomotor while accelerating and decelerating through a 0 → maximum motor speed → 0 (r/min) cycle

Table 8 8 Servopack and SGMGH Servomotor Combination Specifications at 200 V

Voltage			Three-phase 200 V								
Servopack Model SGDM-			05AD	08AD	10AD	15AD	20AD	30AD	–	–	–
			05ADA	08ADA	10ADA	15ADA	20ADA	30ADA	50ADA	60ADA	75ADA
SGMGH Series	Applicable Servomotor	Model SGMGH-	05A□A	–	09A□A	13A□A	20A□A	30A□A	44A□A	55A□A	75A□A
		Capacity (kW)	0 45	–	0 85	1 3	1 8	2 9	4 4	5 5	7 5
		Motor Speed (r/min)	Rated 1500/maximum 3000								
	Applicable Encoder		Standard 17-bit incremental encoder								
	Continuous Output Current A (rms)		3 8	–	7 1	10 7	16 7	23 8	32 8	42 1	54 7
	Max. Output Current A (rms)		11	–	17	28	42	56	84	110	130
	Allowable Regenerative Frequency *1 (times/min)		34	–	13	10	12	8	11	26*2	36*2
SGMGH Series	Applicable Servomotor	Model SGMGH-	03A□B	06A□B	09A□B	12A□B	20A□B	30A□B	44A□B	60A□B	–
		Capacity (kW)	0 3	0 6	0 9	1 2	2 0	3 0	4 4	6 0	–
		Motor Speed (r/min)	Rated 1000/maximum 2000								
	Applicable Encoder		Standard 17-bit incremental encoder								
	Continuous Output Current A (rms)		3 0	5 7	7 6	11 6	18 5	24 8	32 9	46 9	–
	Max. Output Current A (rms)		7 3	13 9	16 6	28	42	56	84	110	–
	Allowable Regenerative Frequency *1 (times/min)		96	39	22	15	20	13	20	44*2	–

8

* 1 Allowable regenerative frequency is the allowable frequency in the Servomotor while accelerating and decelerating through a 0 → maximum motor speed → 0 (r/min) cycle

* 2 The regenerative frequency for motor combinations with the SGDM-60ADA/-75ADA assume that the JUSP-RA04 or JUSP-RA05 Regenerative Resistor Unit is used For information on Regenerative Resistor Units, refer to *5 6 1 External Regenerative Resistors* or to *5 2 5 Regenerative Resistor Units* in the Σ-II Series SGM□H/ SGDM User's Manual Servo Selection and Datasheets (manual number SIE-S800-31 1)

Table 8.9 Servopack and SGMSH/SGMDH Servomotor Combination Specifications at 200 V

Voltage			Three-phase 200 V							
Servopack Model SGDM-			05AD	08AD	10AD	15AD	20AD	30AD	–	
			05ADA	08ADA	10ADA	15ADA	20ADA	30ADA	50ADA	
SGMSH Series	Applicable Servomotor	Model SGMSH-	–	–	10A	15A	20A	30A	40A	50A
		Capacity (kW)	–	–	1.0	1.5	2.0	3.0	4.0	5.0
		Motor Speed (r/min)	Rated 3000/maximum 5000							
	Applicable Encoder		Standard 17-bit incremental encoder							
	Continuous Output Current A (rms)		–	–	5.7	9.7	12.7	18.8	25.4	28.6
	Max. Output Current A (rms)		–	–	17	28	42	56	77	84
	Allowable Regenerative Frequency * (times/min)		–	–	39	31	48	20	29	22
SGMDH Series	Applicable Servomotor	Model SGMDH-	–	–	–	–	–	22A	32A	40A
		Capacity (kW)	–	–	–	–	–	2.2	3.2	4.0
		Motor Speed (r/min)	Rated 3000/maximum 5000							
	Applicable Encoder		Standard 17-bit incremental encoder							
	Continuous Output Current A (rms)		–	–	–	–	–	15.7	20.9	23.2
	Max. Output Current A (rms)		–	–	–	–	–	54	73	77
	Allowable Regenerative Frequency * (times/min)		–	–	–	–	–	7	11	8

* Allowable regenerative frequency is the allowable frequency in the Servomotor while accelerating and decelerating through a 0 → maximum motor speed → 0 (r/min) cycle

Table 8.10 Servopack and Servomotor Combination Specifications

Voltage			Single-phase 100 V			
Servopack Model SGDM-			A3BD	A5BD	01BD	02BD
Servopack Model SGDM-			A3BDA	A5BDA	01BDA	02BDA
SGMAH Series	Applicable Servomotor	Model SGMAH-	A3B	A5B	01B	02B
		Capacity kW	0 03	0 05	0 1	0 2
		Motor Speed (r/min)	Rated 3000/maximum 5000			
	Applicable Encoder		Standard 13-bit incremental encoder			
	Continuous Output Current A (rms)		0 66	0 95	2 4	3 0
	Max. Output Current A (rms)		2 0	2 9	7 2	9 0
	Allowable Regenerative Energy*1 (Joules)		7 8	15 7		
SGMPH Series	Applicable Servomotor	Model SGMPH-	–	–	01B	02B
		Capacity kW	–	–	0 1	0 2
		Motor Speed (r/min)	Rated 3000/maximum 5000			
	Applicable Encoder		Standard 13-bit incremental encoder			
	Continuous Output Current A (rms)		–	–	2 2	2 7
	Max. Output Current A (rms)		–	–	7 1	8 4
	Allowable Regenerative Energy*1 (Joules)		–		15 7	

* Allowable regenerative energy is the value with an AC input power supply voltage of 100 Vrms The allowable regenerative energy may vary with power supply fluctuations



Refer to *Section 5 6 Selecting a Regeneration Resistor* for more details on allowable regenerative energy and frequency

8.2.2 Ratings and Specifications

The following table shows ratings and specifications for the SGDM Servopack Refer to them as required when selecting a Servopack

Table 8 11 Servopack Ratings and Specifications

Servopack Model SGDM-			A3	A5	01	02	04	05	08	10	15	20	30
Applicable Servomotor	200V	SGMAH-□A	A3A	A5A	01A	02A	04A	–	08A	–	–	–	–
		SGMPH-□A	–	–	01A	02A	04A	–	08A	–	15A	–	–
		SGMGH-□A□A (1500r/min)	–	–	–	–	–	05	–	09	13	20	30
		SGMGH-□A□B (1000r/min)	–	–	–	–	–	03	06	09	12	20	30
		SGMSH-□A	–	–	–	–	–	–	–	10	15	20	30
	100V	SGMAH-□B	A3B	A5B	01B	02B	–	–	–	–	–	–	–
		SGMPH-□B	–	–	01B	02B	–	–	–	–	–	–	–
Basic Specifications	Max Applicable Servomotor Capacity [kW]		0 03	0 05	0 1	0 2	0 4	0 5	0 75	1 0	1 5	2 0	3 0
	200V	Continuous Output Current [A rms]	0 44	0 64	0 91	2 1	2 8	3 8	5 7	7 6	11 6	18 5	24 8
		Max. Output Current [A rms]	1 3	2 0	2 8	6 5	8 5	11 0	13 9	17	28	42	56
	100V	Continuous Output Current [A rms]	0 66	0 95	2 4	3 0	–	–	–	–	–	–	–
		Max. Output Current [A rms]	2 0	2 9	7 2	9 0	–	–	–	–	–	–	–
	Input Power Supply	200 and 100-V Servopack Capacity Range	For single-phase 200 VAC					For three-phase 200 VAC					
			For single-phase 100 VAC				–						
		Main circuit *1	Three-phase (or single-phase) 200 to 230 VAC +10 to –15%, 50/60 Hz, or single-phase 100 to 115 VAC +10 to –15%, 50/60 Hz										
		Control Circuit *1	Single-phase 200 to 230 VAC +10 to –15%, 50/60 Hz, or single-phase 100 to 115 VAC +10 or –15%, 50/60 Hz										
	Control Method		Single or three-phase full-wave rectification IGBT-PWM (sine-wave driven)										
	Feedback		Serial encoder 13, 16 or 17-bit (incremental/absolute value) * The 13 bit encoder is incremental only										
	Conditions	Ambient/Storage Temperature *2	0 to +55°C/–20 to +85°C										
		Ambient/Storage Humidity	90% RH or less (with no condensation)										
		Vibration/Shock Resistance	4 9 m/s^2/19 6 m/s^2										
	Configuration		Base mounted (Can be rack mounted with optional specifications)										
	Approx Mass [kg] (lb)	For 200 V	0 8 (1 76)				1 1 (2 43)	1 7 (3 75)			2 8 (6 17)	3 8 (8 38)	
		For 100 V	0 8 (1 76)			1 1 (2 43)	–						

Servopack Model SGDM-				A3	A5	01	02	04	05	08	10	15	20	30
Speed and Torque Control Modes	Performance	Speed Control Range		1 5000 (The lowest speed of the speed control range is the speed at which the Servomotor will not stop with a rated torque load)										
		Speed Regulation *3	Load Regulation	0 to 100% load 0 01% max (at rated speed)										
			Voltage Regulation	Rated Voltage ±10% 0% (at rated speed)										
			Temperature Regulation	25 ± 25 °C ±0 1% max (at rated speed)										
		Frequency Characteristics		400 Hz (at $J_L = J_M$)										
		Torque Control Tolerance (Repeatability)		±2%										
		Soft Start Time Setting		0 to 10 s (Can be set individually for acceleration and deceleration)										
	Input Signals	Speed Reference Input	Reference Voltage *4	±6 VDC (Variable setting range ±2 to ±10 VDC) at rated torque (positive torque reference with positive reference), input voltage ±12 V (max)										
			Input Impedance	About 14 kΩ										
			Circuit Time Constant	–										
		Torque Reference Input	Reference Voltage *4	±3 VDC (Variable setting range ±1 to ±10 VDC) at rated torque (positive torque reference with positive reference), input voltage ±12 V (max)										
			Input Impedance	About 14 kΩ										
			Circuit Time Constant	About 47 µs										
		Contact Speed Reference	Rotation Direction Selection	With P control signal										
			Speed Selection	With forward/reverse current limit signal (speed 1 to 3 selection), Servomotor stops or another control method is used when both are OFF										
Position Control Modes	Performance	Bias Setting		0 to 450 r/min (setting resolution 1 r/min)										
		Feed Forward Compensation		0 to 100% (setting resolution 1%)										
		Positioning Completed Width Setting		0 to 250 reference units (setting resolution 1 reference unit)										
	Input Signals	Reference Pulse	Type	Sign + pulse train, 90° phase difference 2-phase pulse (A phase + B phase), or CCW + CW pulse train										
			Form	Line driver (+5 V level), open collector (+5 V or +12 V level)										
			Frequency	500/200 kpps max (line driver/open collector)										
		Control Signal		Clear Signal (input pulse form identical to reference pulse)										
		Built-in Open Collector Power Supply *5		+12 V (1-kΩ resistor built in)										

Servopack Model SGDM-			A3	A5	01	02	04	05	08	10	15	20	30
I/O Signals	Position Output	Form	A-, B-, C-phase line driver S-phase line driver (only with an absolute encoder)										
		Frequency Dividing Ratio	Any										
	Sequence Input	Signal allocation can be modified.	Servo ON, P control (or Control Mode switching, forward/reverse motor rotation by internal speed setting, zero clamping, reference pulse prohibited), forward run prohibited (P-OT), reverse run prohibited (N–OT), alarm reset, forward current limit and reverse current limit (or internal speed selection)										
	Sequence Output	Fixed Output	Servo alarm, 3-bit alarm codes										
		Signal allocation can be modified.	Positioning completed (speed coincidence), during Servomotor rotation, servo ready, during current limiting, during speed limiting, brake released, warning, selecting three of the NEAR signals										
Internal Functions	Dynamic Brake		Operated at main power OFF, servo alarm, servo OFF or overtravel										
	Regeneration		External regenerative resistor					Built-in					
	Overtravel Stop		Dynamic brake stop at P-OT or N-OT, deceleration to a stop, or free run to a stop										
	Electronic Gear		0 01 ≦ B/A ≦ 100										
	Protection		Overcurrent, overvoltage, low voltage, overload, regeneration error, main circuit voltage error, heat sink overheated, no power supply, overflow, overspeed, encoder error, overrun, CPU error, parameter error, etc										
	LED Display		Charge, Power, five 7-segment LEDs (built-in Digital Operator functions)										
	CN5 Analog Monitoring		Analog monitor connector built in for monitoring speed, torque and other reference signals Speed 1 V/1000 r/min Torque 1 V/rated torque Pulses remaining 0 05 V/1 reference units or 0 05 V/100 reference units										
	Communications	Connected Devices	Digital Operator (hand-held model), RS-422A port such as for a personal computer (RS-232C ports under certain conditions)										
		1:N Communications	Up to N = 14 for RS-422A ports										
		Axis Address Setting	Set with user constants										
		Functions	Status display, user constant setting, monitor display, alarm trace-back display, JOG and auto-tuning operations, speed, torque reference signal and other drawing functions										
	Others		Reverse rotation connection, origin search, automatic Servomotor ID, DC reactor connection terminal for high power supply frequency control										

* 1 Supply voltage must not exceed 230 V +10% (253 V) or 115 V + 10% (127 V) A step-down transformer is required if the voltage exceeds these values

* 2 Use the Servopack within the ambient temperature range When enclosed in a box, internal temperatures must not exceed the ambient temperature range

* 3 Speed regulation is defined as follows

$$\text{Speed reguration} = \frac{\text{No-load motor speed} - \text{Total load motor speed}}{\text{Rated motor speed}} \times 100\%$$

The motor speed may change due to voltage variations or amplifier drift and changes in processing resistance due to temperature variation The ratio of speed changes to the rated speed represent speed regulation due to voltage and temperature variations

* 4 Forward is clockwise viewed from the non-load side of the Servomotor (Counterclockwise viewed from the load and shaft end)

* 5 The built-in open collector power supply is not electrically insulated from the control circuit in the Servopack

Table 8 12 Servopack Ratings and Specifications 2

Servopack Model SGDM-			30	50		60	75
Applicable Servomotor	200V	SGMGH-□A□A (1500r/min)	30	44		55	75
		SGMGH-□A□B (1000r/min)	30	44		60	–
		SGMSH-□A	30	40	50	–	–
		SGMDH-□A	22	32	40	–	–
Basic Specifications	Max Applicable Servomotor Capacity [kW]		3 0	5 0		6 0	7 5
	200V	Continuous Output Current [A rms]	24 8	32 9		46 9	54 7
		Max. Output Current [A rms]	56	84		110	130
	Input Power Supply	Main circuit *1	Three-phase 200 to 230 VAC +10 to –15%, 50/60 Hz				
		Control Circuit *1	Single-phase 200 to 230 VAC +10 to –15%, 50/60 Hz				
	Control Method		Three-phase full-wave rectification IGBT-PWM (sine-wave driven)				
	Feedback		Serial encoder 17-bit (incremental/absolute value)				
	Conditions	Ambient/Storage Temperature *2	0 to +55°C/–20 to +85°C				
		Ambient/Storage Humidity	90% RH or less (with no condensation)				
		Vibration/Shock Resistance	4 9 m/s^2/19 6 m/s^2				
	Configuration		Base mounted (Can be rack mounted with optional specifications)			Base mounted (Can be duct ventilated with optional specifications)	
	Approx Mass [kg] (lb)		3 8 (8 38)	5 5 (12 1)		15 (33 1)	

Servopack Model SGDM-				30	50	60	75
Speed and Torque Control Modes	Performance	Speed Control Range		1 5000 (The lowest speed of the speed control range is the speed at which the Servomotor will not stop with a rated torque load)			
		Speed Regulation *3	Load Regulation	0 to 100% load 0 01% max (at rated speed)			
			Voltage Regulation	Rated Voltage ±10% 0% (at rated speed)			
			Temperature Regulation	25 ± 25 °C ±0 1% max (at rated speed)			
		Frequency Characteristics		400 Hz (at $J_L = J_M$)			
		Torque Control Tolerance (Repeatability)		±2%			
		Soft Start Time Setting		0 to 10 s (Can be set individually for acceleration and deceleration)			
	Input Signals	Speed Reference Input	Reference Voltage *4	±6 VDC (Variable setting range ±2 to ±10 VDC) at rated torque (positive torque reference with positive reference), input voltage ±12 V (max)			
			Input Impedance	About 14 kΩ			
			Circuit Time Constant	–			
		Torque Reference Input	Reference Voltage *4	±3 VDC (Variable setting range ±1 to ±10 VDC) at rated torque (positive torque reference with positive reference), input voltage ±12 V (max)			
			Input Impedance	About 14 kΩ			
			Circuit Time Constant	About 47 µs			
		Contact Speed Reference	Rotation Direction Selection	With P control signal			
			Speed Selection	With forward/reverse current limit signal (speed 1 to 3 selection), Servomotor stops or another control method is used when both are OFF			
Position Control Modes	Performance	Bias Setting		0 to 450 r/min (setting resolution 1 r/min)			
		Feed Forward Compensation		0 to 100% (setting resolution 1%)			
		Positioning Completed Width Setting		0 to 250 reference units (setting resolution 1 reference unit)			
	Input Signals	Reference Pulse	Type	Sign + pulse train, 90° phase difference 2-phase pulse (A phase + B phase), or CCW + CW pulse train			
			Form	Line driver (+5 V level), open collector (+5 V or +12 V level)			
			Frequency	500/200 kpps max (line driver/open collector)			
		Control Signal		Clear Signal (input pulse form identical to reference pulse)			
		Built-in Open Collector Power Supply *5		+12 V (1-kΩ resistor built in)			

Servopack Model SGDM-			30	50	60	75
I/O Signals	Position Output	Form	A-, B-, C-phase line driver S-phase line driver (only with an absolute encoder)			
		Frequency Dividing Ratio	Any			
	Sequence Input	Signal allocation can be modified.	Servo ON, P control (or Control Mode switching, forward/reverse motor rotation by internal speed setting, zero clamping, reference pulse prohibited), forward run prohibited (P-OT), reverse run prohibited (N–OT), alarm reset, forward current limit and reverse current limit (or internal speed selection)			
	Sequence Output	Fixed Output	Servo alarm, 3-bit alarm codes			
		Signal allocation can be modified	Positioning completed (speed coincidence), during Servomotor rotation, servo ready, during current limiting, during speed limiting, brake released, warning, selecting three of the NEAR signals			
Internal Functions	Dynamic Brake		Operated at main power OFF, servo alarm, servo OFF or overtravel			
	Regeneration		Built-in		External regenerative resistor	
	Overtravel Stop		Dynamic brake stop at P-OT or N-OT, deceleration to a stop, or free run to a stop			
	Electronic Gear		0 01 ≦ B/A ≦ 100			
	Protection		Overcurrent, overvoltage, low voltage, overload, regeneration error, main circuit voltage error heat sink overheated, no power supply, overflow, overspeed, encoder error, overrun, CPU error, parameter error, etc			
	LED Display		Charge, Power, five 7-segment LEDs (built-in Digital Operator functions)			
	CN5 Analog Monitoring		Analog monitor connector built in for monitoring speed, torque and other reference signals Speed 1 V/1000 r/min Torque 1 V/rated torque Pulses remaining 0 05 V/1 reference units or 0 05 V/100 reference units			
	Communications	Connected Devices	Digital Operator (hand-held model), RS-422A port such as for a personal computer (RS-232C ports under certain conditions)			
		1 N Communications	Up to N = 14 for RS-422A ports			
		Axis Address Setting	Set with user constants			
		Functions	Status display, user constant setting, monitor display, alarm trace-back display, JOG and auto-tuning operations, speed, torque reference signal and other drawing functions			
	Others		Reverse rotation connection, origin search, automatic Servomotor ID, DC reactor connection terminals for high power supply frequency control*6			

* 1 Supply voltage must not exceed 230 V +10% (253 V) A step-down transformer is required if the voltage exceeds these values

* 2 Use the Servopack within the ambient temperature range When enclosed in a box, internal temperatures must not exceed the ambient temperature range

* 3 Speed regulation is defined as follows

$$\text{Speed reguration} = \frac{\text{No-load motor speed} - \text{Total load motor speed}}{\text{Rated motor speed}} \times 100\%$$

The motor speed may change due to voltage variations or amplifier drift and changes in processing resistance due to temperature variation The ratio of speed changes to the rated speed represent speed regulation due to voltage and temperature variations

* 4 Forward is clockwise viewed from the non-load side of the Servomotor (Counterclockwise viewed from the load and shaft end)

* 5 The built-in open collector power supply is not electrically insulated from the control circuit in the Servopack

* 6 The DC reactor connection terminals for power supplies designed for minimum harmonics are not included in Servopacks with capacities of 6 kW or more

8.2.3 Dimensional Drawings


- Dimensional drawings of the Base Mounting Standard Servopacks are shown below. For detailed dimensional drawings, refer to *Servo Selection and Data Sheets*.

  For details of the Rack Mounting and Duct-ventilated Servopacks, refer also to *Servo Selection and Data Sheets*.

■ Base Mounting Models


Unit: mm (in)

SGDM-A3AD to -02AD, -A3ADA to -02ADA (Single-phase, 200 V, 30 to 200 W)
SGDM-A3BD to -01BD, -A3BDA to -01BDA (Single-phase, 100 V, 30 to 100 W)

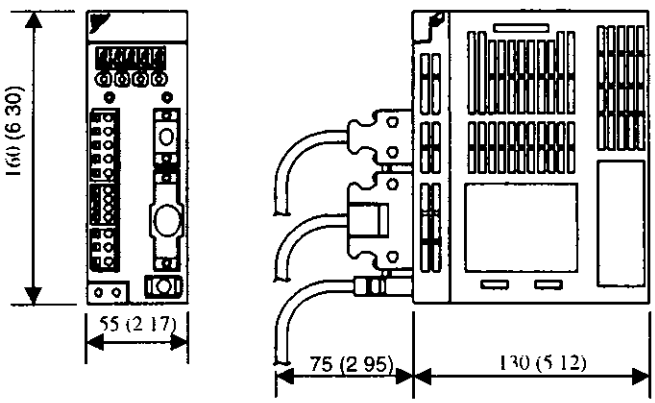


Approx. mass: 0.8 kg (1.76 lb)

SGDM-04AD, -04ADA (Single-phase, 200 V, 400 W)
SGDM-02BD, -02BDA (Single-phase, 100 V, 200 W)

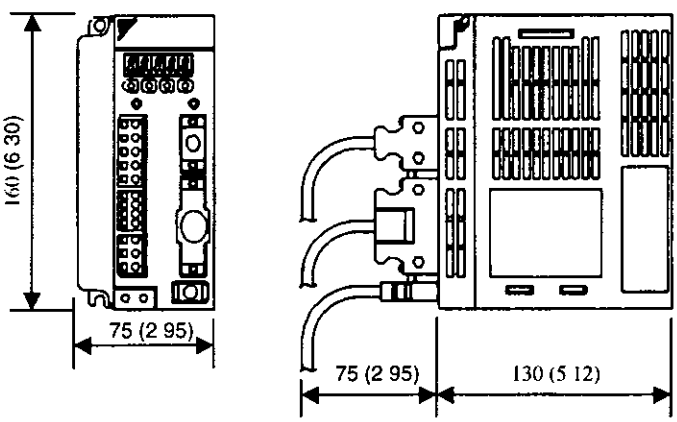


Approx. mass: 1.1 kg (2.43 lb)

SGDM-05AD to-10AD, -05ADA to -10ADA (Three-phase, 200 V, 0.5 to 1.0 kW)

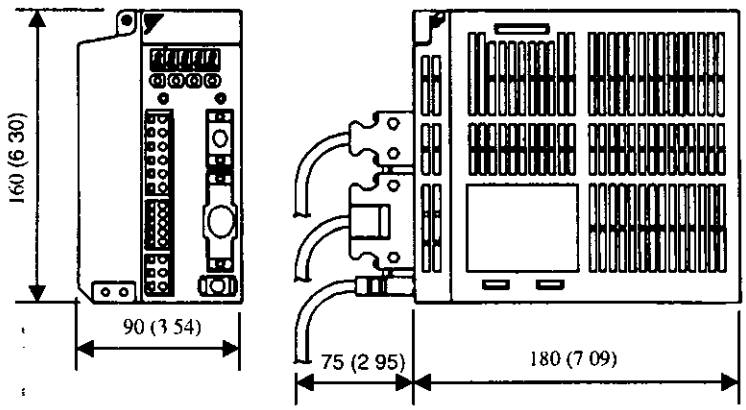


Approx mass 1 7 kg (3 75 lb)

SGDM-15AD, -15ADA (Three-phase, 200 V, 1.5 kW)

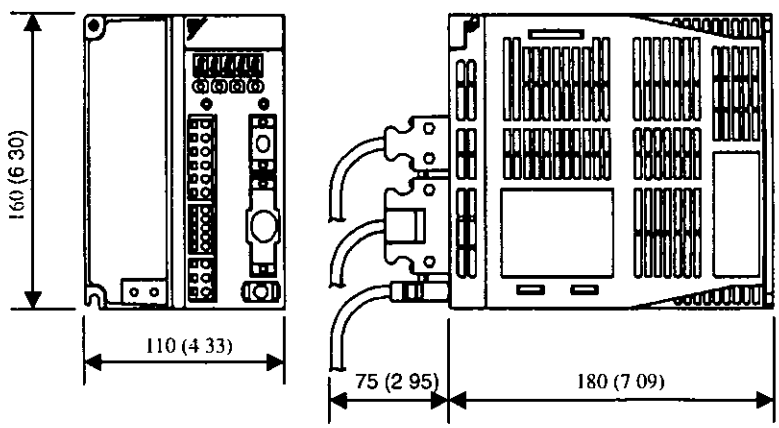


Approx mass 2 8 kg (6 17 lb)

SGDM-20AD, -30AD, -20ADA, -30ADA (Three-phase, 200 V, 2.0 kW, 3.0 kW)

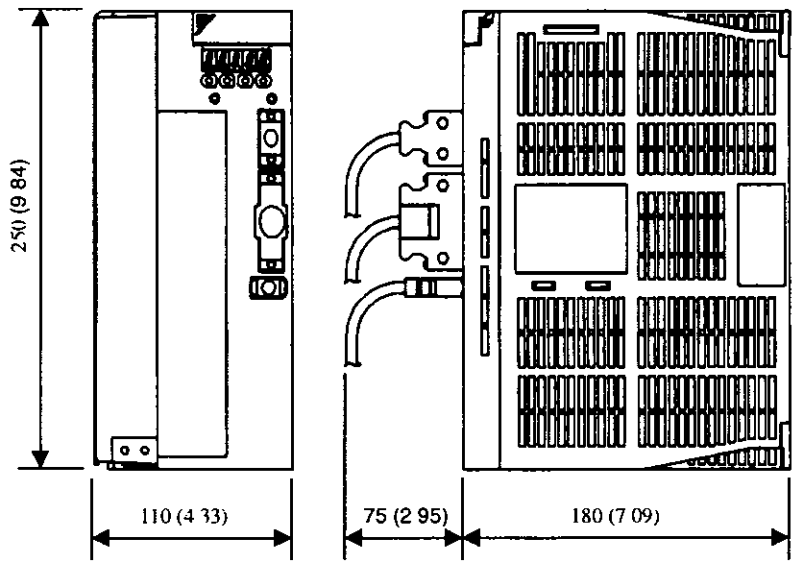


Approx mass 3 8 kg (8 38 lb)

SGDM-50ADA (Three-phase, 200 V, 5.0 kW)

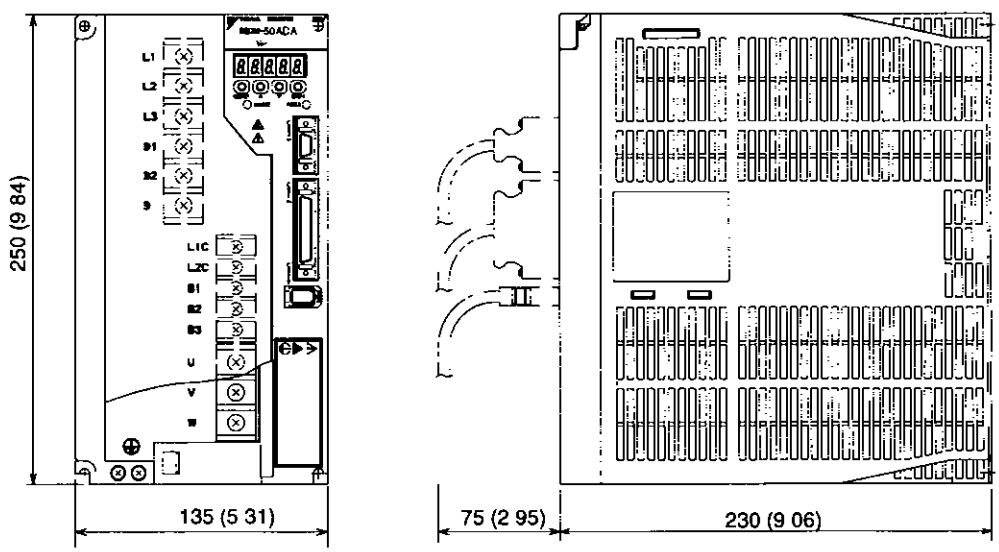

Approx mass 5 5 kg (12 1 lb)

SGDM-60ADA, -75ADA (Three-phase, 200 V, 6.0 kW, 7.5 kW)

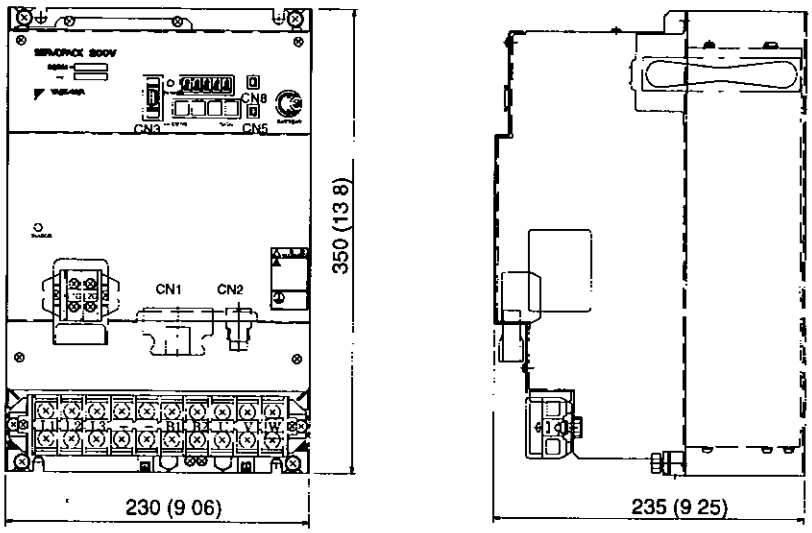

9

Inspection, Maintenance, and Troubleshooting

This chapter describes the basic inspection and maintenance to be carried out by the user In addition, troubleshooting procedures are described for problems which cause an alarm display and for problems which result in no alarm display

9 1 Servodrive Inspection and Maintenance . 9 - 2

9 1 1 Servomotor Inspection 9 - 2

9 1 2 Servopack Inspection 9 - 3

9 1 3 Replacing Battery for Absolute Encoder 9 - 4

9.2 Troubleshooting . . . . . 9 - 5

9 2 1 Troubleshooting Problems with Alarm Displays 9 - 5

9 2 2 Troubleshooting Problems with No Alarm Display 9 - 31

9 2 3 Alarm Display Table 9 - 33

9 2 4 Warning Displays 9 - 35

9.1 Servodrive Inspection and Maintenance

This section describes the basic inspections and maintenance of Servomotors and Servopacks and the procedures for replacing the battery for absolute encoders

9.1.1 Servomotor Inspection

For inspection and maintenance of Servomotors, follow the simple, daily inspection procedures in the following table

The AC Servomotors are brushless Simple, daily inspection is sufficient The inspection and maintenance frequencies in the table are only guidelines Increase or decrease the frequency to suit the operating conditions and environment

IMPORTANT

During inspection and maintenance, do not disassemble the Servomotor
If disassembly of the Servomotor is required, contact your Yaskawa representative

Table 9.1 Servomotor Inspections

Item	Frequency	Procedure	Comments
Vibration and Noise	Daily	Touch and listen	Levels higher than normal?
Exterior	According to degree of contamination	Clean with cloth or compressed air	–
Insulation Resistance Measurement	At least every year	Disconnect Servopack and test insulation resistance at 500 V Must exceed 10 MΩ*	Contact your Yaskawa representative if the insulation resistance is below 10 MΩ
Replacing Oil Seal	At least every 5000 hours	Remove Servomotor from machine and replace oil seal	Applies only to motors with oil seals
Overhaul	At least every 20000 hours or 5 years	Contact your Yaskawa representative	The user should not disassemble and clean the Servomotor

* Measure across the Servomotor FG and the U-phase, V-phase, or W-phase power line

9.1.2 Servopack Inspection

For inspection and maintenance of the Servopack, follow the inspection procedures in the following table at least once every year Other routine inspections are not required

Table 9.2 Servopack Inspections

Item	Frequency	Procedure	Comments
Clean Interior and Circuit Boards	At least every year	Check for dust, dirt, and oil on the surfaces	Clean with compressed air
Loose Screws	At least every year	Check for loose terminal block and connector screws	Tighten any loose screws
Defective Parts in Unit or on Circuit Boards	At least every year	Check for discoloration, damage or discontinuities due to heating	Contact your Yaskawa representative

■ Part Replacement Schedule

The following parts are subject to mechanical wear or deterioration over time To avoid failure, replace these parts at the frequency indicated

The user constants of any Servopacks overhauled by Yaskawa are reset to the standard settings before shipping Be sure to confirm that the user constants are properly set before starting operation

Table 9.3 Periodical Part Replacement

Part	Standard Replacement Period	Replacement Method
Cooling Fan	4 to 5 years	Replace with new part
Smoothing Capacitor	7 to 8 years	Test Replace with new part if necessary
Relays	–	Test Replace if necessary
Fuse	10 years	Replace with new part
Aluminum Electrolytic Capacitor on Circuit Board	5 years	Test Replace with new circuit board if necessary

Operating Conditions:

- Ambient Temperature Annual average of 30°C
- Load Factor 80% max
- Operation Rate 20 hours/day max

9.1.3 Replacing Battery for Absolute Encoder

If the voltage of the battery for an absolute encoder drops to approx 2 7 V or less, an Absolute Encoder Battery Alarm (A 83) will occur in the Servopack This alarm occurs when the Servopack receives a signal from the absolute encoder when the power to the Servopack is turned ON Therefore, the Servopack will not give an alarm when the battery voltage drops below the minimum voltage level while the power is being supplied to the Servopack

Refer to *5 7 3 Handling Batteries* for the battery type recommended for absolute encoders

Replace the battery using the following procedure if the battery voltage drops below the minimum required battery voltage

■ Battery Replacement Procedure

1. Replace the battery while the control power to the Servopack is ON
2. After replacement, turn OFF the power to the Servopack in order to clear the Absolute Encoder Battery Alarm (A 83)
3. Turn ON the power to the Servopack again and confirm that it operates properly to complete battery replacement

IMPORTANT

The absolute encoder data will be lost when the control power to the Servopack is turned OFF and when the encoder cable is disconnected from the battery If the data is lost, refer to *5 7 4 Initializing the Absolute Encoder* and initialize the absolute encoder

9.2 Troubleshooting

This section describes causes and remedies for problems which cause an alarm display and for problems which result in no alarm display

9.2.1 Troubleshooting Problems with Alarm Displays

Problems that occur in the Servodrives are displayed on the panel operator as "A □□" or 'CPF-□□" "A – –", however, does not indicate an alarm Refer to the following sections to identify the cause of an alarm and the action to be taken

Contact your Yaskawa representative if the problem cannot be solved by the described procedures

■ A.02

A 02 User Constants Breakdown

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

At power ON — **A, B**

Cause		Remedy
A	Power turned OFF during parameter write Alarm occurred at next power ON	• Initialize user constants using Fn005 and reinput user settings • Replace Servopack
B	Circuit board (1PWB) defective	Replace Servopack

■ A.03


A 03 Main Circuit Encoder Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm



Cause		Remedy
A	Circuit board (1PWB or 2PWB) defective	Replace Servopack

■ A.04


A 04 User Constant Setting Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm



Cause		Remedy
A	An out-of-range user constant was previously set or loaded	• Reset all user constants in range • Otherwise, re-load correct user constant
B	Circuit board (1PWB) defective	Replace Servopack

■ A.05

A 05 Combination Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

At power ON —— A, B

Cause		Remedy
A	The range of Servomotor capacities that can be combined has been exceeded	Replace the Servomotor so that a suitable combination is achieved
B	Encoder parameters have not been written properly	Replace the Servomotor

■ A.10

A 10 Overcurrent or Heat Sink Overheated

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

During Servomotor operation — **A, B, D, E, F, G, H**

When SERVO ON (/S-ON) signal turned ON — **C, D**

At power ON — **C**

	Cause	Remedy
A	Wiring shorted between Servopack and Servomotor	Check and correct wiring
B	Servomotor U, V, or W phase shorted	Replace Servomotor
C	• Circuit board (1PWB) defective • Power transistor defective	Replace Servopack
D	Current feedback circuit, power transistor, DB circuit, or circuit board defective	Replace Servopack
E	The ambient temperature of the Servopack exceeded 55°C	Alter conditions so that the ambient temperature goes below 55°C
F	The air flow around the heat sink is bad	Follow the installation method and provide sufficient space as specified
G	Fan stopped	Replace Servopack
H	Servopack is operating under an overload	Reduce load

Note E to H can occur with a Servopack with a capacity of 1 5 kW to 3 kW

■ A.30

A 30 Regenerative Error Detected

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	ON	OFF	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

During Servomotor operation — A.B

Occurred when the control power turned ON — D

Occurred approximately 1 second after the main circuit power ON — A.B.C

	Cause	Remedy
A	Regenerative transistor is abnormal	Replace Servopack
B	Disconnection of the regenerative resistor	Replace Servopack or regenerative resistor
C	Regenerative Unit disconnected (for an external regenerative resistor)	Check wiring of the external regenerative resistor
D	Servopack defective	Replace Servopack

■ A.32

A 32 Regenerative Overload

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	ON	OFF	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

During Servomotor operation — A, B

Cause		Remedy
A	Regenerative power exceeds the allowable value	Use an external regenerative resistor that matches the regenerative power capacity
B	Alarm occurs although an external regenerative resistor is used and the temperature rise of the regenerative resistor is small	Correct user constant Pn600

■ A.40

A 40 Main Circuit DC Voltage Error Detected Overvoltage

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	ON	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

During Servomotor operation — **A, B, C, D**

Occurred when the control power turned ON — **E**

Occurred when main circuit power turned ON — **A, D**

	Cause	Remedy
A	The power supply voltage is not within the range of specifications	Check power supply
B	Load exceeds capacity of the Regenerative Unit	Check specifications of load inertia and overhanging load
C	Regenerative transistor is abnormal	Replace Servopack
D	Rectifying diode defective	
E	Servopack defective	

■ A.41

A 41 Main Circuit Voltage Error Detected Undervoltage

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	ON	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

During Servomotor operation — **A, B, C**

Occurred when the control power turned ON — **D**

Occurred when main circuit power turned ON — **A, B, C**

Cause		Remedy
A	The power supply voltage is not within the range of specifications	Check power supply voltage
B	Fuse blown	Replace Servopack
C	Rectifying diode defective	
D	Servopack defective	

■ A.51


A 51 Overspeed

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	OFF	ON	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

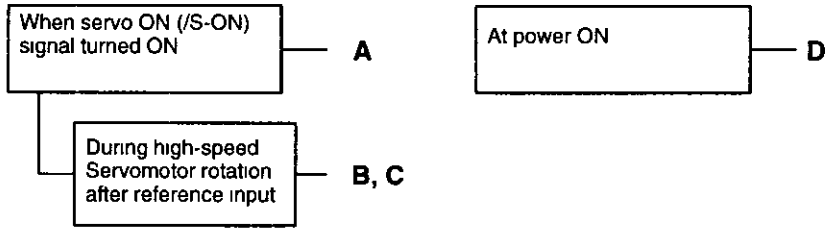

Cause		Remedy
A	Servomotor wiring incorrect	Check and correct wiring (Check for U-, V-, and W-phase wiring errors)
B	Position or speed reference input is too large	Lower the reference input values
C	Incorrect reference input gain settings	Check and correct user constant settings
D	Circuit board (1PWB) defective	Replace Servopack

■ A.71

A 71 Overload High Load

The alarm output, status, and remedy for A 71 are the same as for A 72

■ A.72


A 72 Overload Low Load

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	ON	ON	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

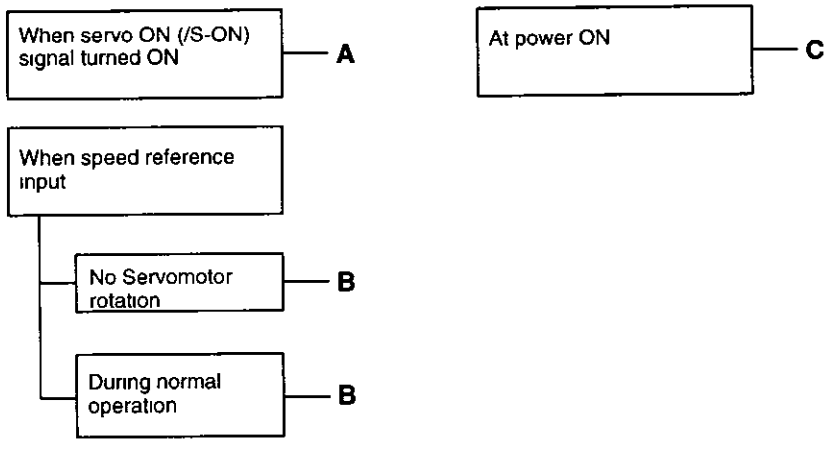

	Cause	Remedy
A	Servomotor wiring incorrect or disconnected	Check wiring and connectors at Servomotor
B	Load greatly exceeds rated torque	Reduce load torque and inertia Otherwise, replace with larger capacity Servomotor
C	Circuit board (IPWB) defective	Replace Servopack

■ A.73

A 73 Dynamic Brake Overload

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	ON	ON	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

When servo OFF signal turned ON — A

At power ON — B

	Cause	Remedy
A	The product of the square of rotational motor speed and the combined inertia of the motor and load (rotation energy) exceeds the capacity of the dynamic brake resistor built into Servopack	• Lower the rotational speed • Lower the load inertia • Minimize the use of the dynamic brake
B	Circuit board (1PWB) defective	Replace Servopack

■ A.74

A 74 Overload of Surge Current Limit Resistor

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	ON	ON	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

When main circuit power turned ON or OFF — A

At power ON — B

	Cause	Remedy
A	Frequently turning the main circuit power ON/OFF	Do not repeatedly turn ON/OFF the main circuit power
B	Circuit board (1PWB) defective	Replace Servopack

■ A.7A

A 7A Heat Sink Overheated

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	ON	ON	OFF

Note OFF Output transistor is OFF (alarm state)
ON Output transistor is ON

Status and Remedy for Alarm

During Servomotor operation — A, B, C, D

When control power turned ON — E

Cause		Remedy
A	The ambient temperature of the Servopack exceeds 55°C	Alter conditions so that the ambient temperature goes below 55°C
B	The air flow around the heat sink is bad	Follow installation methods and provide sufficient space as specified
C	Fan stopped	Replace Servopack
D	Servopack is operating under overload	Reduce load
E	Servopack defective	Replace Servopack

Note This alarm display tends to occur only with a Servopack of 30 W to 1000 W

■ A.81


A 81 Absolute Encoder Backup Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

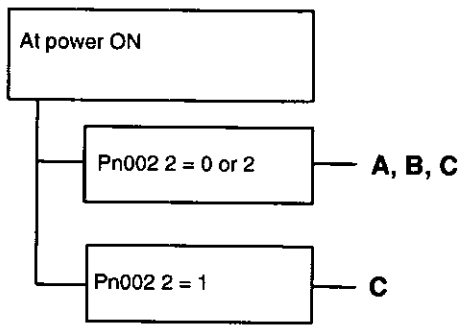

	Cause	Remedy
A	The following power supplies to the absolute encoder all failed • +5 V supply • Battery power	Follow absolute encoder set-up procedure
B	Absolute encoder malfunctioned	Replace Servomotor
C	Circuit board (1PWB) defective	Replace Servopack

■ A.82


A 82 Encoder Checksum Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

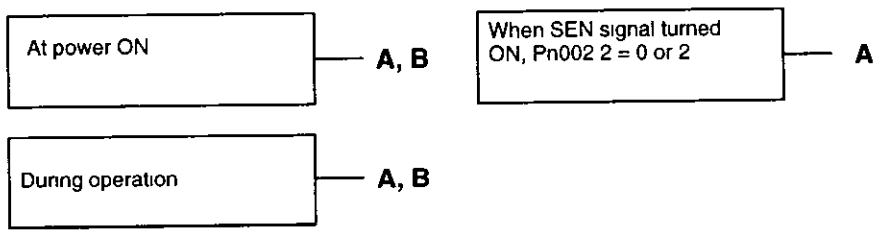

Cause		Remedy
A	Error during encoder memory check	• Follow absolute encoder set-up procedure • Replace Servomotor if error occurs frequently
B	Circuit board (1PWB) defective	Replace Servopack

■ A.83


A 83 Absolute Encoder Battery Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

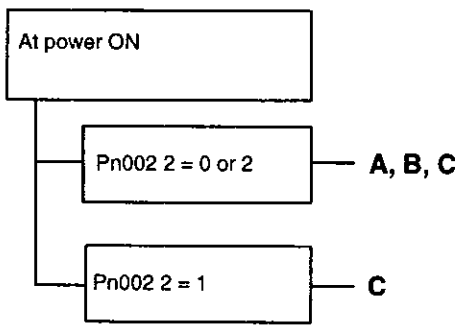

	Cause	Remedy
A	• Battery not connected • Battery connection defective	Check and correct battery connection
B	Battery voltage below specified value Specified value 2 7 V	Install a new battery while the control power to Servopack is ON After replacement, turn ON the power again
C	Circuit board (1PWB) defective	Replace Servopack

Note No alarm will occur at the Servopack is the battery error occurs during operation

■ A.84

A 84 Absolute Encoder Data Error -

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

At power ON — A

During operation — B

Cause		Remedy
A	Faulty encoder	Replace the Servomotor is the problem occurs often
B	Operational error in encoder caused by external noise	Check and correct wiring around the encoder (grounding of the Servomotor, separation between the encoder cable and the servomotor power cable, insertion of toroidal cores onto cables, etc)

■ A.85

A 85 Absolute Encoder Overspeed

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

At power ON — A, B

	Cause	Remedy
A	Absolute encoder turned ON at a speed exceeding 200 r/min	Turn ON power supply with the Servomotor stopped
B	Circuit board (1PWB) defective	Replace Servopack

■ A.86

A 86 Encoder Overheated

Detected only when using absolute encoder

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

During Servomotor operation — A, B

Occurred when the control power turned ON — C, D

	Cause	Remedy
A	The ambient temperature of the Servomotor is high	Alter conditions so that the ambient temperature goes below 40°C
B	Servomotor is operating under overload	Reduce load
C	Circuit board (1PWB) defective	Replace Servopack
D	Encoder defective	Replace Servopack

■ A.b1

A b1 Reference Speed Input Read Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

During Servomotor operation — A, B

At power ON — C

	Cause	Remedy
A	Error in reference read-in unit (A/D Converter, etc)	Reset alarm and restart operation
B	Reference read-in unit faulty (A/D Converter, etc)	Replace Servopack
C	Circuit board (1PWB) defective	Replace Servopack

■ A.b2

A b2 Reference Torque Input Read Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

During Servomotor operation — A, B

At power ON — C

	Cause	Remedy
A	Error in reference read-in unit (A/D Converter, etc)	Reset alarm and restart operation
B	Reference read-in unit faulty (A/D Converter, etc)	Replace Servopack
C	Circuit board (1PWB) defective	Replace Servopack

■ A.bF

A.bF System Error in Servopack Control Section

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	OFF

Note OFF Output transistor is OFF (alarm state)

Status and Remedy for Alarm

During Servomotor operation — A

Cause	Remedy
A Circuit board (1PWB or 2PWB) defective	Replace Servopack

■ A.C1


A.C1 Servo Overrun

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	OFF	ON	OFF

Note OFF: Output transistor is OFF (alarm state) ON: Output transistor is ON

Status and Remedy for Alarm

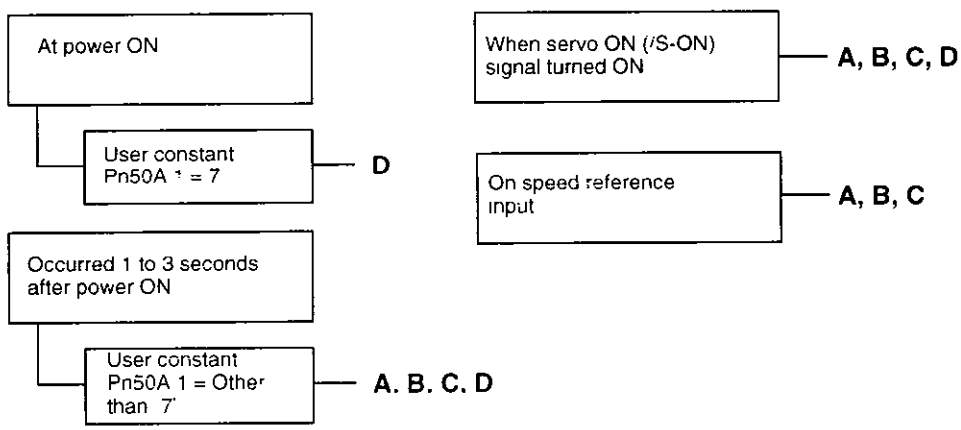

	Cause	Remedy
A	Servomotor wiring incorrect or disconnected	Check wiring and connectors at Servomotor
B	Encoder wiring incorrect or disconnected	Check wiring and connectors at encoder
C	Encoder defective	Replace Servomotor
D	Circuit board (PWB) defective	Replace Servopack

■ A.C8

A.C8 Absolute Encoder Clear Error and Multi-turn Limit Setting Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	OFF	ON	OFF

Note OFF Output transistor is OFF (alarm state) ON Output transistor is ON

Status and Remedy for Alarm

At power ON — A, B

When resetting multi-turn clear encoder alarm — A, B

	Cause	Remedy
A	Encoder defective	Replace Servomotor
B	Servopack defective	Replace Servopack

■ A.C9

A.C9 Encoder Communications Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	OFF	ON	OFF

Note OFF Output transistor is OFF (alarm state) ON Output transistor is ON

Status and Remedy for Alarm

During Servomotor operation — A, B, C

At power ON — A, B, C

	Cause	Remedy
A	Encoder wiring incorrect or disconnected	Check wiring and connectors at encoder
B	Encoder defective	Replace Servomotor
C	Servopack defective	Replace Servopack

■ A.CA

A.CA Encoder Parameter Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	OFF	ON	OFF

Note OFF Output transistor is OFF (alarm state) ON Output transistor is ON

Status and Remedy for Alarm

At power ON — A. B

	Cause	Remedy
A	Encoder defective	Replace Servomotor
B	Servopack defective	Replace Servopack

■ A.Cb

A.Cb Encoder Echoback Error

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	OFF	ON	OFF

Note OFF Output transistor is OFF (alarm state) ON Output transistor is ON

Status and Remedy for Alarm

At power ON — A. B

	Cause	Remedy
A	Encoder wiring incorrect or disconnected	Check wiring and connectors at encoder
B	Encoder defective	Replace Servomotor
C	Servopack defective	Replace Servopack

■ A.CC

A CC Multiturn Limit Disagreement Alarm

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	OFF	ON	OFF

Note OFF Output transistor is OFF (alarm state) ON Output transistor is ON

Status and Remedy for Alarm

At power ON — **A, B**

	Cause	Remedy
A	The setting of the Multiturn Limit Setting (Pn205) user constant in the Servopack is incorrect	Change use constant Pn205
B	The multiturn limit has not been set in the encoder	Check to be sure the Multiturn Limit Setting (Pn205) user constant in the Servopack is correct create a Multiturn Limit Disagreement Alarm (A CC) and then execute the encoder multiturn limit setting change (Fn013)

INFO This alarm will occur for the new version of SGDM Servopacks (SGDM-□DA) only

■ A.d0


A.d0 Position Error Pulse Overflow

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
ON	ON	OFF	OFF

Note OFF Output transistor is OFF (alarm state) ON Output transistor is ON

Status and Remedy for Alarm

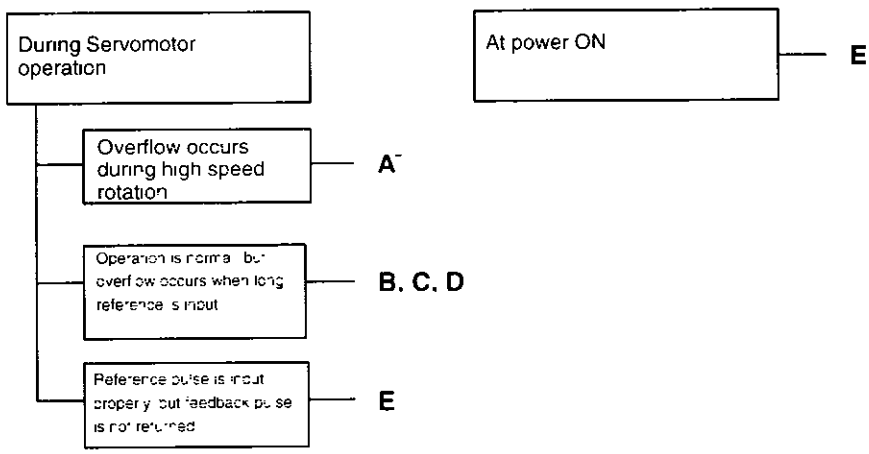

	Cause	Remedy
A	Servomotor wiring incorrect or poor connection	Check wiring and connectors at encoder
B	Servopack was not correctly adjusted	Increase speed loop gain (Pn100) and position loop gain (Pn102)
C	Motor load was excessive	Reduce load torque or inertia. If problem not corrected, replace with a motor with larger capacity
D	Position reference pulse frequency was too high	• Increase or decrease reference pulse frequency • Add smoothing function • Correct electronic gear ratio
E	Circuit board (PWB) defective	Replace Servopack

■ A.F1

A F1 Power Line Open Phase

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	ON	OFF	OFF

Note OFF Output transistor is OFF (alarm state) ON Output transistor is ON

Status and Remedy for Alarm

At main circuit power supply ON — **A. B**

Occurred when the control power turned ON — **C**

	Cause	Remedy
A	One phase (L1 L2 or L3) of the main circuit power supply is disconnected	• Check power supply • Check wiring of the main circuit power supply • Check MCCB noise filter, magnetic contactor
B	There is one phase where the line voltage is low	Check power supply
C	Servopack defective	Replace Servopack

Note A and B tend to occur in a Servopack with a capacity of 500 W or higher

■ CPF00

CPF00 Digital Operator Transmission Error 1

This alarm is not stored in the alarm trace-back function memory.

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
Not specified			

Status and Remedy for Alarm

At power ON Digital Operator connected before Servopack power turned ON — **A, B, C, D**

Digital Operator connected to Servopack while power turned ON — **A, B, C, D**

	Cause	Remedy
A	Cable defective or poor contact between Digital Operator and Servopack	• Check connector connections • Replace cable
B	Malfunction due to external noise	Separate Digital Operator and cable from noise source
C	Digital Operator defective	Replace Digital Operator
D	Servopack defective	Replace Servopack

■ CPF01

CPF01 Digital Operator Transmission Error 2

This alarm is not stored in the alarm trace-back function memory

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
Not specified			

Status and Remedy for Alarm

During operation	— A, B, C, D

	Cause	Remedy
A	Cable defective or poor contact between Digital Operator and Servopack	• Check connector connections • Replace cable
B	Malfunction due to external noise	Separate Digital Operator and cable from noise source
C	Digital Operator defective	Replace Digital Operator
D	Servopack defective	Replace Servopack

■ A.– –

A – – Normal Operation

This is not an alarm display

Display and Outputs

Alarm Outputs			
Alarm Code Outputs			ALM Output
ALO1	ALO2	ALO3	
OFF	OFF	OFF	ON

Note OFF Output transistor is OFF (alarm state) ON Output transistor is ON

9.2.2 Troubleshooting Problems with No Alarm Display

Refer to the tables below to identify the cause of a problem which causes no alarm display and take the remedy described

Turn OFF the servo system power supply before commencing the shaded procedures

Contact your Yaskawa representative if the problem cannot be solved by the described procedures

Table 9 4 Troubleshooting Table No Alarm Display

Symptom	Cause	Inspection	Remedy
Servomotor Does Not Start	Power not connected	Check voltage between power supply terminals	Correct the power circuit
	Loose connection	Check terminals of connectors (CN1, CN2)	Tighten any loose parts
	Connector (CN1) external wiring incorrect	Check connector (CN1) external wiring	Refer to connection diagram and correct wiring
	Servomotor or encoder wiring disconnected	--	Reconnect wiring
	Overloaded	Run under no load	Reduce load or replace with larger capacity Servomotor
	Speed/position references not input	Check reference input pins	Correctly input speed/position references
	/S-ON is turned OFF	Check settings of user constants Pn50A.0 and Pn50A.1	Turn /S-ON input ON
	/P-CON input function setting incorrect	Check user constant Pn000.1	Refer to section *5.3.5* and set user constants to match application
	Reference pulse mode selection incorrect	Refer to section *5.2.2*	Correct setting of user constant Pn200.0
	Encoder type differs from user constant setting	Incremental or absolute encoder?	Set user constant Pn002.2 to the encoder type being used
	P-OT and N-OT inputs are turned OFF	Refer to section *5.1.2*	Turn P-OT and N-OT input signals ON
	CLR input is turned ON	Check status of error counter clear input	Turn CLR input OFF
	SEN input is turned OFF	When absolute encoder is used	Turn SEN input ON
Servomotor Moves Instantaneously, then Stops	Servomotor or encoder wiring incorrect	---	Refer to chapter *3* and correct wiring
Suddenly Stops during Operation and will Not Restart	Alarm reset signal (/ALM-RST) is turned ON because an alarm occurred	---	Remove cause of alarm. Turn alarm reset signal (ALM-RST) from ON to OFF

Symptom	Cause	Inspection	Remedy
Servomotor Speed Unstable	Wiring connection to motor defective	Check connection of power lead (U, V and W phases) and encoder connectors	Tighten any loose terminals or connectors
Servomotor Vibrates at Approximately 200 to 400 Hz	Speed loop gain value too high	---	Reduce speed loop gain (Pn100) preset value
	Speed/position reference input lead too long	---	Minimize length of speed/position reference input lead. with impedance not exceeding several hundred ohms
	Speed/position reference input lead is bundled with power cables	---	Separate reference input lead at least 30 cm from power cables
High Rotation Speed Overshoot on Starting and Stopping	Speed loop gain value too high	---	Reduce speed loop gain (Pn100) preset value Increase integration time constant (Pn101)
	Speed loop gain is too low compared to position loop gain	---	Increase the value of user constant Pn100 (speed loop gain) Reduce the integration time constant (Pn101)
Servomotor Overheated	Ambient temperature too high	Measure Servomotor ambient temperature	Reduce ambient temperature to 40°C max
	Servomotor surface dirty	Visual check	Clean dust and oil from motor surface
	Overloaded	Run under no load	Reduce load or replace with larger capacity Servomotor
Abnormal Noise	Mechanical mounting incorrect	Servomotor mounting screws loose?	Tighten mounting screws
		Coupling not centered?	Center coupling
		Coupling unbalanced?	Balance coupling
	Bearing defective	Check noise and vibration near bearing	Consult your Yaskawa representative if defective
	Machine causing vibrations	Foreign object intrusion, damage or deformation of sliding parts of machine	Consult with machine manufacturer
Speed Reference 0 V but Servomotor Rotates	Speed reference voltage offset applied	---	Adjust reference offset Refer to sections *7 2 4* and *7 2 5*.

9.2.3 Alarm Display Table

A summary of alarm displays and alarm code outputs is given in the following table

Table 9.5 Alarm Display Table

Alarm Display	Alarm Code Outputs			ALM Output	Alarm Name	Meaning
	ALO1	ALO2	ALO3			
A.02	OFF	OFF	OFF	OFF	User Constant Breakdown *3	EEPROM data of Servopack is abnormal
A.03					Main Circuit Encoder Error	Detection data for power circuit is abnormal
A.04					User Constant Setting Error *3	The user constant setting is outside the allowable setting range
A.05					Combination Error	Servopack and Servomotor capacities do no match each other
A.10	ON	OFF	OFF	OFF	Overcurrent or Heat Sink Overheated *3	An overcurrent flowed through the IGBT Heat sink of Servopack was overheated
A.30	ON	ON	OFF	OFF	Regeneration Error Detected	• Regenerative circuit is faulty • Regenerative resistor is faulty
A.32					Regenerative Overload	Regenerative energy exceeds regenerative resistor capacity
A.40	OFF	OFF	ON	OFF	Overvoltage	Main circuit DC voltage is excessively high
A.41					Undervoltage	Main circuit DC voltage is excessively low
A.51	ON	OFF	ON	OFF	Overspeed	Rotational speed of the motor is excessively high
A.71	ON	ON	ON	OFF	Overload: High Load	The motor was operating for several seconds to several tens of seconds under a torque largely exceeding ratings
A.72					Overload: Low Load	The motor was operating continuously under a torque largely exceeding ratings
A.73					Dynamic Brake Overload	When the dynamic brake was applied, rotational energy exceeded the capacity of dynamic brake resistor
A.74					Overload of Surge Current Limit Resistor	The main circuit power was frequently turned ON and OFF
A.7A					Heat Sink Overheated *2	The heat sink of Servopack overheated

Alarm Display	Alarm Code Outputs			ALM Output	Alarm Name	Meaning
	ALO1	ALO2	ALO3			
A.81	OFF	OFF	OFF	OFF	Encoder Backup Error*3	All the power supplies for the absolute encoder have failed and position data was cleared
A.82					Encoder Checksum Error*3	The checksum results of encoder memory is abnormal
A.83					Absolute Encoder Battery Error	Battery voltage for the absolute encoder has dropped
A.84					Encoder Data Error*3	Data in the encoder is abnormal
A.85					Encoder Overspeed	The encoder was rotating at high speed when the power was turned ON
A.86					Encoder Overheated	The internal temperature of encoder is too high (Detected only when using absolute encoder)
A.b1					Reference Speed Input Read Error	The A/D converter for reference speed input is faulty
A.b2					Reference Torque Input Read Error	The A/D converter for reference torque input is faulty
A.bF					System Alarm*3	A system error occurred in the Servopack
A.C1	ON	OFF	ON	OFF	Servo Overrun Detected	The Servomotor ran out of control
A.C8					Absolute Encoder Clear Error and Multi-turn Limit Setting Error*3	The multi-turn for the absolute encoder was not properly cleared or set
A.C9					Encoder Communications Error*3	Communications between Servopack and encoder is not possible
A.CA					Encoder Parameter Error*3	Encoder parameters are faulty
A.Cb					Encoder Echoback Error*3	Contents of communications with encoder is incorrect
A.CC					Multiturn Limit Disagreement*3	Different multiturn limits have been set in the encoder and Servopack
A.d0	ON	ON	OFF	OFF	Position Error Pulse Overflow	Position error pulse exceeded user constant (Pn505)
A.F1	OFF	ON	OFF	OFF	Power Line Open Phase	One phase is not connected in the main power supply
CPF00	Not specified				Digital Operator Transmission Error	Digital Operator (JUSP-OP02A-2) fails to communicate with Servopack (e.g., CPU error)
CPF01						
A.--	OFF	OFF	OFF	ON	Not an error	Normal operation status

Note 1 OFF Output transistor is OFF (high) ON Output transistor is ON (low)

2 This alarm display appears only within the range of 30 W to 1000 W.

3 These alarms are not reset for the alarm reset signal (/ALM-RST). Eliminate the cause of the alarm and then turn OFF the power supply to reset the alarms.

4 This alarm will occur for the new version (SGDM-□DA) only.

9.2.4 Warning Displays

The relation between warning displays and warning code outputs are shown in the following table.

Table 9.6 Warning Displays and Outputs

Warning Display	Warning Code Outputs			Warning Name	Meaning of Warning
	ALO1	ALO2	ALO3		
A.91	ON	OFF	OFF	Overload	This warning occurs before the overload alarms (A.71 or A.72) occur. If the warning is ignored and operation continues, an overload alarm may occur.
A.92	OFF	ON	OFF	Regenerative Overload	This warning occurs before the regenerative overload alarm (A.32) occurs. If the warning is ignored and operation continues, a regenerative overload alarm may occur.

Note OFF Output transistor is OFF (high) ON Output transistor is ON (low)

A


Host Controller Connection Examples

This appendix provides examples of connecting SGDM Servopacks to typical host controllers. Refer to the manuals for the host controller when actually connecting to them.

A.1 Connecting the GL-series MC20 Motion Module A-2
A.2 Connecting the CP-9200SH Servo Controller Module (SVA) A-3
A.3 Connecting the GL-series B2813 Positioning Module A-4
A.4 Connecting OMRON's C500-NC221 Position Control Unit A-5
A.5 Connecting OMRON's C500-NC112 Position Control Unit A-6
A.6 Connecting MITSUBISHI's AD72 Positioning Unit A-7
A.7 Connecting MITSUBISHI's AD75 Positioning Unit A-8

A.1 Connecting the GL-series MC20 Motion Module

The following diagram shows an example of connecting to the GL-series MC20 Motion Module In this example, the Servopack is used in Speed Control Mode

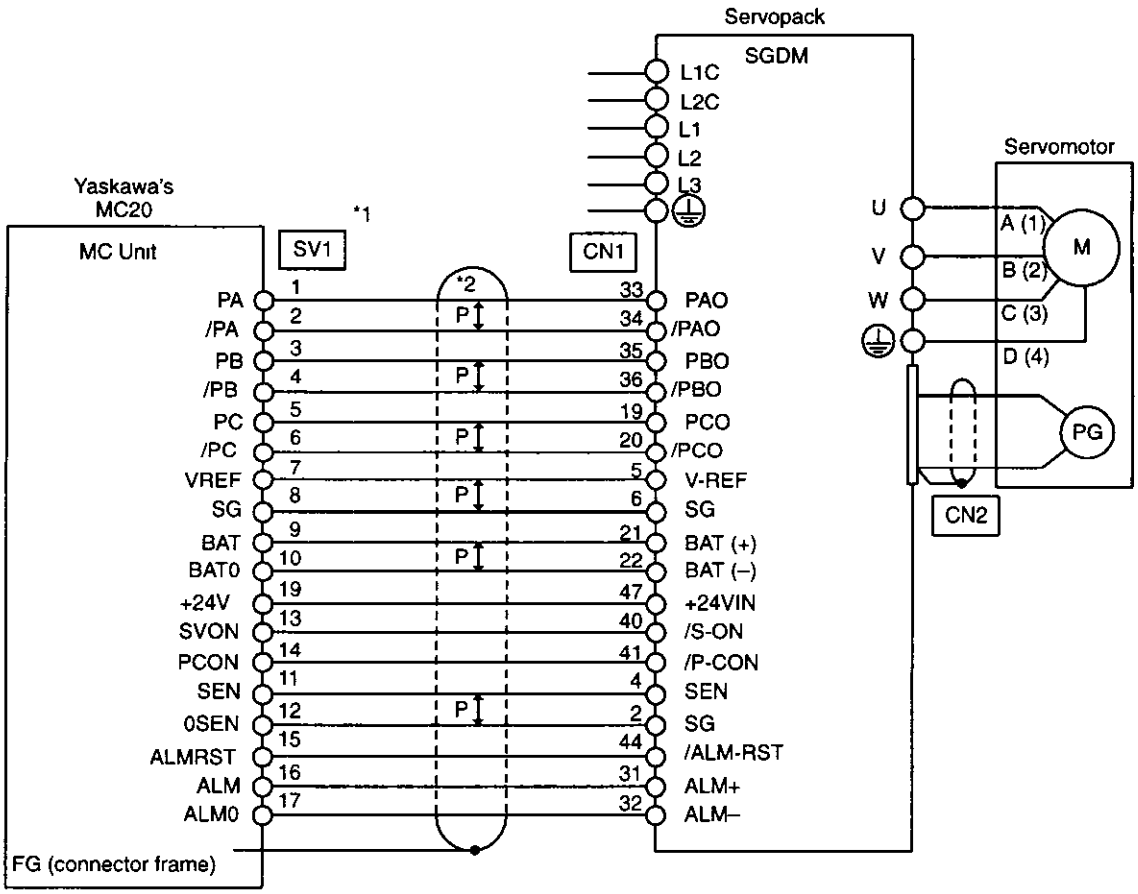


* 1 These pin numbers are the same for SV2 to SV4

* 2 ↕P indicates twisted-pair wires

A.2 Connecting the CP-9200SH Servo Controller Module (SVA)


The following diagram shows an example of connecting to the CP-9200SH Servo Controller Module (SVA) In this example, the Servopack is used in Speed Control Mode

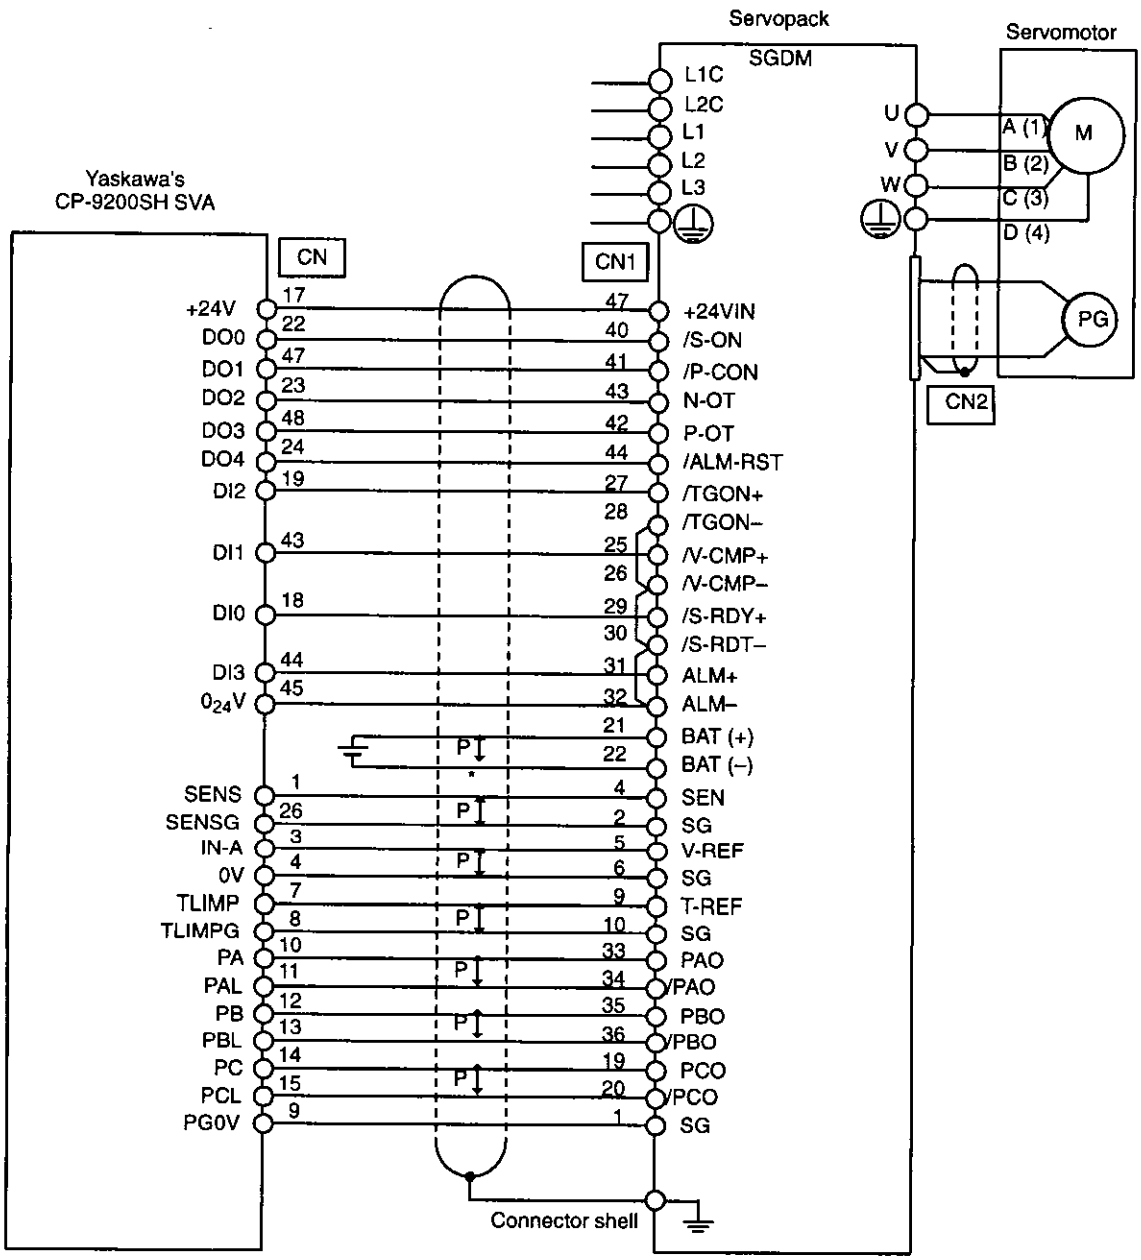

*↕ P indicates twisted-pair wires

A.3 Connecting the GL-series B2813 Positioning Module

The following diagram shows an example of connecting to the GL-series B2813 Positioning Module In this example, the Servopack is used in Position Control Mode

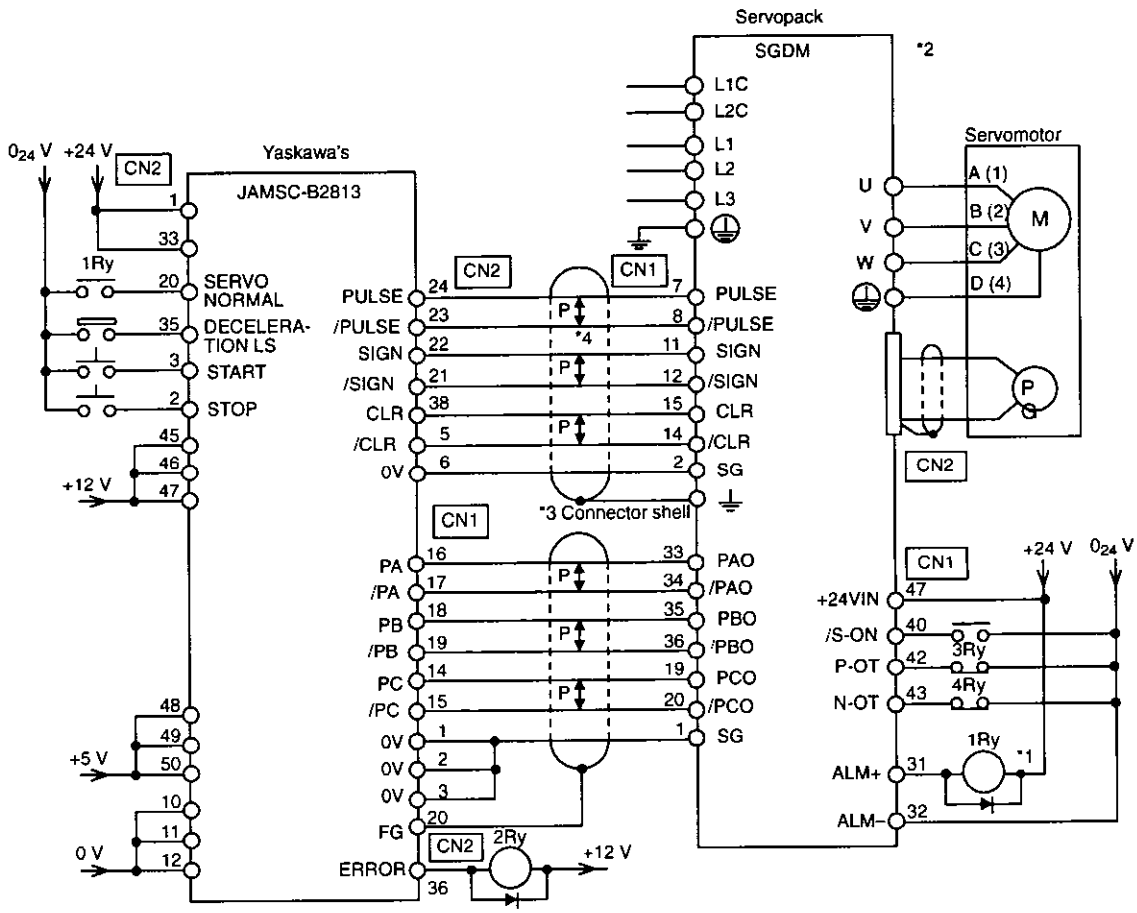

* 1 The ALM signal is output for approximately two seconds when the power is turned ON Take this into consideration when designing the power ON sequence The ALM signal actuates the alarm detection relay 1Ry to stop main circuit power supply to the Servopack


* 2 Set user constant Pn200 0 to 1"

* 3 Connect the shield wire to the connector shell

* 4 ⇕P indicates twisted-pair wires

A.4 Connecting OMRON's C500-NC222 Position Control Unit

The following diagram shows an example of connecting to an OMRON C500-NC222 Position Control Unit In this example, the Servopack is used in Speed Control Mode

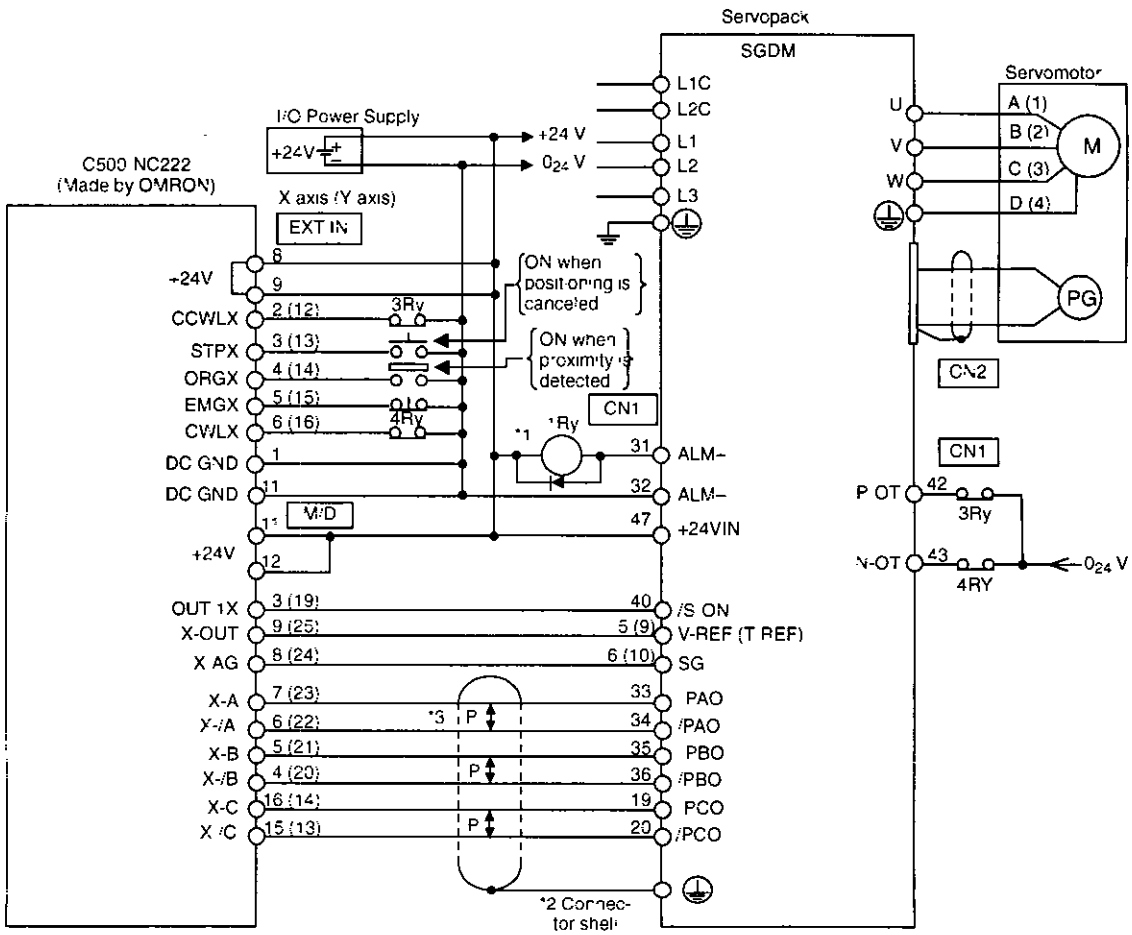

*1 The ALM signal is output for approximately two seconds when the power is turned ON Take this into consideration when designing the power ON sequence The ALM signal actuates the alarm detection relay 1Ry to stop main circuit power supply to the Servopack


*2 Connect the shield wire of the I/O cable to the connector shell

*3 ↕P indicates twisted-pair wires

Note Only signals applicable to OMRON s C500-NC222 Position Control Unit and Yaskawa's SGDM Servopack are shown here

A.5 Connecting OMRON's C500-NC112 Position Control Unit

The following diagram shows an example of connecting to the OMRON C500-NC112 Position Control Unit In this example, the Servopack is used in the position control mode

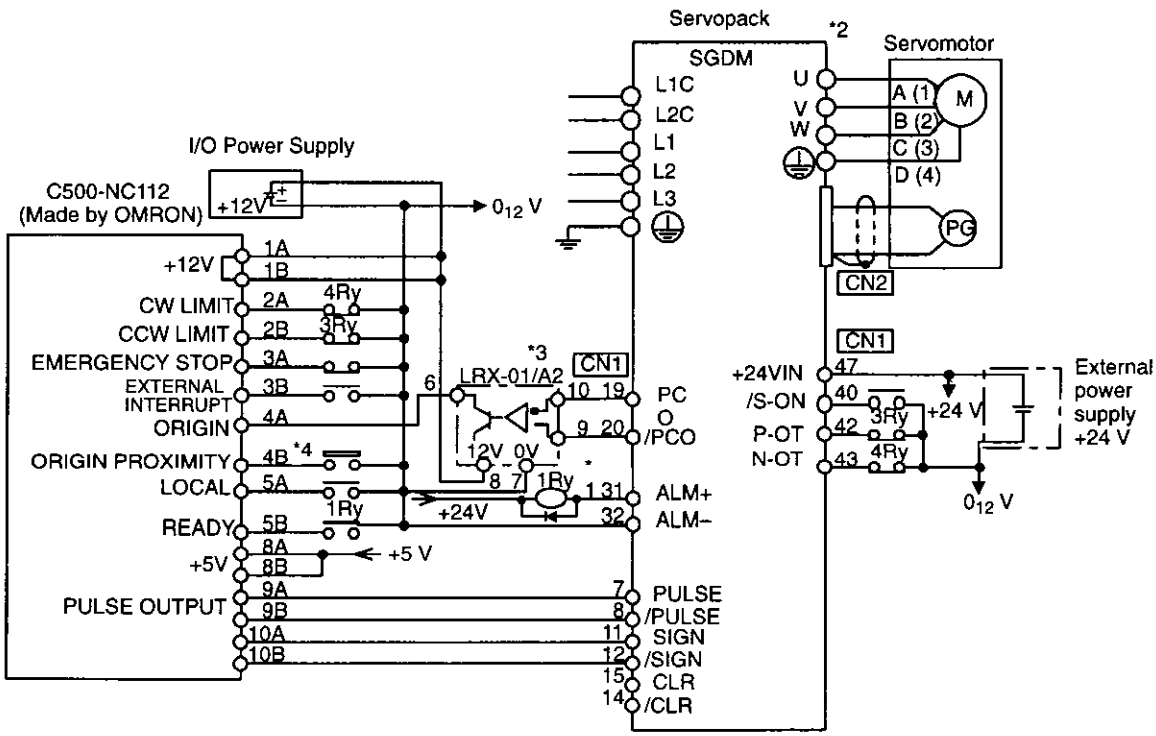

* 1 The ALM signal is output for approximately two seconds when the power is turned ON Take this into consideration when designing the power ON sequence The ALM signal actuates the alarm detection relay 1Ry to stop main circuit power supply to Servopack


* 2 Set user constant Pn200 0 to 1"

* 3 Manufactured by Yaskawa Controls Co , Ltd

Note Only signals applicable to OMRON's C500-NC112 Position Control Unit and Yaskawa's SGDM Servopack are shown here

A.6 Connecting MITSUBISHI's AD72 Positioning Unit

The following diagram shows an example of connecting to the MITSUBISHI AD72 Positioning Unit In this example, the Servopack is used in Speed Control Mode

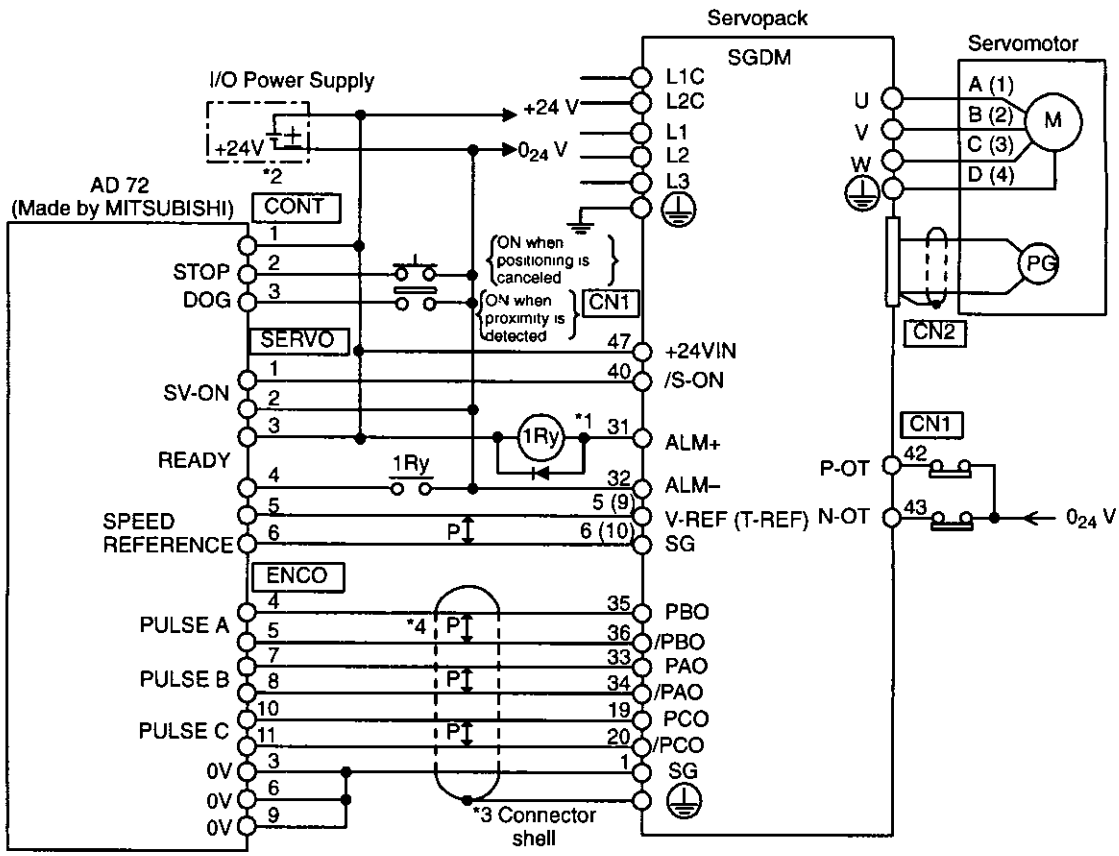

* 1 The ALM signal is output for approximately two seconds when the power is turned ON Take this into consideration when designing the power ON sequence The ALM signal actuates the alarm detection relay 1Ry to stop main circuit power supply to Servopack

* 2 Pin numbers are the same both for X axis and Y axis


* 3 Connect the connector wire of the cable to the connector shell

* 4 ↕P indicates twisted-pair wires

Note Only signals applicable to Mitsubishi's AD72 Positioning Unit and Yaskawa's SGDM Servopack are shown here

A.7 Connecting MITSUBISHI's AD75 Positioning Unit

The following diagram shows an example of connecting to the MITSUBISHI AD75 Positioning Unit In this example, the Servopack is used in Position Control Mode

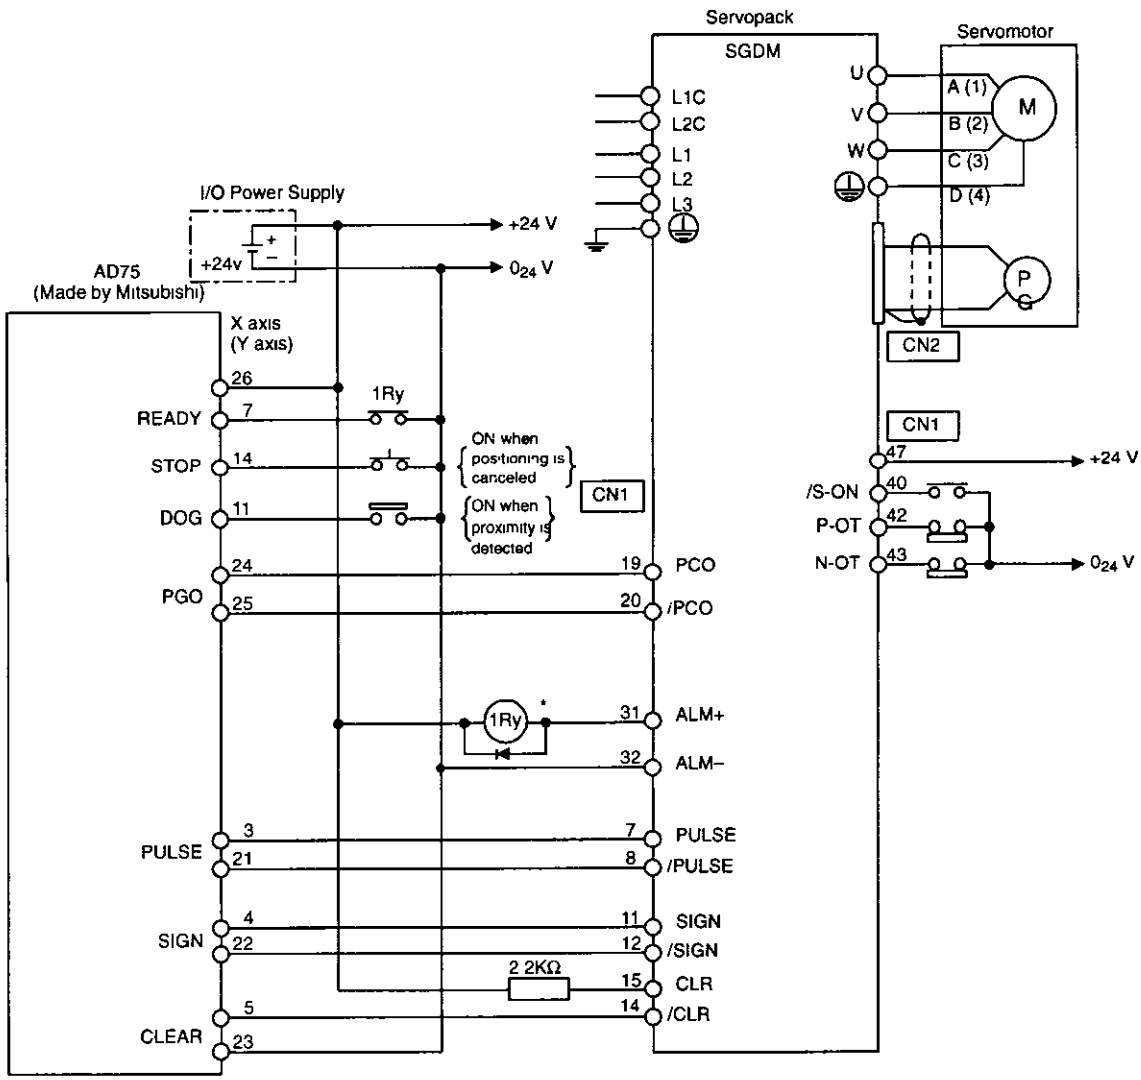

* The ALM signal is output for approximately two seconds when the power is turned ON Take this into consideration when designing the power ON sequence The ALM signal actuates the alarm detection relay 1Ry to stop main circuit power supply to Servopack

Note Only signals applicable to MITSUBISHI's AD75 Positioning Unit and Yaskawa's SGDM Servopack are shown here

B

List of User Constants

This appendix lists the user constants, switches, input signal selections, output signal selections, auxiliary functions, and monitor modes for SGDM Servopacks

B 1 User Constants ..... B - 2
B.2 Switches ..... B - 6
B 3 Input Signal Selections .... B - 11
B 4 Output Signal Selections ..... B - 13
B.5 Auxiliary Functions ..... B - 15
B 6 Monitor Modes ..... B - 16

B.1 User Constants

The following list shows user constants and their settings

Category	User Constant No	Name	Unit	Setting Range	Factory Setting	Reference
Function Selection Constants	Pn000	Function Selection Basic Switches (See note 3)	---	---	0000	5 1 1, 5 3 5
	Pn001	Function Selection Application Switches 1 (See notes 1 and 3)	---	---	0000	5 1 2, 5 4 2, 5 5 7
	Pn002	Function Selection Application Switches 2 (See note 3)	---	---	0000	5 2 8, 5 2 10, 5 7 2
	Pn003	Function Selection Application Switches 3	---	---	0002	6 5
	Pn004	Reserved constants (Do not change) (See note 6)	---	---	0000	---
	Pn005		---	---	0000	---
Gain Related Constants	Pn100	Speed Loop Gain	Hz	1 to 2000	40	---
	Pn101	Speed Loop Integral Time Constant	0 01 ms	15 to 51200	2000	6 2 1
	Pn102	Position Loop Gain	1/s	1 to 2000	40	6 2 1
	Pn103	Inertia Ratio	%	0 to 10000	0	6 2 1, 6 3 3
	Pn104	2nd Speed Loop Gain	Hz	1 to 2000	40	---
	Pn105	2nd Speed Loop Integral Time Constant	0 01 ms	15 to 51200	2000	---
	Pn106	2nd Position Loop Gain	1/s	1 to 2000	40	---
	Pn107	Bias	r/min	0 to 450	0	6 2 4
	Pn108	Bias Width Addition	reference units	0 to 250	7	6 2 4
	Pn109	Feed-forward	%	0 to 100	0	6 2 2
	Pn10A	Feed-forward Filter Time Constant	0 01 ms	0 to 6400	0	5 2 5
	Pn10B	Gain-related Application Switches (See note 3)	---	---	0000	6 2 5
	Pn10C	Mode Switch Torque Reference	%	0 to 800	200	6 2 5
	Pn10D	Mode Switch Speed Reference	r/min	0 to 10000	0	6 2 5
	Pn10E	Mode Switch Acceleration	10 r/min/s	0 to 3000	0	6 2 5
	Pn10F	Mode Switch Error Pulse	reference units	0 to 10000	0	6 2 5
	Pn110	Online Autotuning Switches (See note 3)	---	---	0010	6 3 4
	Pn111	Speed Feedback Compensation (See note 2)	%	1 to 500	100	6 2 6

Category	User Constant No	Name	Unit	Setting Range	Factory Setting	Reference
Gain Related Constants	Pn112	Reserved constants (Do not change) (See note 6)	%	0 to 1000	100	---
	Pn113		---	0 to 1000	1000	---
	Pn114		---	0 to 1000	200	---
	Pn115		---	0 to 65535	32	---
	Pn116		---	0 to 65535	16	---
	Pn117		%	20 to 100	100	---
	Pn118		%	20 to 100	100	---
	Pn119		1/S	1 to 2000	50	---
	Pn11A		0 1%	1 to 2000	1000	---
	Pn11B		Hz	1 to 150	50	---
	Pn11C		Hz	1 to 150	70	---
	Pn11D		%	0 to 150	100	---
	Pn11E		%	0 to 150	100	---
	Pn11F		ms	0 to 2000	0	---
	Pn120		0 01 ms	0 to 51200	0	---
	Pn121		Hz	10 to 250	50	---
	Pn122		Hz	0 to 250	0	---
	Pn123		%	0 to 100	0	---
Position Related Constants	Pn200	Position Control Reference Selection Switches (See note 3)	---	---	0000	5 2 2
	Pn201	PG Divider (See note 3)	p/r	16 to 16384	16384	5 2 3
	Pn202	Electronic Gear Ratio (Numerator) (See note 3)	---	1 to 65535	4	5 2 5
	Pn203	Electronic Gear Ratio (Denominator) (See note 3)	---	1 to 65535	1	5 2 5
	Pn204	Position Reference Accel/Decel Constant	0 01 ms	0 to 6400	0	6 1 2
	Pn205	Multi-turn Limit Setting (See notes 1, 3 and 6)	rev	0 to 65535	65535	5 7 6
	Pn206	Reserved constants (Do not change) (See note 6)	P/rev	513 to 65535	16384	–
	Pn207	Position Control Function Switches (See notes 3 and 6)	–	–	0000	5 2 9, 6 1 2
	Pn208	Position Reference Movement Averaging Time (See notes 3 and 6)	0 01 ms	0 to 6400	0	6 1 2

Category	User Constant No	Name	Unit	Setting Range	Factory Setting	Reference
Speed Related Constants	Pn300	Speed Reference Input Gain	0.01 V/rated speed	150 to 3000	600	5.2.1
	Pn301	Speed 1	r/min	0 to 10000	100	5.2.6
	Pn302	Speed 2	r/min	0 to 10000	200	5.2.6
	Pn303	Speed 3	r/min	0 to 10000	300	5.2.6
	Pn304	Jog Speed	r/min	0 to 10000	500	5.3.2
	Pn305	Soft Start Acceleration Time	ms	0 to 10000	0	6.1.1
	Pn306	Soft Start Deceleration Time	ms	0 to 10000	0	6.1.1
	Pn307	Speed Reference Filter Time Constant	0.01 ms	0 to 65535	40	---
	Pn308	Speed Feed-forward Filter Time Constant	0.01 ms	0 to 65535	0	---
Torque related constants	Pn400	Torque Reference Input Gain	0.1 V/rated torque	10 to 100	30	5.2.7
	Pn401	Torque Reference Filter Time Constant	0.01 ms	0 to 65535	100	6.1.5
	Pn402	Forward Torque Limit	%	0 to 800	800	5.1.3
	Pn403	Reverse Torque Limit	%	0 to 800	800	5.1.3
	Pn404	Forward External Torque Limit	%	0 to 800	100	5.1.3
	Pn405	Reverse External Torque Limit	%	0 to 800	100	5.1.3
	Pn406	Emergency Stop Torque	%	0 to 800	800	5.1.2
	Pn407	Speed Limit during Torque Control	r/min	0 to 10000	10000	5.2.7
	Pn408	Torque Function Switches (See note 6.1)	---	---	0000 (0001)*7	6.1.6
	Pn409	Notch Filter Frequency (See note 6.1)	Hz	50 to 2000	2000 (1500)*7	6.1.6

Category	User Constant No	Name	Unit	Setting Range	Factory Setting	Refer-ence
Sequence related constants	Pn500	Positioning Completed Width	reference units	0 to 250	7	5 5 3
	Pn501	Zero Clamp Level	r/min	0 to 10000	10	5 4 3
	Pn502	Rotation Detection Level	r/min	1 to 10000	20	5 5 5
	Pn503	Speed Coincidence Signal Output Width	r/min	0 to 100	10	5 5 4
	Pn504	NEAR Signal Width	reference units	1 to 250	7	5 5 8
	Pn505	Overflow Level	256 reference units	1 to 32767	1024	6 2 1
	Pn506	Brake Reference Servo OFF Delay Time	10 ms	0 to 50	0	5 4 4
	Pn507	Brake Reference Output Speed Level	r/min	0 to 10000	100	5 4 4
	Pn508	Timing for Brake Reference Output during Motor Operation	10 ms	10 to 100	50	5 4 4
	Pn509	Momentary Hold Time	ms	20 to 1000	20	5 5 9
	Pn50A	Input Signal Selections 1 (See note 3)	---	---	2100	5 3 3
	Pn50B	Input Signal Selections 2 (See note 3)	---	---	6543	5 3 3
	Pn50C	Input Signal Selections 3 (See note 3)	---	---	8888	5 3 3
	Pn50D	Input Signal Selections 4 (See note 3)	---	---	8888	5 3 3
	Pn50E	Output Signal Selections 1 (See note 3)	---	---	3211	5 3 4
	Pn50F	Output Signal Selections 2 (See note 3)	---	---	0000	5 3 4
	Pn510	Output Signal Selections 3 (See note 3)	---	---	0000	5 3 4
	Pn511	Reserved constant (Do not change) (See note 6)	---	---	8888	---
	Pn512	Output Signal Reversal Settings (See notes 3 and 6)	---	---	0000	5 3 4
Other constants	Pn600	Regenerative Resistor Capacity (See note 4)	10 W	0 to capacity*5	0	5 6 1
	Pn601	Reserved constant (Do not change)	---	0 to capacity*5	0	---

B

*1 The multiturn limit must be changed only for special applications. Changing this limit inappropriate or unintentionally can be dangerous

*2 The setting of user constant Pn111 is valid only when user constant Pn110 1 is set to 0

*3 After changing these user constants, turn OFF the main circuit and control power supplies and then turn them ON again to enable the new settings

*4 Normally set to '0'. When using an External Regenerative Resistor, set the capacity (W) of the regenerative resistor

*5 The upper limit is the maximum output capacity (W) of the Servopack

*6 These user constants are supported by the new version of the SGDM Servopacks (SGDM-□DA) only

*7 These factory settings are for Servopacks SGDM-50ADA or more

B.2 Switches

The following list shows the switches and their factory settings

User Constant	Digit Place	Name	Setting	Contents	Factory Setting
Pn000 Function Selection Basic Switches	0	Direction Selection	0	Sets CCW as forward direction	0
			1	Sets CW as forward direction (reverse rotation mode)	
	1	Control Method Selection	0	Speed control (analog reference)	0
			1	Position control (pulse train reference)	
			2	Torque control (analog reference)	
			3	Internal set speed control (contact reference)	
			4	Internal set speed control (contact reference)/Speed control (analog reference)	
			5	Internal set speed control (contact reference)/Position control (pulse train reference)	
			6	Internal set speed control (contact reference)/Torque control (analog reference)	
			7	Position control (pulse train reference)/ Speed control (analog reference)	
			8	Position control (pulse train reference)/ Torque control (analog reference)	
			9	Torque control (analog reference)/ Speed control (analog reference)	
			A	Speed control (analog reference)/ Zero clamp	
			B	Position control (pulse train reference)/ Position control (Inhibit)	
	2	Axis Address	0 to F	Sets Servopack axis address	0
	3	Reserved		---	0

User Constant	Digit Place	Name	Setting	Contents	Factory Setting
Pn001 Function Selection Application Switches	0	Servo OFF or Alarm Stop Mode	0	Stops the motor by applying dynamic brake (DB)	0
			1	Stops the motor by applying dynamic brake (DB) and then releases DB	
			2	Makes the motor coast to a stop state without using the dynamic brake (DB)	
	1	Overtravel Stop Mode	0	Same setting as Pn001 0 (Stops the motor by applying DB or by coasting)	0
			1	Sets the torque of Pn406 to the maximum value, decelerates the motor to a stop, and then sets it to servolock state	
			2	Sets the torque of Pn406 to the maximum value, decelerates the motor to a stop, and then sets it to coasting state	
	2	AC/DC Power Input Selection	0	Not applicable to DC power input Input AC power supply through L1, L2, and (L3) terminals	0
			1	Applicable to DC power input Input DC power supply through (+)1 and (–) terminals	
	3	Warning Code Output Selection	0	ALO1, ALO2, and ALO3 output only alarm codes	0
			1	ALO1, ALO2, and ALO3 output both alarm codes and warning codes While warning codes are output, ALM signal output remains ON (normal state)	
Pn002 Function Selection Application Switches	0	Speed Control Option (T-REF Terminal Allocation)	0	None	0
			1	Uses T-REF as an external torque limit input	
			2	Uses T-REF as a torque feed-forward input	
			3	Uses T-REF as a external torque limit input when P-CL and N-CL are ON	0
Pn002 Function Selection Application Switches	1	Torque Control Option (V-REF Terminal Allocation)	0	None	0
			1	Uses V-REF as an external speed limit input	
	2	Absolute Encoder Usage	0	Uses absolute encoder as an absolute encoder	0
			1	Uses absolute encoder as an incremental encoder	
	3	Reserved constant (Do not change)	0 to 4	---	0

User Constant	Digit Place	Name	Setting	Contents	Factory Setting
Pn003 Function Selection Application Switches	0	Analog Monitor 1 Torque Reference Monitor Analog Monitor 2 Speed Reference Monitor	0	Motor speed 1 V/1000 r/min	2
			1	Speed reference 1 V/1000 r/min	0
			2	Torque reference 1 V/100%	
	1		3	Position error 0 05 V/1 reference unit	
			4	Position error 0 05 V/100 reference unit	
			5	Reference pulse frequency (converted to r/min) 1 V/1000 r/min	
			6	Motor speed × 4 1 V/250 r/min	
			7	Motor speed × 8 1 V/125 r/min	
			8	Reserved constant (Do not change)	
			9		
			A		
			B		
			C		
			D		
			E		
			F		
	2	Not used		---	0
	3	Not used		---	0
Pn10B Gain Application Switches	0	Mode Switch Selection	0	Uses internal torque reference as the condition (Level setting Pn10C)	0
			1	Uses speed reference as the condition (Level setting Pn10D)	
			2	Uses acceleration as the condition (Level setting Pn10E)	
			3	Uses error pulse as the condition (Level setting Pn10F)	
			4	No mode switch function available	
	1	Speed Loop Control Method	0	PI control	0
			1	IP control	
	2	Not used	0	---	0
	3	Reserved constant (Do not change)	0 to 2	---	0

User Constant	Digit Place	Name	Setting	Contents	Factory Setting
Pn110 Online Autotuning Switches	0	Online Autotuning Method	0	Tunes only at the beginning of operation	0
			1	Always tunes	
			2	Does not perform autotuning	
	1	Speed Feedback Compensation Selection	0	Enabled	1
			1	Disabled	
	2	Friction Compensation Selection	0	Friction compensation Disabled	0
			1	Friction compensation Small	
			2	Friction compensation Large	
	3	Reserved Constant (Do not change)	0 to 3	---	0
Pn200 Position Control References Selection Switches	0	Reference Pulse Form	0	Sign + pulse, positive logic	0
			1	CW + CCW, positive logic	
			2	A phase + B phase (x1), positive logic	
			3	A phase + B phase (x2), positive logic	
			4	A phase + B phase (x4) positive logic	
			5	Sign + pulse, negative logic	
			6	CW + CCW, negative logic	
			7	A phase + B phase (x1) negative logic	
			8	A phase + B phase (x2) negative logic	
			9	A phase + B phase (x4) negative logic	
	1	Error Counter Clear Signal Form	0	Clears error counter when the signal goes high	0
			1	Clears error counter at the rising edge of the signal	
			2	Clears error counter when the signal goes low	
			3	Clears error counter at the falling edge of the signal	
	2	Clear Operation	0	Clears error counter at the baseblock	0
			1	Does not clear error counter (Possible to clear error counter only with CLR signal)	
			2	Clears error counter when an alarm occurs	
	3	Filter Selection	0	Reference input filter for line driver signals	0
			1	Reference input filter for open collector signals	
Pn207 [1] Position Control Function Switches	0	Position Reference Filter Selection	0	Acceleration/deceleration filter	0
			1	Average movement filter	
	1	Position Control Option	0	Disabled	0
			1	Uses V-REF as a speed feed-forward input	
	2	Not used		---	0
	3	Not used		---	0

User Constant	Digit Place	Name	Setting	Contents	Factory Setting
Pn408*1 Torque Function Switches	0	Notch Filter Selection	0	Disabled	0 (1)*2
			1	Uses a notch filter for torque reference	
	1	Not used		---	0
	2	Not used		---	0
	3	Not used		---	0

*1 These user constants are supported by the new version of the SGDM Servopacks (SGDM-□DA) only

*2 This factory setting is for Servopacks SGDM-50ADA or more

B.3 Input Signal Selections

The following list shows input signal selections and their factory settings

User Constant	Digit Place	Name	Setting	Contents	Factory Setting
Pn50A	0	Input Signal Allocation Mode	0	Sets the input signal allocation for the sequence to the same one as for the SGDB Servopack (See note 1)	0
			1	Possible to freely allocate the input signals	
	1	/S-ON Signal Mapping (Servo ON when low)	0	Inputs from the SI0 (CN1-40) input terminal	0 SI0
			1	Inputs from the SI1 (CN1-41) input terminal	
			2	Inputs from the SI2 (CN1-42) input terminal	
			3	Inputs from the SI3 (CN1-43) input terminal	
			4	Inputs from the SI4 (CN1-44) input terminal	
			5	Inputs from the SI5 (CN1-45) input terminal	
			6	Inputs from the SI6 (CN1-46) input terminal	
			7	Sets signal ON	
			8	Sets signal OFF	
			9 (See note 2)	Inputs the reverse signal from the SI0 (CN1-40) input terminal	
			A (See note 2)	Inputs the reverse signal from the SI1 (CN1-41) input terminal	
			B (See note 2)	Inputs the reverse signal from the SI2 (CN1-42) input terminal	
			C (See note 2)	Inputs the reverse signal from the SI3 (CN1-43) input terminal	
			D (See note 2)	Inputs the reverse signal from the SI4 (CN1-44) input terminal	
			E (See note 2)	Inputs the reverse signal from the SI5 (CN1-45) input terminal	
			F (See note 2)	Inputs the reverse signal from the SI6 (CN1-46) input terminal	
Pn50A	2	/P-CON Signal Mapping (P control when low)	0 to F (See note 2)	Same as above	1 SI1
	3	P-OT Signal Mapping (Overtravel when high)	0 to F (See note 2)	Same as above	2 SI2

User Constant	Digit Place	Name	Setting	Contents	Factory Setting
Pn50B	0	N-OT Signal Mapping (Over-travel when high)	0 to F (See note 2)	Same as above	3 SI3
	1	/ALM-RST Signal Mapping (Alarm reset when low)	0 to F (See note 2)	Same as above	4 SI4
	2	/P-CL Signal Mapping (Torque control when low)	0 to F (See note 2)	Same as above	5 SI5
	3	/N-CL Signal Mapping (Torque control when low)	0 to F (See note 2)	Same as above	6 SI6
Pn50C	0	/SPD-D Signal Mapping (Internal Set Speed Selection)	0 to F (See note 2)	Same as above	8 OFF
	1	/SPD-A Signal Mapping (Internal Set Speed Selection)	0 to F (See note 2)	Same as above	8 OFF
	2	/SPD-B Signal Mapping (Internal Set Speed Selection)	0 to F (See note 2)	Same as above	8 OFF
	3	/C-SEL Signal Mapping (Control Mode Switching)	0 to F (See note 2)	Same as above	8 OFF
Pn50D	0	/ZCLAMP Signal Mapping (Zero Clamping)	0 to F (See note 2)	Same as above	8 OFF
	1	/INHIBIT Signal Mapping (Disabling Reference Pulse)	0 to F (See note 2)	Same as above	8 OFF
	2	/G-SEL Signal Mapping (Gain Switching)	0 to F (See note 2)	Same as above	8 OFF
	3	(Reserved)	0 to F (See note 2)	Same as above	8 OFF

Note 1. When Pn50A 0 is set to 0 for the SGDB Servopack, only the following modes are compatible Pn50A 1=7, Pn50A 3=8, and Pn50B 0=8

2 User constant settings 9 and A to F can be used for the new version of the SGDM Servopacks (SGDM-□DA) only

B.4 Output Signal Selections

The following list shows output signal selections and their factory settings

User Constant	Digit Place	Name	Setting	Contents	Factory Setting
Pn50E	0	/COIN Signal Mapping	0	Disabled	1 SO1
			1	Outputs from the SO1 (CN1-25, 26) output terminal	
			2	Outputs from the SO2 (CN1-27, 28) output terminal	
			3	Outputs from the SO3 (CN1-29, 30) output terminal	
	1	/V-CMP Signal Mapping	0 to 3	Same as above	1 SO1
	2	/TGON Signal Mapping	0 to 3	Same as above	2 SO2
	3	/S-RDY Signal Mapping	0 to 3	Same as above	3 SO3
Pn50F	0	/CLT Signal Mapping	0 to 3	Same as above	0 Not used
	1	/VLT Signal Mapping	0 to 3	Same as above	
	2	/BK Signal Mapping	0 to 3	Same as above	
	3	/WARN Signal Mapping	0 to 3	Same as above	
Pn510	0	/NEAR Signal Mapping	0 to 3	Same as above	
	1	Reserved	0 to 3	Same as above	
	2	Not used	0	---	0
	3	Not used	0	---	0
Pn512*	0	Output Signal Reversal for SO1 (CN1-25 and 26)	0	Output signal is not reversed	0 Not reversed
			1	Output signal is reversed	
	1	Output Signal Reversal for SO2 (CN1-27 and 28)	0	Output signal is not reversed	0 Not reversed
			1	Output signal is reversed	
	2	Output Signal Reversal for SO3 (CN1-29 and 30)	0	Output signal is not reversed	0 Not reversed
			1	Output signal is reversed	
	3	Not used	---	---	0

* These user constants are supported by the new version of the SGDM Servopacks (SGDM-□DA) only

Note 1. When more than one signal is allocated to the same output circuit, data is output using OR logic

2. Depending on the control mode, undetected signals are treated as OFF For example, in the speed control mode, the /COIN signal is treated as OFF

3. Types of /WARN signals Overload and regenerative overload

B.5 Auxiliary Functions

The following list shows the available auxiliary functions

User Constant	Function
Fn000	Alarm traceback data display
Fn001	Rigidity setting during online autotuning
Fn002	JOG mode operation
Fn003	Zero-point search mode
Fn004	(Reserved constant)
Fn005	User constant settings initialization
Fn006	Alarm traceback data clear
Fn007	Writing to EEPROM inertia ratio data obtained from online autotuning
Fn008	Absolute encoder multi-turn reset and encoder alarm reset
Fn009	Automatic tuning of analog (speed, torque) reference offset
Fn00A	Manual adjustment of speed reference offset
Fn00B	Manual adjustment of torque reference offset
Fn00C	Manual zero-adjustment of analog monitor output
Fn00D	Manual gain-adjustment of analog monitor output
Fn00E	Automatic offset-adjustment of motor current detection signal
Fn00F	Manual offset-adjustment of motor current detection signal
Fn010	Password setting (protects user constants from being changed)
Fn011	Motor models display
Fn012	Software version display
Fn013*	Multiturn limit setting change when a Multiturn Limit Disagreement Alarm (A CC) occurs

* This user constant is supported by the new version of the SGDM Servopacks (SGDM-□DA) only

B.6 Monitor Modes

The following list shows monitor modes available

User Constant	Content of Display	Unit	Remarks
Un000	Actual motor speed	r/min	---
Un001	Input speed reference	r/min	---
Un002	Internal torque reference	%	Value for rated torque
Un003	Rotation angle 1	pulse	Number of pulses from the origin
Un004	Rotation angle 2	deg	Angle from the origin (electrical angle)
Un005	Input signal monitor	---	---
Un006	Output signal monitor	---	---
Un007	Input reference pulse speed	r/min	---
Un008	Error counter value	reference units	Amount of position error
Un009	Accumulated load rate	%	Value for the rated torque as 100% Displays effective torque in 10-s cycle
Un00A	Regenerative load rate	%	Value for the processable regenerative power as 100% Displays effective torque in 10-s cycle
Un00B	Power consumed by DB resistance	%	Value for the processable power when dynamic brake is applied as 100% Displays effective torque in 10-s cycle
Un00C	Input reference pulse counter	---	Displayed in hexadecimal
Un00D	Feedback pulse counter	---	Displayed in hexadecimal

C

Additional Functions for SGDM-□DA (New Version)

This appendix lists the new functions added for the SGDM-□DA (new version)

C 1 Additional Functions for SGDM-□DA (New Version) ..... C - 2

C.1 Additional Functions for SGDM-□DA (New Version)

In the new version of SGDM Servopacks (SGDM-□DA). the memory capacity of the control board has been increased, control algorithms in the CPU have been improved to increase speed, and CPU functions have been improved The main changes that have been made are listed in the following table

The capacity of applicable Servomotors has also been increased to 7 5 kW The Servomotor capacity range for SGDM-□D Servomotors is from 30 W to 3 0 kW

Table C.1. Additional Functions for SGDM-□DA (New Version)

Additional Function	Outline	Related Section
Speed Feed-forward Function	A speed feed-forward reference using an analog voltage can be added using the speed reference (V-REF) in position control mode	5 2 9
Torque Limiting via Analog Voltage, Function 2	A torque limit function using an analog voltage reference can be enabled when the /P-CL or /N-CL signal is ON	5 2 11
Sequence Input Signal Polarity Reversal	The polarity of the valid sequence input signal logic can be reversed	5 3 3
Sequence Output Signal Polarity Reversal	The polarity of the valid sequence output signal logic can be reversed	5 3 4
Multiturn Limit Setting	An upper limit can be set for the multiturn data when an absolute encoder is used Although this function was described in the previous version of this manual, the SGDM-□D Servopacks did not support it	5 7 6
Multiturn Limit Disagreement Alarm Detection	An alarm (A CC) is generated when the multiturn limit setting in the encoder is not the same as the setting in the Servopack	5 7 6
Position Reference Average Movement Filter	A filter can be applied inside the Servopack to a constant-frequency position reference pulse Either an average movement filter or the previous acceleration/deceleration filter can be selected	6 1 2
Notch Filter	This filter can be used to control vibration occurring at a specific frequency in the machine In comparison to the previous torque reference filter, the attenuation characteristics of the notch filter near the set frequency is better, making it effective in controlling vibration at a specific frequency	6 1 6

INDEX

Symbols

/ALM–RST input signal 5 - 72

/BK signal 5 - 70

/CLT signal 5 - 10 5 - 13

/N–CL signal 5 - 12

/P–CL signal 5 - 12

/P–CON signal 5 - 36 5 - 42 5 - 49
  using the 5 - 17

/TGON signal 5 - 77

A

absolute data 5 - 98

absolute encoders 3 - 22 5 - 92
  battery replacement 9 - 4
  mounted to Servomotor 5 - 93
  multiturn limit setting 5 - 101
  reception sequence 5 - 97
  selecting 5 - 94
  setup 5 - 95
  transmission sequence 5 - 98

absolute signals 5 - 97

absorbable energy 5 - 91

acceleration used as detection point, 6 - 13

adjusting gain 6 - 4

adjusting offset 6 - 5

alarm code outputs 5 - 71

alarm contents transferring 5 - 101

alarm display table 9 - 33

alarm displays used for troubleshooting 9 - 5

alarm traceback data clearing 7 - 30

alarm traceback mode 7 - 20

alarms checking 7 - 20

analog input circuit 3 - 19

analog monitor 6 - 35 7 - 40

analog signals 3 - 19

analog voltage reference
  function 1 5 - 46
  function 2 5 - 47

automatic adjustment of speed and torque reference offset 7 - 23

autotuning 6 - 17

auxiliary functions B - 15

B

batteries 5 - 94
  absolute encoder, 9 - 4

bias function, 6 - 33

brake ON timing, 5 - 69

Built–in Panel Operator, 5 - 96, 5 - 103 6 - 21 6 - 23 7 - 2, 7 - 9

C

cable stress 2 - 6

cables
  encoder 5 - 114
  specifications 3 - 10

CN1
  specifications 3 - 15
  terminal layout, 3 - 15

CN2
  connector models 3 - 23
  connector terminal layout 3 - 23

contact input speed control, 5 - 32
  example 5 - 37
  operation by 5 - 35
  selection 5 - 60 5 - 61
  using 5 - 33

control modes
  description, 5 - 60
  selection 5 - 60

control panel, Servopacks 2 - 9

cooling, Servopacks 2 - 8

CP–9200SH Servo Controller Module A - 3

current loop, 6 - 27

D

DATA/ENTER Key, 6 - 20

DATA/SHIFT Key 7 - 9

DC reactor 5 - 117

detection point, 6 - 12, 6 - 13, 6 - 14

Digital Operator 7 - 1
See also Built-in Panel Operator, Hand-held Digital Operator
alarm traceback mode 7 - 20
basic mode selection 7 - 5
connecting the 7 - 2
functions 7 - 3
initializing user constant settings 7 - 38
monitor mode 7 - 14
origin search mode 7 - 36
password setting 7 - 49
position control mode 7 - 7
reference offset automatic adjustment mode 7 - 23
reference offset manual adjustment mode 7 - 26
speed and torque display mode 7 - 6
status display mode 7 - 5
types 7 - 2
user constant setting mode 7 - 8

dimensional drawings
Servopacks 8 - 36
SGMAH Servomotors 8 - 6
SGMDH Servomotors 8 - 23
SGMGH Servomotors 8 - 13, 8 - 17
SGMPH Servomotors 8 - 9
SGMSH Servomotors 8 - 20

DSPL/SET Key 6 - 20

dynamic brake 5 - 64

E

electronic gear setting the 5 - 29
examples 5 - 31

electronic gear function 5 - 28

encoder alarms resetting 5 - 72

encoder signal output 5 - 23

encoders
absolute 3 - 22, 5 - 92
battery replacement 9 - 4
multiturn limit setting 5 - 101
reception sequence 5 - 97
selecting 5 - 94
setup 5 - 95
transmission sequence 5 - 98
cables 5 - 114
incremental 3 - 22
wiring to Servopack 3 - 22

error counter clearing 5 - 21

error pulses used as detection point 6 - 14

external power supply input 24 V 5 - 27

F

feed-forward control 6 - 9

feed-forward functions 6 - 33
speed 5 - 45
torque 5 - 44

feedback loops 6 - 27

feedback pulse counter monitor display 7 - 18

forward rotation prohibited signal 7 - 21, 7 - 36

friction compensation 6 - 25

functions
new Servopack version C - 1
selection 7 - 10

fuse capacity 5 - 107

G

gain adjusting 6 - 4, 7 - 40, 7 - 43

GL-series B2813 Positioning Module A - 4

GL-series MC20 Motion Module A - 2

grounding 5 - 108, 5 - 110

H

Hand-held Digital Operator 5 - 95, 5 - 103, 6 - 20, 6 - 22, 7 - 2
using the 7 - 8

harmonic suppression 5 - 117

high-speed positioning 6 - 7

holding brake 5 - 67, 5 - 70

host controller connection examples A - 1

host controller input circuit, 5 - 16

I

I/O signal generation timing example 5 - 20

I/O signals 5 - 24
names and functions 3 - 16
SGDM Servopack 3 - 13
used for protective sequence, 5 - 71

incremental encoders 3 - 22

incremental pulses 5 - 100

index 6 - 33

inertia ratio 6 - 7

INHIBIT 5 - 49

INHIBIT function 5 - 49

INHIBIT signal and reference pulses 5 - 49

input pulse multiplier 5 - 20

input signal monitor display 7 - 16

input signals 3 - 16 4 - 13
  allocation 5 - 51
  enabling and disabling 5 - 6
  required for trial operation 4 - 12
  selections B - 11

inspection 9 - 1
  Servomotors 9 - 2
  Servopacks 9 - 3

installation Servopacks 2 - 8

installation direction Servomotors, 2 - 3

installation site
  Servomotors 2 - 3
  Servopacks 2 - 7

insufficient voltage alarm 5 - 82

integral time constant 6 - 7

interface circuit absolute encoder and Servomotor 5 - 93

interface circuits 3 - 19

interlock 5 - 75

J

JOG speed 5 - 51

L

line driver output circuit connecting to 3 - 20

line–driver output connection example 5 - 17

load inertia 6 - 7 6 - 17

M

main circuit
  power supply 5 - 82
  terminal blocks wiring 3 - 12
  terminals 3 - 9
  wiring 3 - 8
    example 3 - 10
    precautions 3 - 8

maintenance 9 - 1

manual adjustment of speed and torque reference offset 7 - 26

manual adjustments 6 - 29

manual zero adjustment 7 - 40

MCCB capacity 5 - 107

mechanical rigidity settings for online autotuning 6 - 20

Mitsubishi
  AD72 Positioning Unit A - 7
  AD75 Positioning Unit A - 8

mode switch function, 6 - 11

mode switch 6 - 11

monitor modes B - 16

motor current detection offset, 7 - 45

motor model checking the, 7 - 32

multiturn limit setting 5 - 101

N

near output signal, 5 - 80

new version, Servopacks C - 1

noise control 5 - 109

noise filters 5 - 110

notch filter 6 - 6

O

offset
  adjusting, 5 - 63 6 - 5
  automatic adjustment, 7 - 23
  manual adjustment, 7 - 26

oil and water, Servomotors, 2 - 6

OMRON
  C500–NC112 Position Control Unit, A - 6
  C500–NC221 Position Control Unit, A - 5

online autotuning 6 - 17
  mechanical rigidity settings for 6 - 20
  related user constants, 6 - 24
  saving results of 6 - 22
  setting user constants for, 6 - 19

open collector output circuit, connecting to, 3 - 21

open–collector output connection example, 5 - 18

operating conditions, Servopacks, 9 - 3

orientation
  Servomotors 2 - 3
  Servopacks, 2 - 8

origin pulses 5 - 100

output circuit interfaces 3 - 20

output pulse form, 5 - 24

output signal monitor display 7 - 17

output signals, 3 - 17
  allocation 5 - 57
  selections B - 13

overload signal, 5 - 79

overshooting, 6 - 11

overtravel limit function
  setting the 5 - 5
  using the 5 - 5

P

Panel Operator using the
  See Built-in Panel Operator

PAO serial data specifications 5 - 99

peripheral devices 3 - 10
  connecting to 3 - 2
  single-phase specifications 3 - 3
  three-phase specifications 3 - 4

PG dividing ratio 5 - 100

PG dividing ratio setting 5 - 24

photocoupler output circuit connecting to 3 - 21

photocoupler output signals 5 - 71 5 - 75

position control 6 - 31

position control (inhibit) 5 - 61

position control (pulse train reference) 5 - 61

Position Control Mode 3 - 26
  trial operation 4 - 8

position loop 6 - 5 6 - 27

position loop gain 6 - 16 6 - 17 6 - 28, 6 - 32 6 - 34
  setting 6 - 8

position reference 5 - 17

positioning high-speed 6 - 7

positioning completed output signal 5 - 74

power loss 5 - 82

power supply
  harmonic suppression 5 - 117
  single-phase specifications 3 - 24
  three-phase specifications 3 - 25

proportional (P) control 6 - 11

proportional control 6 - 9

proportional/integral (PI) control 6 - 11

protective sequence 5 - 71

PSO serial data specifications 5 - 99

pulse control (pulse train reference) 5 - 60

pulse divider setting the 5 - 25

pulse dividing ratio setting the 5 - 100

R

radial load Servomotors 2 - 4

reception sequence 5 - 97

reference input circuits 3 - 19

reference input line noise 5 - 110

reference offset adjustment 5 - 63 6 - 5

reference position input circuit 3 - 19

reference pulse counter monitor display, 7 - 18

reference pulse form selecting, 5 - 19

reference pulse input signal timing 5 - 21

reference speed input 3 - 19

reference torque input 3 - 19

reference voltage offset 6 - 5

regenerative energy calculating 5 - 88

regenerative overload signal 5 - 79

regenerative resistors
  built-in 5 - 83
  calculating capacity 5 - 86
  connecting 5 - 84
  external 5 - 84

response characteristics 6 - 32

responsiveness 6 - 28 6 - 32

Reverse Rotation Mode 5 - 4
  setting the 5 - 4

reverse rotation prohibited signal, 7 - 21, 7 - 36

rigidity 6 - 34

running output signal 5 - 77

S

SEN signal 5 - 78 5 - 93 5 - 101

sequence I/O signal monitor display 7 - 16

sequence I/O signals 5 - 26

sequence input circuit interface 3 - 20

Serial Encoders 1 - 4

servo alarm
  outputs 5 - 71
  resetting 7 - 4

servo gain 6 - 17
  adjusting 6 - 27
  setting 6 - 7
  user constants 6 - 27

Servo ON input signal 5 - 73

Servo Ready output signal 5 - 78

servo system block diagram 6 - 27

Servomotor Stop Mode, 5 - 6

Servomotors 1 - 2 2 - 2
handling oil and water 2 - 6
inspection 9 - 2
installation site 2 - 3
product part names 1 - 8
ratings 8 - 2
rotation direction 7 - 23
setting rotation direction 5 - 36
SGMAH dimensional drawings, 8 - 6
SGMAH ratings and specifications 8 - 2
SGMAH torque and motor speed 8 - 4
SGMDH dimensional drawings 8 - 23
SGMDH ratings and specifications, 8 - 21
SGMDH torque and motor speed 8 - 22
SGMGH dimensional drawings, 8 - 13, 8 - 17
SGMGH ratings and specifications, 8 - 10 8 - 14
SGMGH torque and motor speed, 8 - 11 8 - 15
SGMPH dimensional drawings, 8 - 9
SGMPH ratings and specifications, 8 - 7
SGMPH torque and motor speed, 8 - 8
SGMSH dimensional drawings 8 - 20
SGMSH ratings and specifications, 8 - 18
SGMSH torque and motor speed, 8 - 19
shaft alignment 2 - 3
shaft load 2 - 4
storage temperature 2 - 2
switching rotation direction 5 - 4
winding resistance loss 5 - 89

Servopacks 1 - 6 2 - 7
absorbable energy 5 - 91
control panel 2 - 9
cooling 2 - 8
dimensional drawings 8 - 36
I/O signals 3 - 13
inspection 9 - 3
installation 2 - 8
installation site 2 - 7
internal block diagrams 3 - 5
new version functions C - 1
online autotuning function 6 - 17
operating conditions 9 - 3
orientation 2 - 8
output circuits 3 - 20
power loss 3 - 11
product part names 1 - 9
ratings 8 - 29
Reverse Rotation Mode 5 - 4
setting up the SGDM 5 - 50
specifications 8 - 24
standard connection examples 3 - 24
stopping 5 - 63
storage conditions 2 - 7
user constants 5 - 50
wiring to encoders 3 - 22

shaft alignment Servomotors 2 - 3

shaft load Servomotors 2 - 4

signals
/ALM–RST, 5 - 72
/BK 5 - 70
/CLT, 5 - 10, 5 - 13
/COIN 5 - 74, 5 - 80
/N–CL 5 - 12
/NEAR 5 - 80
/P–CL 5 - 12
/P–CON 5 - 36 5 - 42 5 - 49
/S–RDY 5 - 78
/TGON 5 - 77
/V–CMP 5 - 75
/WARN, 5 - 79
absolute 5 - 97
analog 3 - 19
analog monitor, 6 - 35
forward rotation prohibited 7 - 21 7 - 36
I/O connections, 3 - 14
photocoupler output, 5 - 71
reverse rotation prohibited, 7 - 21 7 - 36
SEN 5 - 78, 5 - 93, 5 - 101
Servo ON 5 - 73

smoothing capacitor, 5 - 83

smoothing function 6 - 3

soft start function 6 - 2

software version checking the, 7 - 35

specifications
SGMAH Servomotors, 8 - 2
SGMDH Servomotors 8 - 21
SGMGH Servomotors 8 - 10, 8 - 14
SGMPH Servomotors, 8 - 7
SGMSH Servomotors 8 - 18

speed bias 6 - 10

speed coincidence output 5 - 75

speed control 6 - 34
adjusting manually 6 - 29
principle of 5 - 44

speed control (analog reference), 5 - 60, 5 - 61

Speed Control Mode, 3 - 27
trial operation 4 - 7

speed feed–forward function, 5 - 45

speed feedback compensation, 6 - 14, 6 - 24

speed loop 6 - 18 6 - 27

speed loop gain, 6 - 16, 6 - 17, 6 - 31
setting 6 - 7

speed loop integral time constant 6 - 31

speed reference 5 - 15, 6 - 10, 6 - 12, 6 - 28

speed reference input gain 6 - 30

speed reference offset, manual adjustment, 7 - 26

standard Servopack connections, examples 3 - 24

storage conditions, Servopacks, 2 - 7

switches and factory settings B - 6

T

single-phase power supply specifications, 3 - 24

three-phase power supply specifications, 3 - 25

thrust load Servomotors 2 - 4

torque control using 5 - 38

torque control (analog reference) 5 - 60, 5 - 61

Torque Control Mode 3 - 28 6 - 18

torque feed forward function 6 - 18

torque feed-forward function 5 - 44

torque limiting by analog voltage reference
  function 1 5 - 46
  function 2 5 - 47

torque limits 5 - 7 5 - 9
  external 5 - 11

torque reference filter time constant 6 - 5, 6 - 27

torque reference filter time constant 6 - 30 6 - 31

torque reference inputs 5 - 41 6 - 12

torque reference offset manual adjustment 7 - 28

torsion resonance 6 - 30

transmission sequence 5 - 98

trial operation
  in Position Control Mode 4 - 8
  in Speed Control Mode 4 - 7
  input signals 4 - 12
  Servomotor without load 4 - 3
  two-step 4 - 2
  user constants 4 - 12
  using reference input 4 - 7

troubleshooting 9 - 1 9 - 5
  with alarm display 9 - 5
  with no alarm display 9 - 31

two-step trial operation 4 - 2

U

undershooting 6 - 11

user constants 5 - 50
  configuration 5 - 3
  function selection 7 - 10
  initializing settings 7 - 38
  list of B - 2
  numbers 7 - 9
  setting from host controller 5 - 15

W

warning displays 9 - 35

warning output signal 5 - 79

winding resistance loss 5 - 89

wiring 5 - 105
  Servopacks to encoders, 3 - 22

wiring example 3 - 10

wiring precautions 3 - 8 5 - 105

Z

zero clamp, 5 - 61 5 - 65
  conditions 5 - 66

Σ-Ⅱ Series SGM□H/SGDM

USER'S MANUAL
Design and Maintenance

TOKYO OFFICE
New Pier Takeshiba South Tower 1 16 1 Kaigan Minatoku Tokyo 105-6891 Japan
Phone 81 3 5402 4511 Fax 81 3 5402-4580

YASKAWA ELECTRIC AMERICA. INC
2121 Norman Drive South Waukegan iL 60085 U S A
Phone 1 847-887 7000 Fax 1-847 887 7370

MOTOMAN INC HEADQUARTERS
805 Liberty Lane West Carrollton OH 45449 U S A
Phone 1 937-847-6200 Fax 1 937-847-6277

YASKAWA ELÉTRICO DO BRASIL COMÉRCIO LTDA
Avenida Fagundes Filho 620 Bairro Saude Sao Paulo SP Brazil CEP 04304-000
Phone 55 11 5071 2552 Fax 55 11 5581 8795

YASKAWA ELECTRIC EUROPE GmbH
Am Kronberger Hang 2 65824 Schwalbach, Germany
Phone 49-6196 569 300 Fax 49-6196 888 30

Motoman Robotics AB
Box 504 S38525 Torsas Sweden
Phone 46-486 48800 Fax 46 486 41410

Motoman Robotec GmbH
Kammerfeldstraße 8539 Allershausen Germany
Phone 49 8166 900 Fax 49-8166 9039

YASKAWA ELECTRIC UK LTD
1 Hurt Hill Orchardton Woods Cumbernauld G68 9LF United Kingdom
Phone 44 1236 735000 Fax 44 1236-458182

YASKAWA ELECTRIC KOREA CORPORATION
Kfpa Bldg #120 35 4 Youido-dong Yeongdungpo Ku Seoul 150-010 Korea
Phone 82 2 784 7844 Fax 82 2 784-8495

YASKAWA ELECTRIC (SINGAPORE) PTE LTD
151 Lorong Chuan #04-01 New Tech Park Singapore 556741 Singapore
Phone 65 282 3003 Fax 65 289 3003

YATEC ENGINEERING CORPORATION
Shen Hsiang Tang Sung Chiang Building 10F 146 Sung Chiang Road Taipei Taiwan
Phone 886 2 2563-0010 Fax 886 2 2567-4677

BEIJING OFFICE
Room No 301 Office Building of Beijing International Club 21
Jianguomenwai Avenue Beijing 100020 China
Phone 86 10-6532 1850 Fax 86 10-6532 1851

SHANGHAI OFFICE
27 Hui He Road Shanghai 200437 China
Phone 86 21-6553-6600 Fax 86 21-6531 4242

YASKAWA JASON (HK) COMPANY LIMITED
Rm 2909 10 Hong Kong Plaza 186 191 Connaught Road West Hong Kong
Phone 852 2803 2385 Fax 852 2547 5773

TAIPEI OFFICE
Shen Hsiang Tang Sung Chiang Building 10F 146 Sung Chiang Road Taipei Taiwan
Phone 886 2 2563-0010 Fax 886 2 2567-4677

SHANGHAI YASKAWA-TONGJI M & E CO . LTD
27 Hui He Road Shanghai China 200437
Phone 86 21-6531-4242 Fax 86 21-6553-6060

BEIJING YASKAWA BEIKE AUTOMATION ENGINEERING CO , LTD
30 Xue Yuan Road Haidian Beijing P R China Post Code 100083
Phone 86 10-6233-2782 Fax 86 10-6232-1536

SHOUGANG MOTOMAN ROBOT CO . LTD
7 Yongchang North Street Beijing Economic Technological Investment & Development Area,
Beijing 100076 P R China
Phone 86 10-6788-0551 Fax 86 10-6788 2878

YASKAWA ELECTRIC CORPORATION

YASKAWA

Specifications are subject to change without notice
for ongoing product modifications and improvements

MANUAL NO SIE-S800-31 2B

© Printed in Japan June 1999 98-2 ③
98-12②
97 23059 97 23060 97 71094